


Q06-VAADHOO

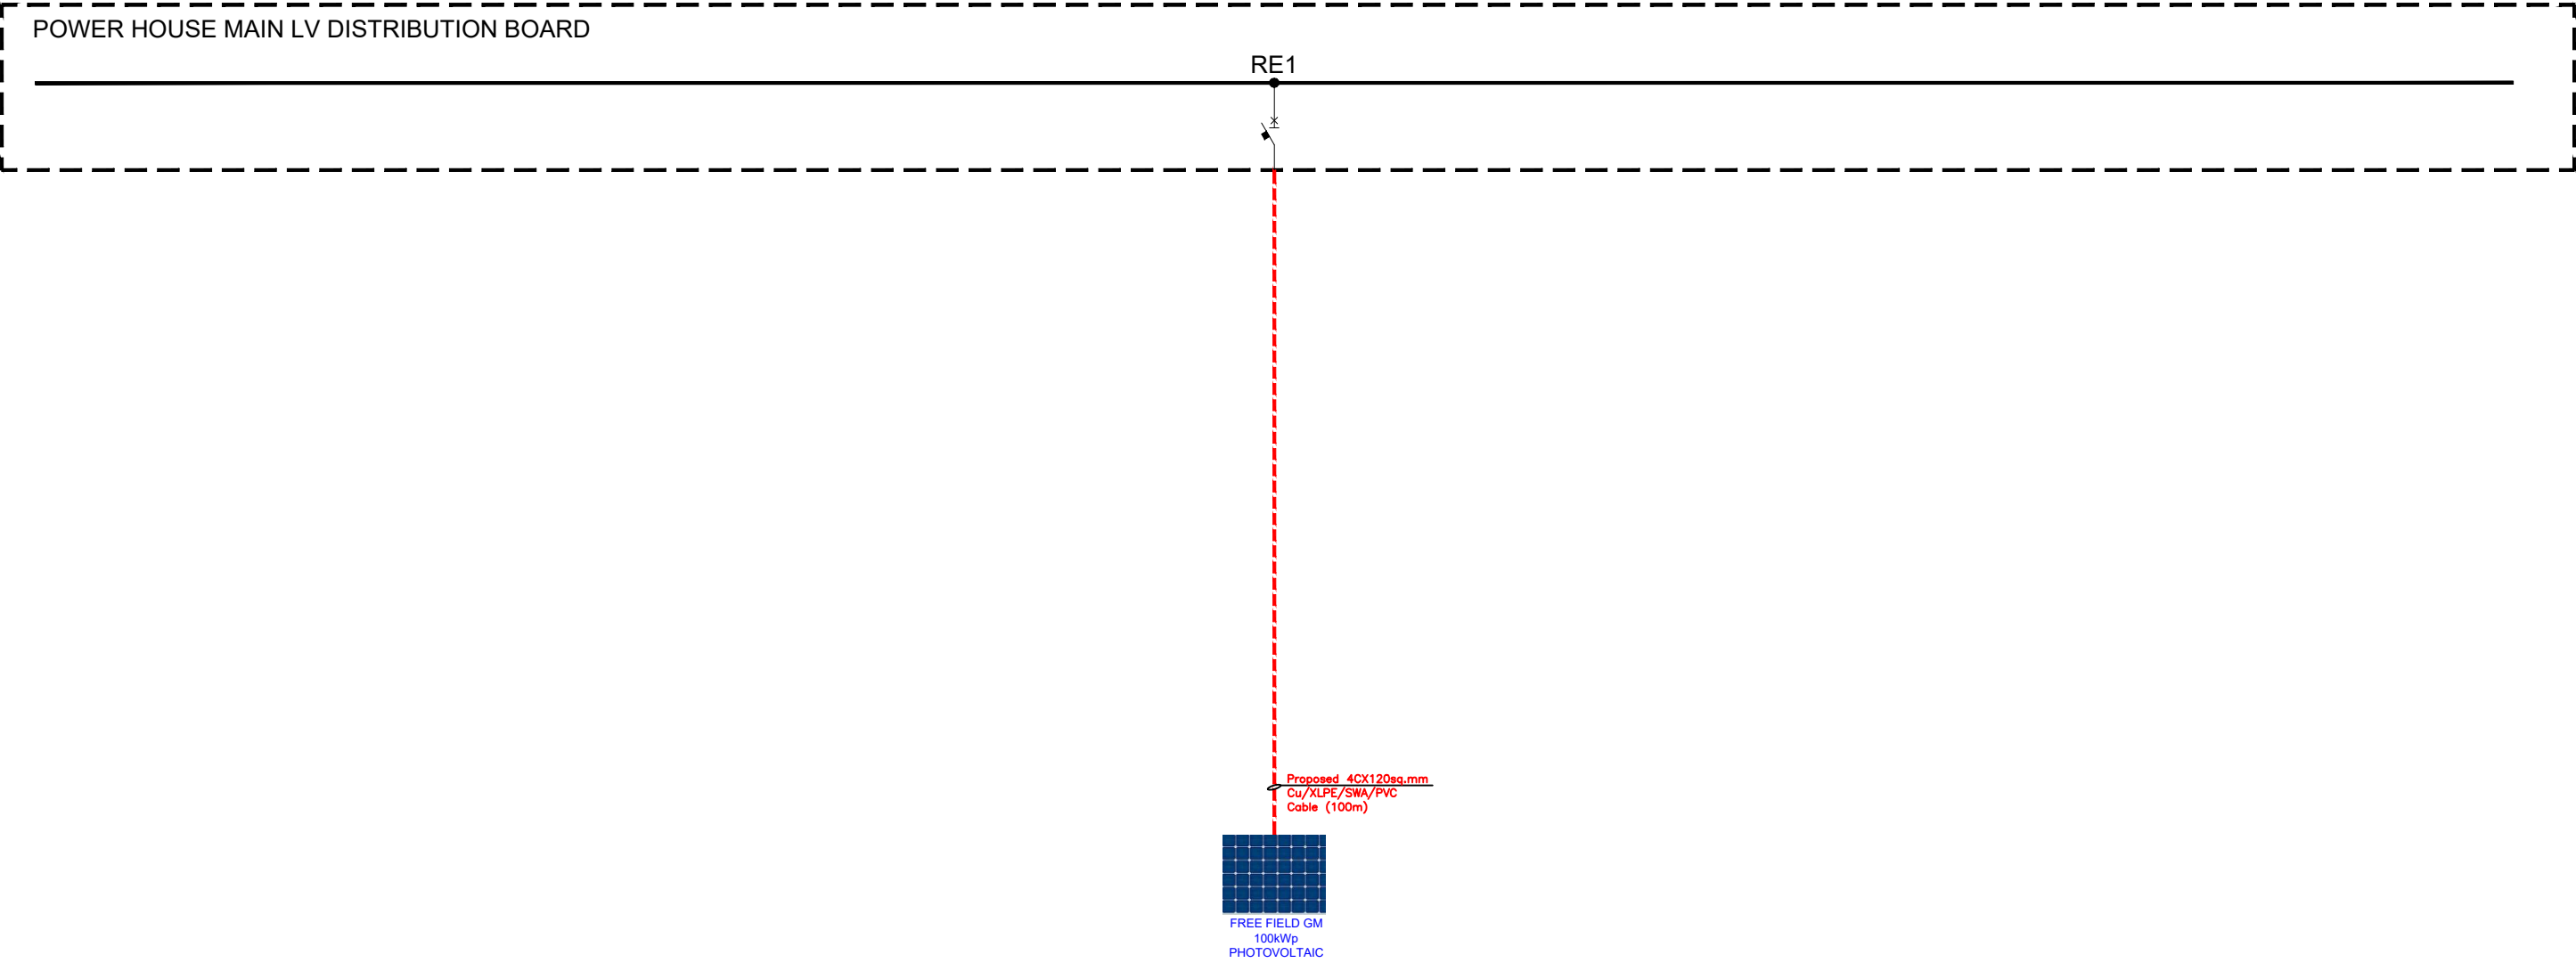

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
<div></div>	EXISTING Cable	-
<div></div>	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	100m
<div></div>	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 1Cx400sq.mm Cu/XLPE/PVC Cable	-
<div></div>	PROPOSED 3Cx70sq.mm 11kV Cable	-
		-
		-
<div>D/B</div>	EXISTING DISTRIBUTION BOX	
<div>D/B</div>	EXISTING DISTRIBUTION BOX TO BE REPLACED	-
<div>D/B</div>	EXISTING DISTRIBUTION BOX TO BE MODIFIED	-

<b>NOTES:-</b>	
1.	THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
2.	CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE GRID MIDIFICATION DIAGRAM FOR Q06–VAADHOO FOR PV INTEGRATION		DESIGN : PMU	SCALE : N.T.S
							DRAWN : MARSOOM	DRW NO. : Q06–POISED–VAADH00–GR
					PROJECT PREPAIRING OUTER ISLANDS SUSTAINABLE DEVELOPMENTS	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : VAADH00
							DATE: : 23MAR24	PAGE : 1