



FIRE SAFETEY LEGENDS	
	DUTY PUMP
	STANDBY PUMP/DUTY PUMP
	ADDRESSABLE FIRE ALARM CONTROL PANEL
	2 WAY BREECHING DRY RISER INLET
	AIR RELEASE VALVE
	SMOKE DETECTOR (FIXED 80 DEG.)
	HEAT DETECTOR
	MANUAL CALL POINT
	DRY RISER LANDING VALVE
	EXIT SIGN
	ELECTRONIC LOOP FIRE ALARM SOUNDER
	2KG CO2 WITH FLUSH MOUNT CABINET
	9 KG DRY CHEMICAL POWDER WITH FLUSH MOUNT CABINET
	9 KG H2O EXTINGUISHER WITH FLUSH MOUNT CABINET
	HOSE REEL WITH VALVE AND CABINET (SLIM TYPE-RECESSED WALL)

NOTES:

ALL MATERIALS AND WORKMANSHIP SHALL BE ACCORDING TO NSS REGULATIONS.
USE FIRE RETARDANT CABLE FOR ALARM SYSTEM WIRING USE 2.5" DIA.
SCHEDULE 40 PIPE FOR DRY RISER SYSTEM (GALVANIZED ON BOTH SIDES).
USE 2" DIA.
SCHEDULE 40 PIPE FOR WET RISER SYSTEM (GALVANIZED ON BOTH SIDES).
LENGTH OF HOSE: 20 METRES.

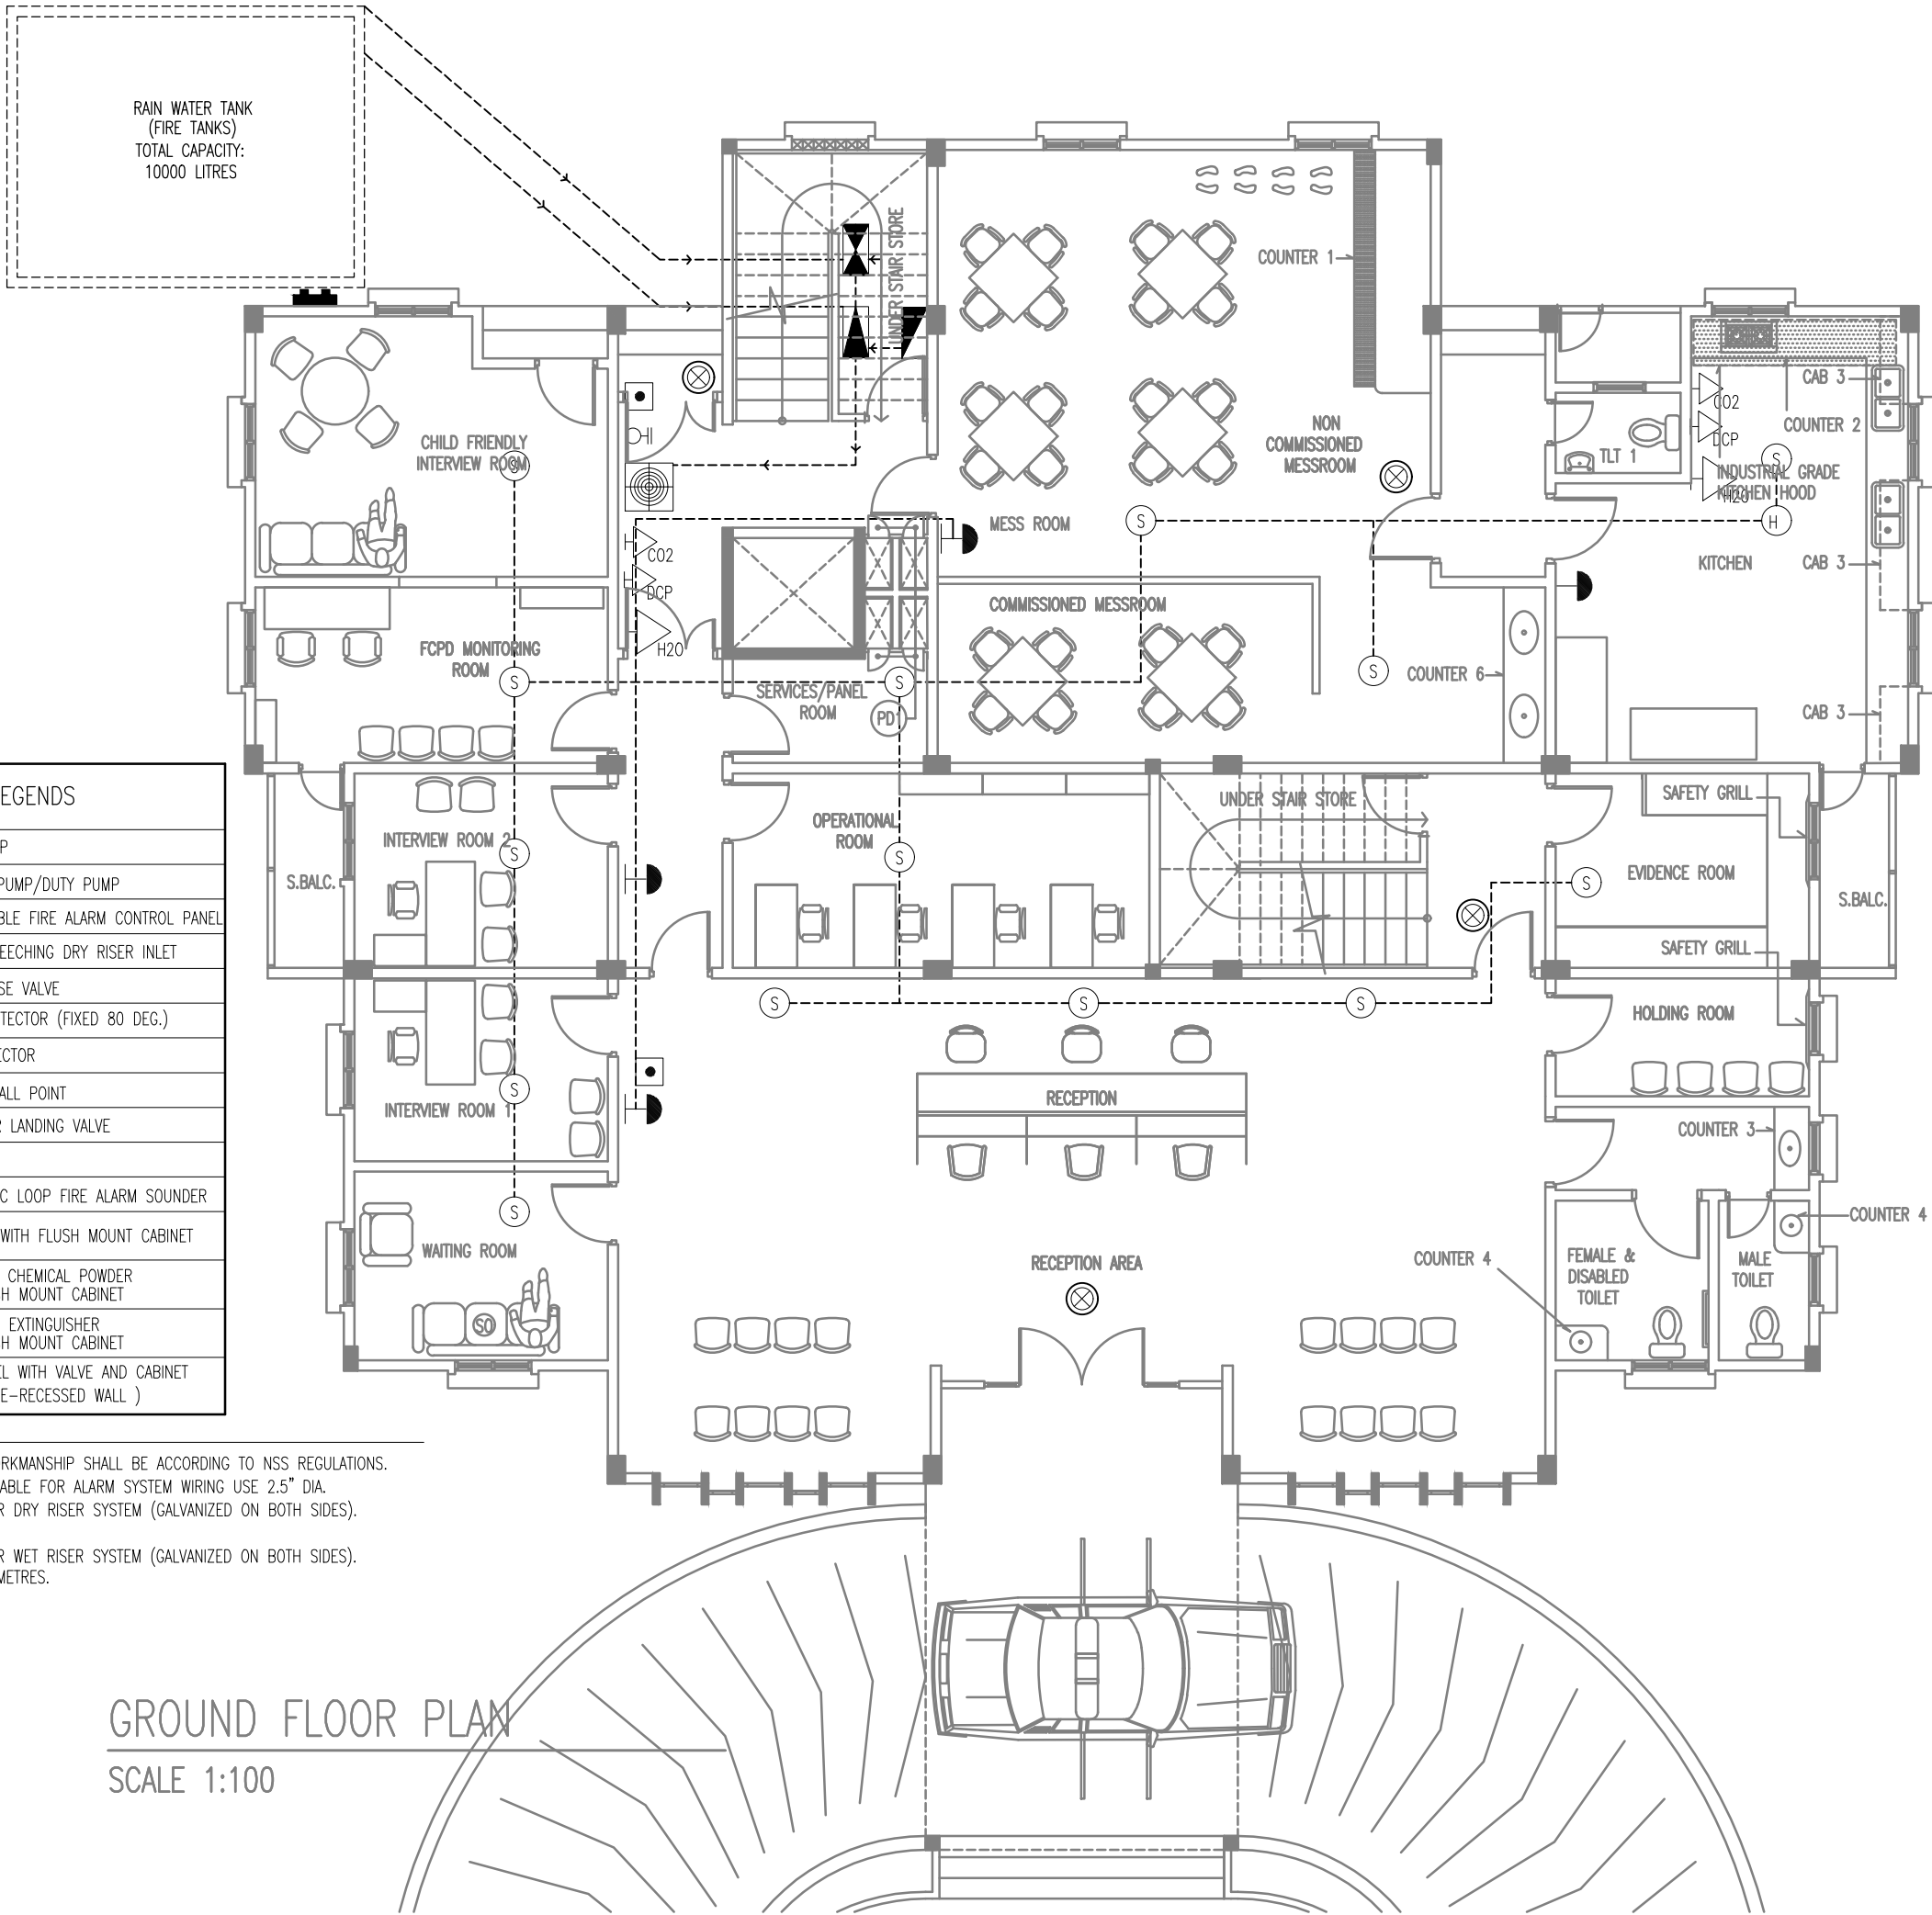

GROUND FLOOR PLAN
SCALE 1:100



INFRASTRUCTURE & BUILDING DEVELOPMENT
MALDIVES POLICE SERVICE

PROJECT TITLE:

ADDUCITY REGIONAL HEADQUARTERS
POLICE STATION

MALDIVES POLICE SERVICE SEAL & SIGN

CONTRACTORS SEAL & SIGN

THE DRAWINGS, CONCEPT AND DESIGN CONTAINED AREA
THE PROPERTIES OF MALDIVES POLICE SERVICE. USE OF
ANY KIND OR COPY OF WHOLE OR PART OF THIS
DRAWING CONCEPT OR DESIGN OR USE ON OTHER
PROJECTS OR SITES OTHER THAN THAT SPECIFIED ON
THIS DRAWINGS IS STRICTLY PROHIBITED

ARCHITECT/DESIGNER	DRAFTED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	SUB INSP OF POLICE MOHAMED FALAHAH

STRUCTURAL ENGINEER	DRAFTED BY
SUB INSP OF POLICE MOHAMED FAZEEN	SUB INSP OF POLICE MOHAMED FALAHAH

CHECKED BY	CHECKED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	INSP OF POLICE AHMED NIZAL

ARCHITECTURAL DRAWINGS

SHEET NO.	DATE: 07-JUNE-2022
-----------	--------------------

E-01

FIRE SAFETEY LEGENDS	
	DUTY PUMP
	STANDBY PUMP/DUTY PUMP
	ADDRESSABLE FIRE ALARM CONTROL PANEL
	2 WAY BREECHING DRY RISER INLET
	AIR RELEASE VALVE
	SMOKE DETECTOR (FIXED 80 DEG.)
	HEAT DETECTOR
	MANUAL CALL POINT
	DRY RISER LANDING VALVE
	EXIT SIGN
	ELECTRONIC LOOP FIRE ALARM SOUNDER
	2KG CO2 WITH FLUSH MOUNT CABINET
	9 KG DRY CHEMICAL POWDER WITH FLUSH MOUNT CABINET
	9 KG H2O EXTINGUISHER WITH FLUSH MOUNT CABINET
	HOSE REEL WITH VALVE AND CABINET (SLIM TYPE-RECESSED WALL)

NOTES:

ALL MATERIALS AND WORKMANSHIP SHALL BE ACCORDING TO NSS REGULATIONS.

USE FIRE RETARDANT CABLE FOR ALARM SYSTEM WIRING USE 2.5" DIA.

SCHEDULE 40 PIPE FOR DRY RISER SYSTEM (GALVANIZED ON BOTH SIDES).


USE 2" DIA.

SCHEDULE 40 PIPE FOR WET RISER SYSTEM (GALVANIZED ON BOTH SIDES).

LENGTH OF HOSE: 20 METRES.

FIRST FLOOR PLAN

SCALE 1:100

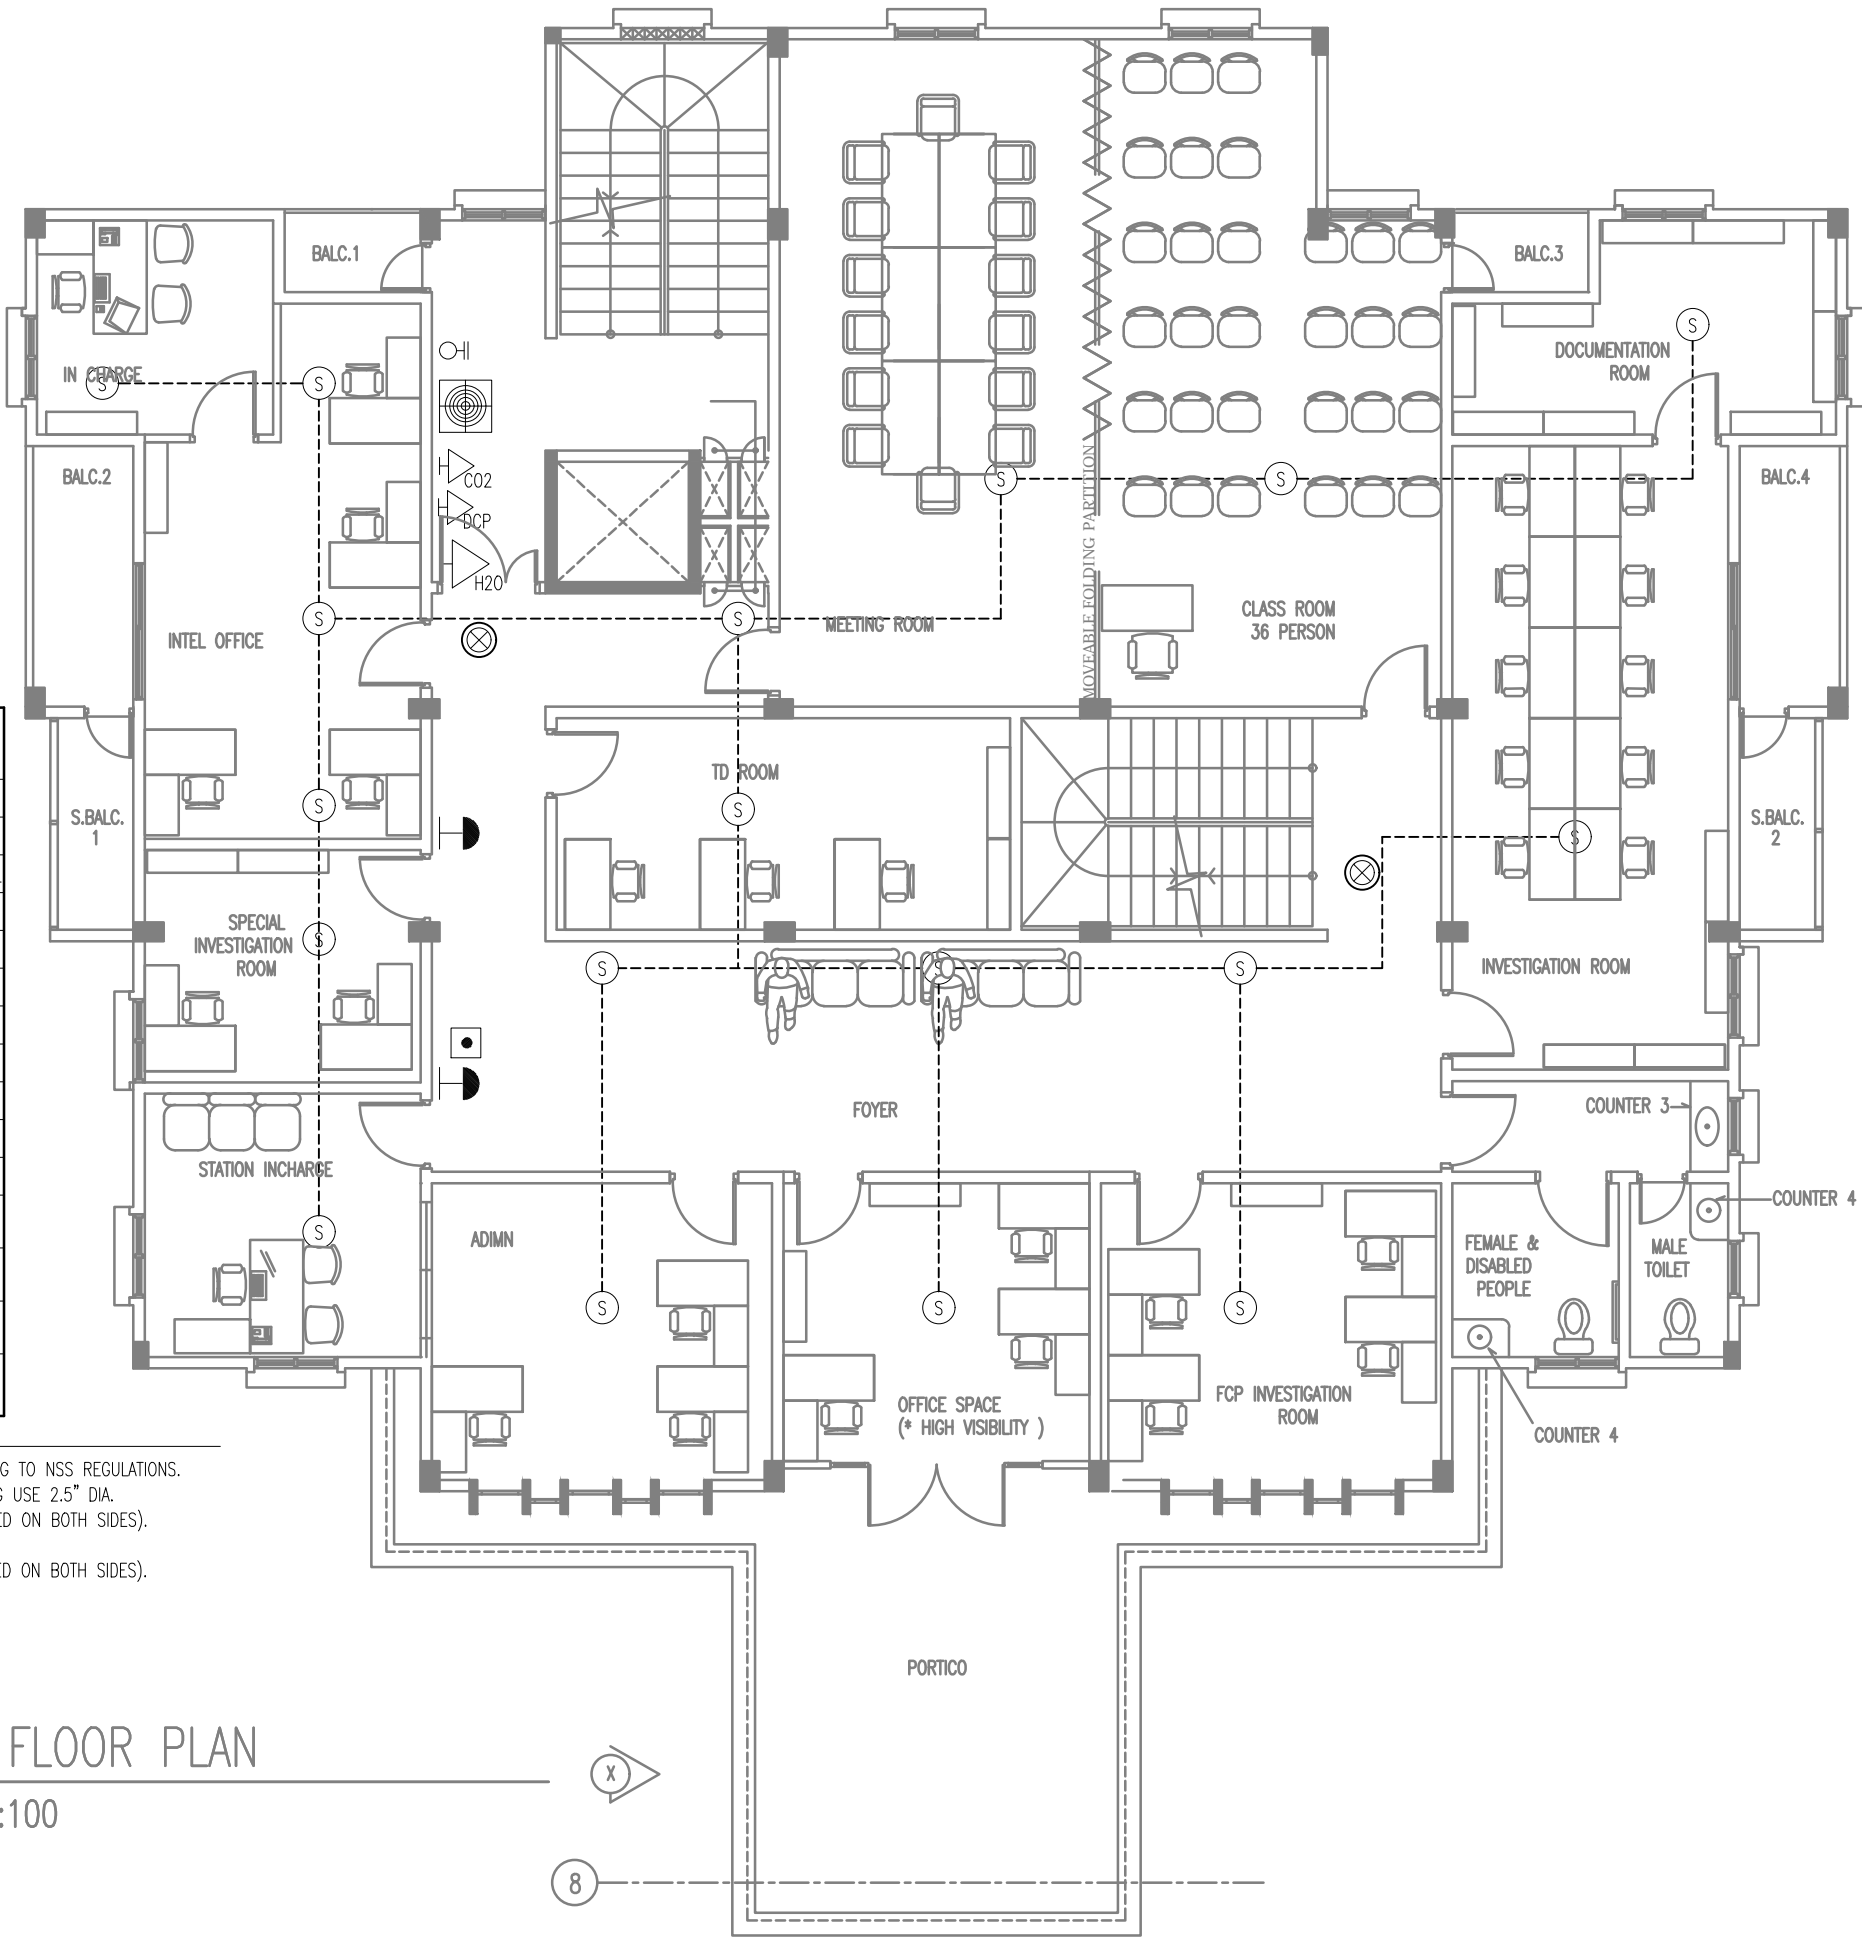



INFRASTRUCTURE & BUILDING DEVELOPMENT
MALDIVES POLICE SERVICE

PROJECT TITLE:

ADDUCITY REGIONAL HEADQUARTERS
POLICE STATION

MALDIVES POLICE SERVICE SEAL & SIGN

CONTRACTORS SEAL & SIGN

THE DRAWINGS, CONCEPT AND DESIGN CONTAINED AREA
THE PROPERTIES OF MALDIVES POLICE SERVICE. USE OF
ANY KIND OR COPY OF WHOLE OR PART OF THIS
DRAWING CONCEPT OR DESIGN OR USE ON OTHER
PROJECTS OR SITES OTHER THAN THAT SPECIFIED ON
THIS DRAWINGS IS STRICTLY PROHIBITED

ARCHITECT/DESIGNER	DRAFTED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	SUB INSP OF POLICE MOHAMED FALAHAH

STRUCTURAL ENGINEER	DRAFTED BY
SUB INSP OF POLICE MOHAMED FAZEEN	SUB INSP OF POLICE MOHAMED FALAHAH

CHECKED BY	CHECKED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	INSP OF POLICE AHMED NIZAL

ARCHITECTURAL DRAWINGS

SHEET NO.	DATE: 07-JUNE-2022
-----------	--------------------

E-02

FIRE SAFETAY LEGENDS	
	DUTY PUMP
	STANDBY PUMP/DUTY PUMP
	ADDRESSABLE FIRE ALARM CONTROL PANEL
	2 WAY BREECHING DRY RISER INLET
	AIR RELEASE VALVE
	SMOKE DETECTOR (FIXED 80 DEG.)
	HEAT DETECTOR
	MANUAL CALL POINT
	DRY RISER LANDING VALVE
	EXIT SIGN
	ELECTRONIC LOOP FIRE ALARM SOUNDER
	2KG CO2 WITH FLUSH MOUNT CABINET
	9 KG DRY CHEMICAL POWDER WITH FLUSH MOUNT CABINET
	9 KG H2O EXTINGUISHER WITH FLUSH MOUNT CABINET
	HOSE REEL WITH VALVE AND CABINET (SLIM TYPE-RECESSED WALL)

NOTES:

ALL MATERIALS AND WORKMANSHIP SHALL BE ACCORDING TO NSS REGULATIONS.


USE FIRE RETARDANT CABLE FOR ALARM SYSTEM WIRING USE 2.5" DIA.

SCHEDULE 40 PIPE FOR DRY RISER SYSTEM (GALVANIZED ON BOTH SIDES).

USE 2" DIA.

SCHEDULE 40 PIPE FOR WET RISER SYSTEM (GALVANIZED ON BOTH SIDES).

LENGTH OF HOSE: 20 METRES.

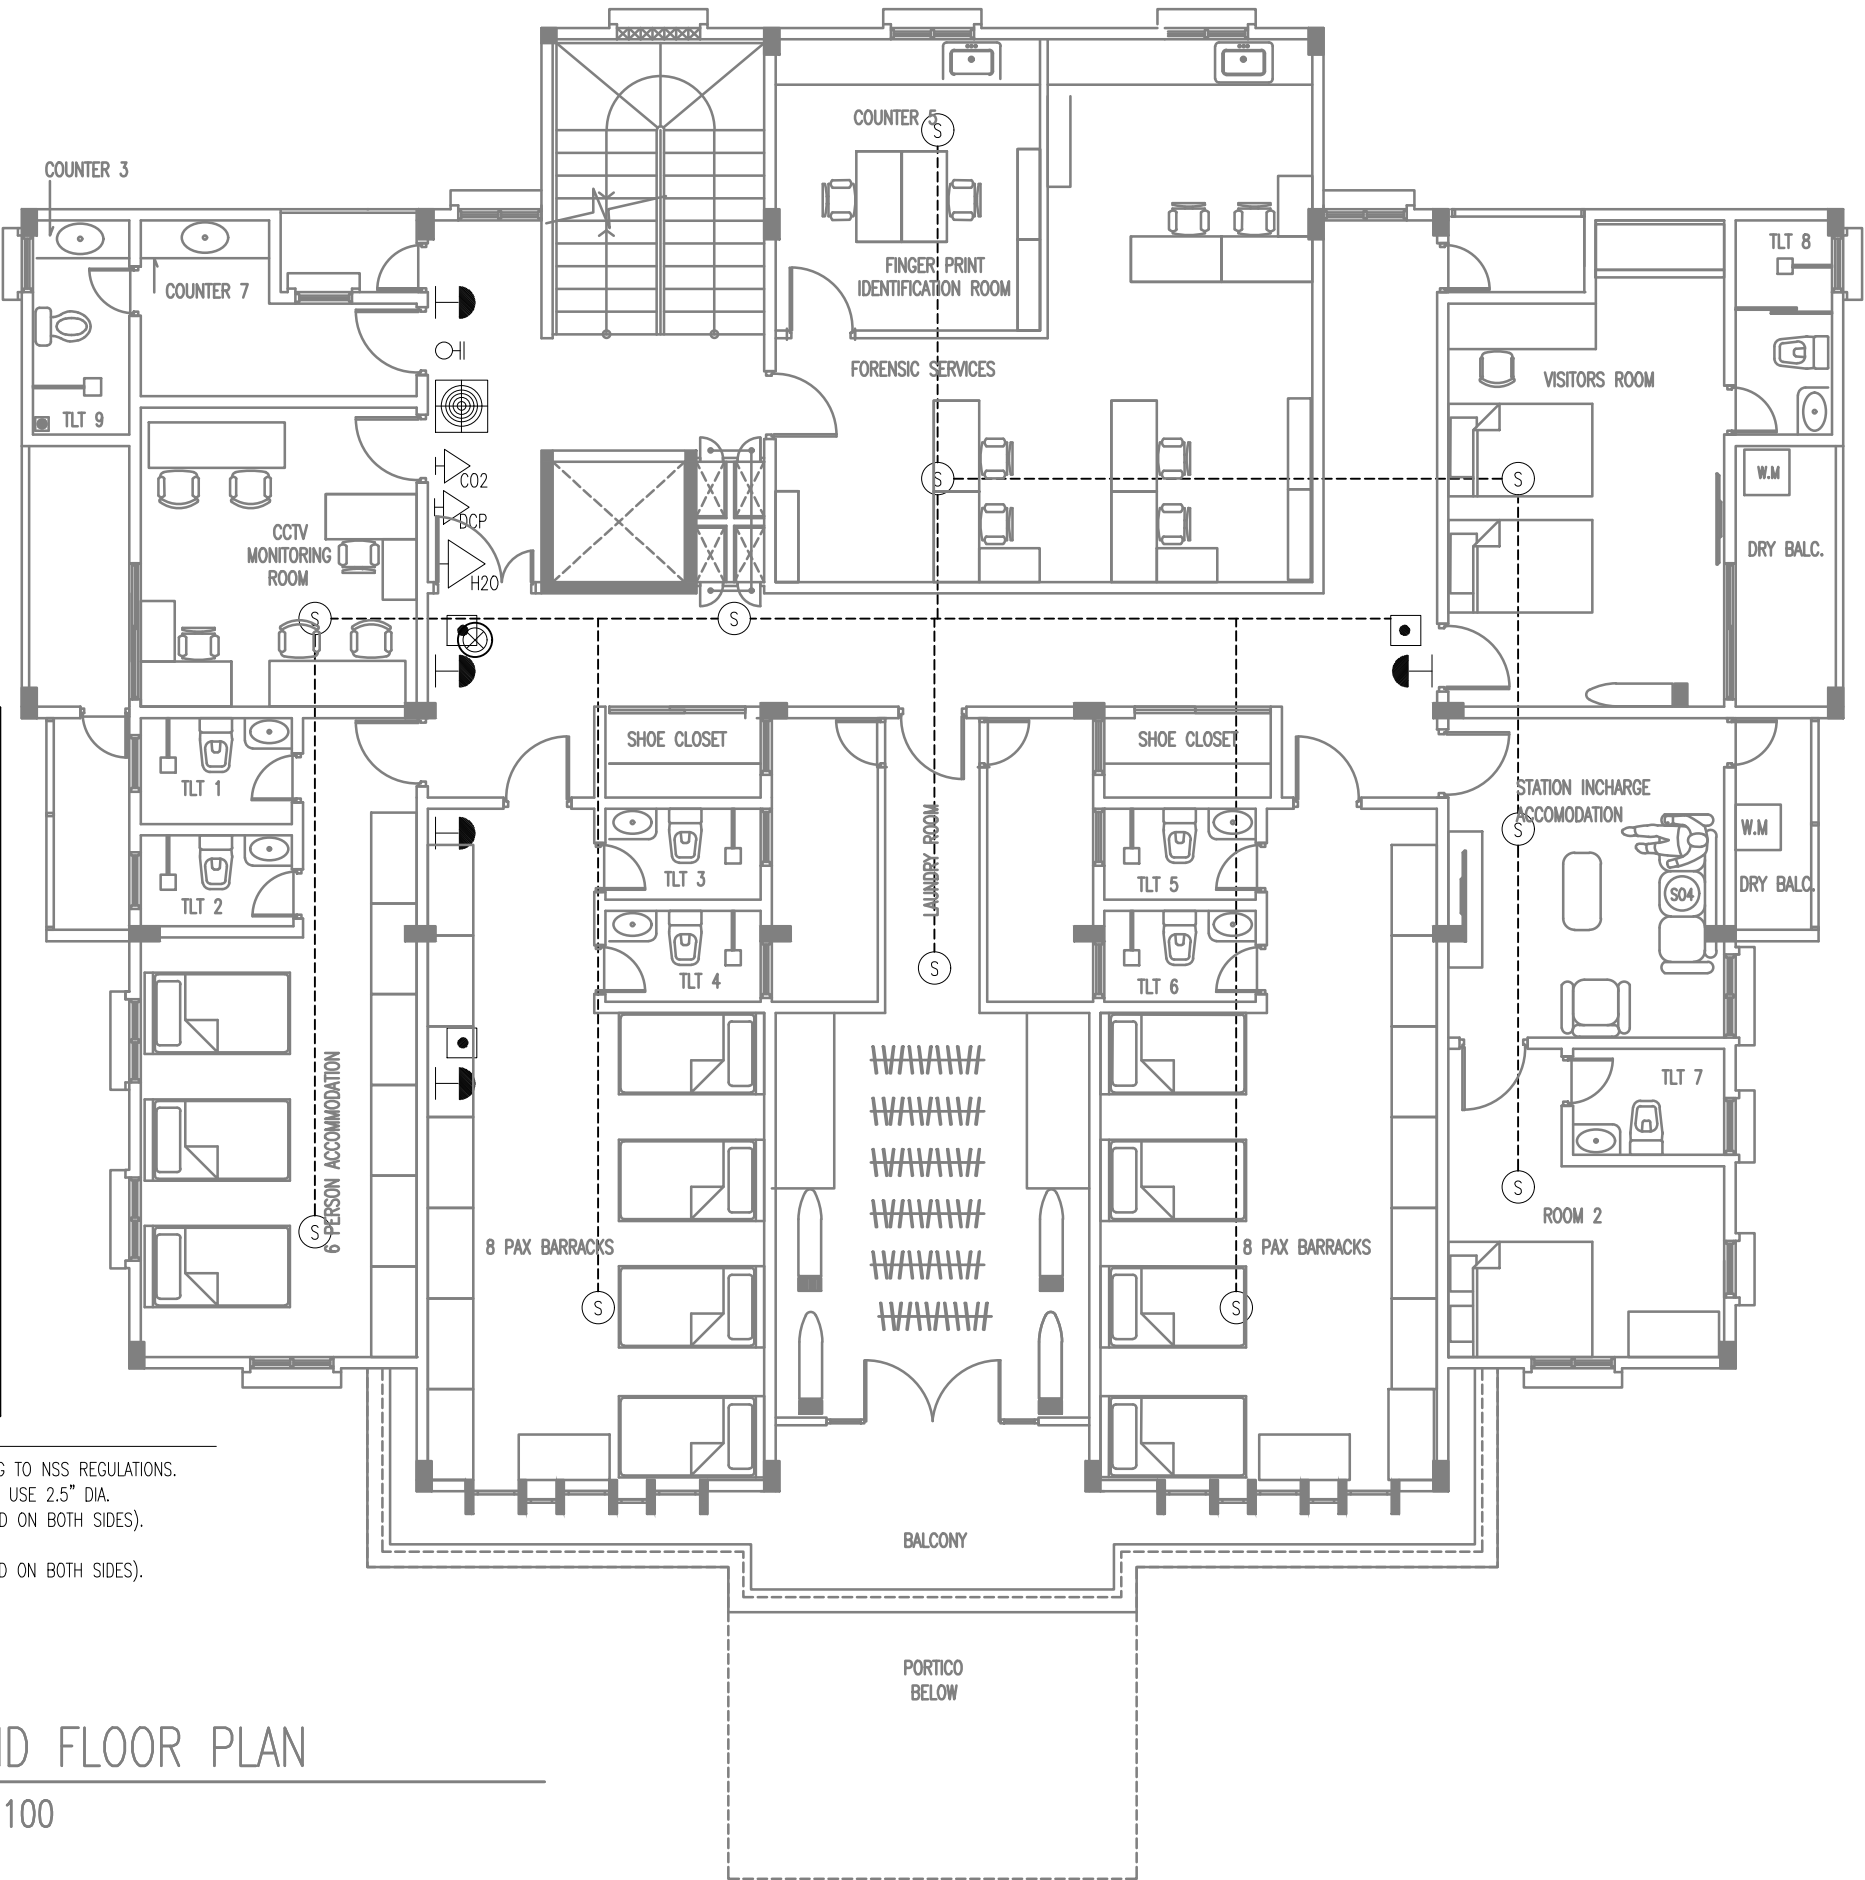

SECOND FLOOR PLAN

SCALE 1:100

INFRASTRUCTURE & BUILDING DEVELOPMENT MALDIVES POLICE SERVICE	
PROJECT TITLE:	
ADDUCITY REGIONAL HEADQUARTERS POLICE STATION	
MALDIVES POLICE SERVICE SEAL & SIGN	
CONTRACTORS SEAL & SIGN	
THE DRAWINGS, CONCEPT AND DESIGN CONTAINED AREA THE PROPERTIES OF MALDIVES POLICE SERVICE. USE OF ANY KIND OR COPY OF WHOLE OR PART OF THIS DRAWING CONCEPT OR DESIGN OR USE ON OTHER PROJECTS OR SITES OTHER THAN THAT SPECIFIED ON THIS DRAWINGS IS STRICTLY PROHIBITED	
ARCHITECT/DESIGNER	DRAFTED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	SUB INSP OF POLICE MOHAMED FALAAH
STRUCTURAL ENGINEER	DRAFTED BY
SUB INSP OF POLICE MOHAMED FAZEEN	SUB INSP OF POLICE MOHAMED FALAAH
CHECKED BY	CHECKED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	INSP OF POLICE AHMED NIZAL
ARCHITECTURAL DRAWINGS	
SHEET NO.	DATE: 07-JUNE-2022
E-03	

FIRE SAFETEY LEGENDS	
	DUTY PUMP
	STANDBY PUMP/DUTY PUMP
	ADDRESSABLE FIRE ALARM CONTROL PANEL
	2 WAY BREECHING DRY RISER INLET
	AIR RELEASE VALVE
	SMOKE DETECTOR (FIXED 80 DEG.)
	HEAT DETECTOR
	MANUAL CALL POINT
	DRY RISER LANDING VALVE
	EXIT SIGN
	ELECTRONIC LOOP FIRE ALARM SOUNDER
	2KG CO2 WITH FLUSH MOUNT CABINET
	9 KG DRY CHEMICAL POWDER WITH FLUSH MOUNT CABINET
	9 KG H2O EXTINGUISHER WITH FLUSH MOUNT CABINET
	HOSE REEL WITH VALVE AND CABINET (SLIM TYPE-RECESSED WALL)

NOTES:

ALL MATERIALS AND WORKMANSHIP SHALL BE ACCORDING TO NSS REGULATIONS.


USE FIRE RETARDANT CABLE FOR ALARM SYSTEM WIRING USE 2.5" DIA.

SCHEDULE 40 PIPE FOR DRY RISER SYSTEM (GALVANIZED ON BOTH SIDES).

USE 2" DIA.

SCHEDULE 40 PIPE FOR WET RISER SYSTEM (GALVANIZED ON BOTH SIDES).

LENGTH OF HOSE: 20 METRES.

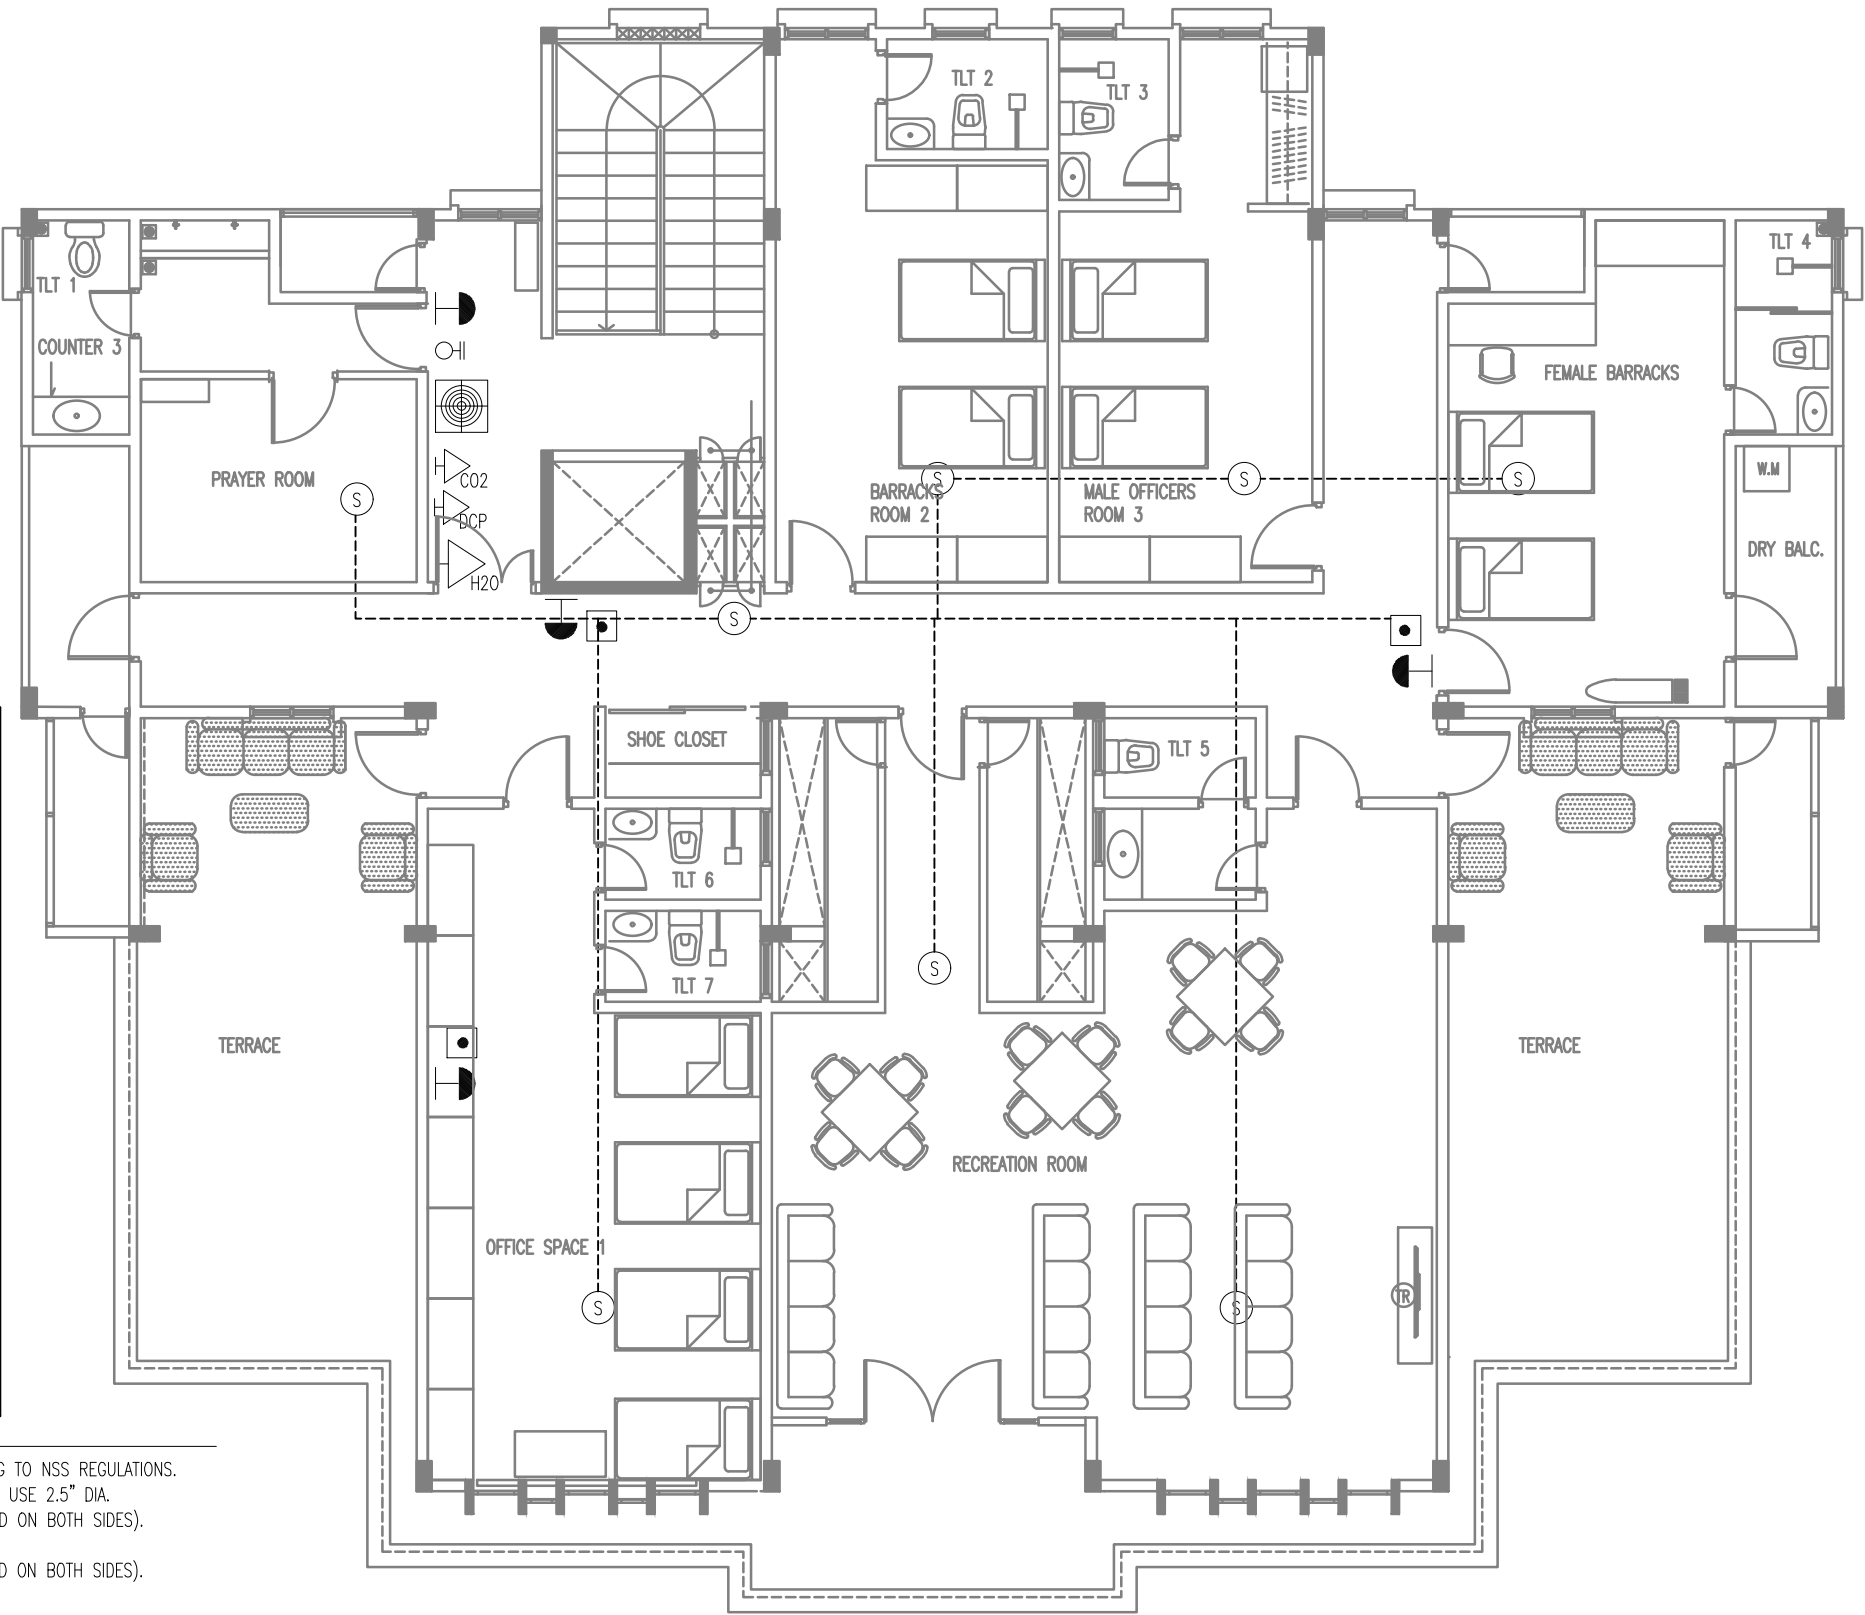

THIRD FLOOR PLAN

SCALE 1:100



INFRASTRUCTURE & BUILDING DEVELOPMENT MALDIVES POLICE SERVICE	
PROJECT TITLE:	
ADDUCITY REGIONAL HEADQUARTERS POLICE STATION	
MALDIVES POLICE SERVICE SEAL & SIGN	
CONTRACTORS SEAL & SIGN	
THE DRAWINGS, CONCEPT AND DESIGN CONTAINED AREA THE PROPERTIES OF MALDIVES POLICE SERVICE. USE OF ANY KIND OR COPY OF WHOLE OR PART OF THIS DRAWING CONCEPT OR DESIGN OR USE ON OTHER PROJECTS OR SITES OTHER THAN THAT SPECIFIED ON THIS DRAWINGS IS STRICTLY PROHIBITED	
ARCHITECT/DESIGNER	DRAFTED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	SUB INSP OF POLICE MOHAMED FALAAH
STRUCTURAL ENGINEER	DRAFTED BY
SUB INSP OF POLICE MOHAMED FAZEEN	SUB INSP OF POLICE MOHAMED FALAAH
CHECKED BY	CHECKED BY
ADMINISTRATIVE DIRECTOR AHMED SADHEEM	INSP OF POLICE AHMED NIZAL
ARCHITECTURAL DRAWINGS	
SHEET NO.	DATE: 07-JUNE-2022
E-04	

