


VISUAL SOIL INSPECTION REPORT FOR WAREHOUSE , K.MANIYAFUSHI

A pit of depth 1.8m was used for the visual soil inspection.

Following diagram represents the soil profile.

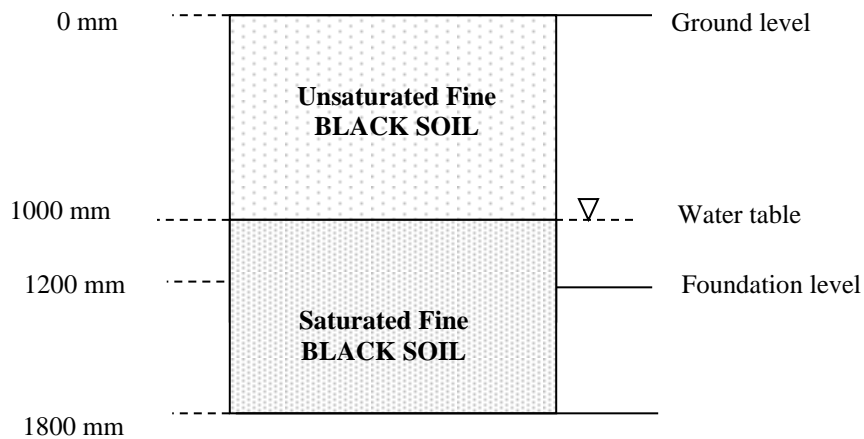

Foundation to be laid at 1.2 m below the natural ground level. Dewatering will be required during foundation construction.

Adam Saaneez
M.Eng. (Hons)
Civil and Structural Engineer