



# **Centre of Excellence for Food Processing and Fisheries – Accomodation Block Ha. Dhidhdhoo**

**ARCHITECTURAL & STRUCTURAL DRAWINGS**

Ministry of Higher Education

Sheet Index					
Layout ID	Layout Name	Revision	Issued	Published	Remark
	Cover		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
	Sheet Index		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.1.01	Ground Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.1.02	First Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.1.03	Terrace Floor Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.1.04	Roof Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.2.01	Section 1		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.3.01	Elevation 1		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.3.02	Elevation 2		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.4.01	All Opening Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.4.02	All Opening Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.4.03	All Opening Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
A.4.04	Ventilation Schedule		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.1.1	Structural Notes 01		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.1.2	Structural Notes 02		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.1.3	Structural Notes 03		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.2.01	Column Layout		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.2.02	Foundation Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.3.01	First to Third Floor Beam Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.4.1	First to Third Floor Slab Reinforcemen...		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
B.4.2	Roof Beam and Slab Plan		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.1.1	Structural Details 01		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.1.2	Structural Detail 02		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.2.1	Staircase Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.2.2	Balcony Details		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.2.3	Typical Wall Constrction Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	
C.2.4	Typical Window Construction Detail		<input type="checkbox"/>	<input checked="" type="checkbox"/>	

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accomodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Building Information List

Plot Area : 30000sqft  
Footprint Area : 5633.62sqft  
Built-up Area : 16900.85sqft

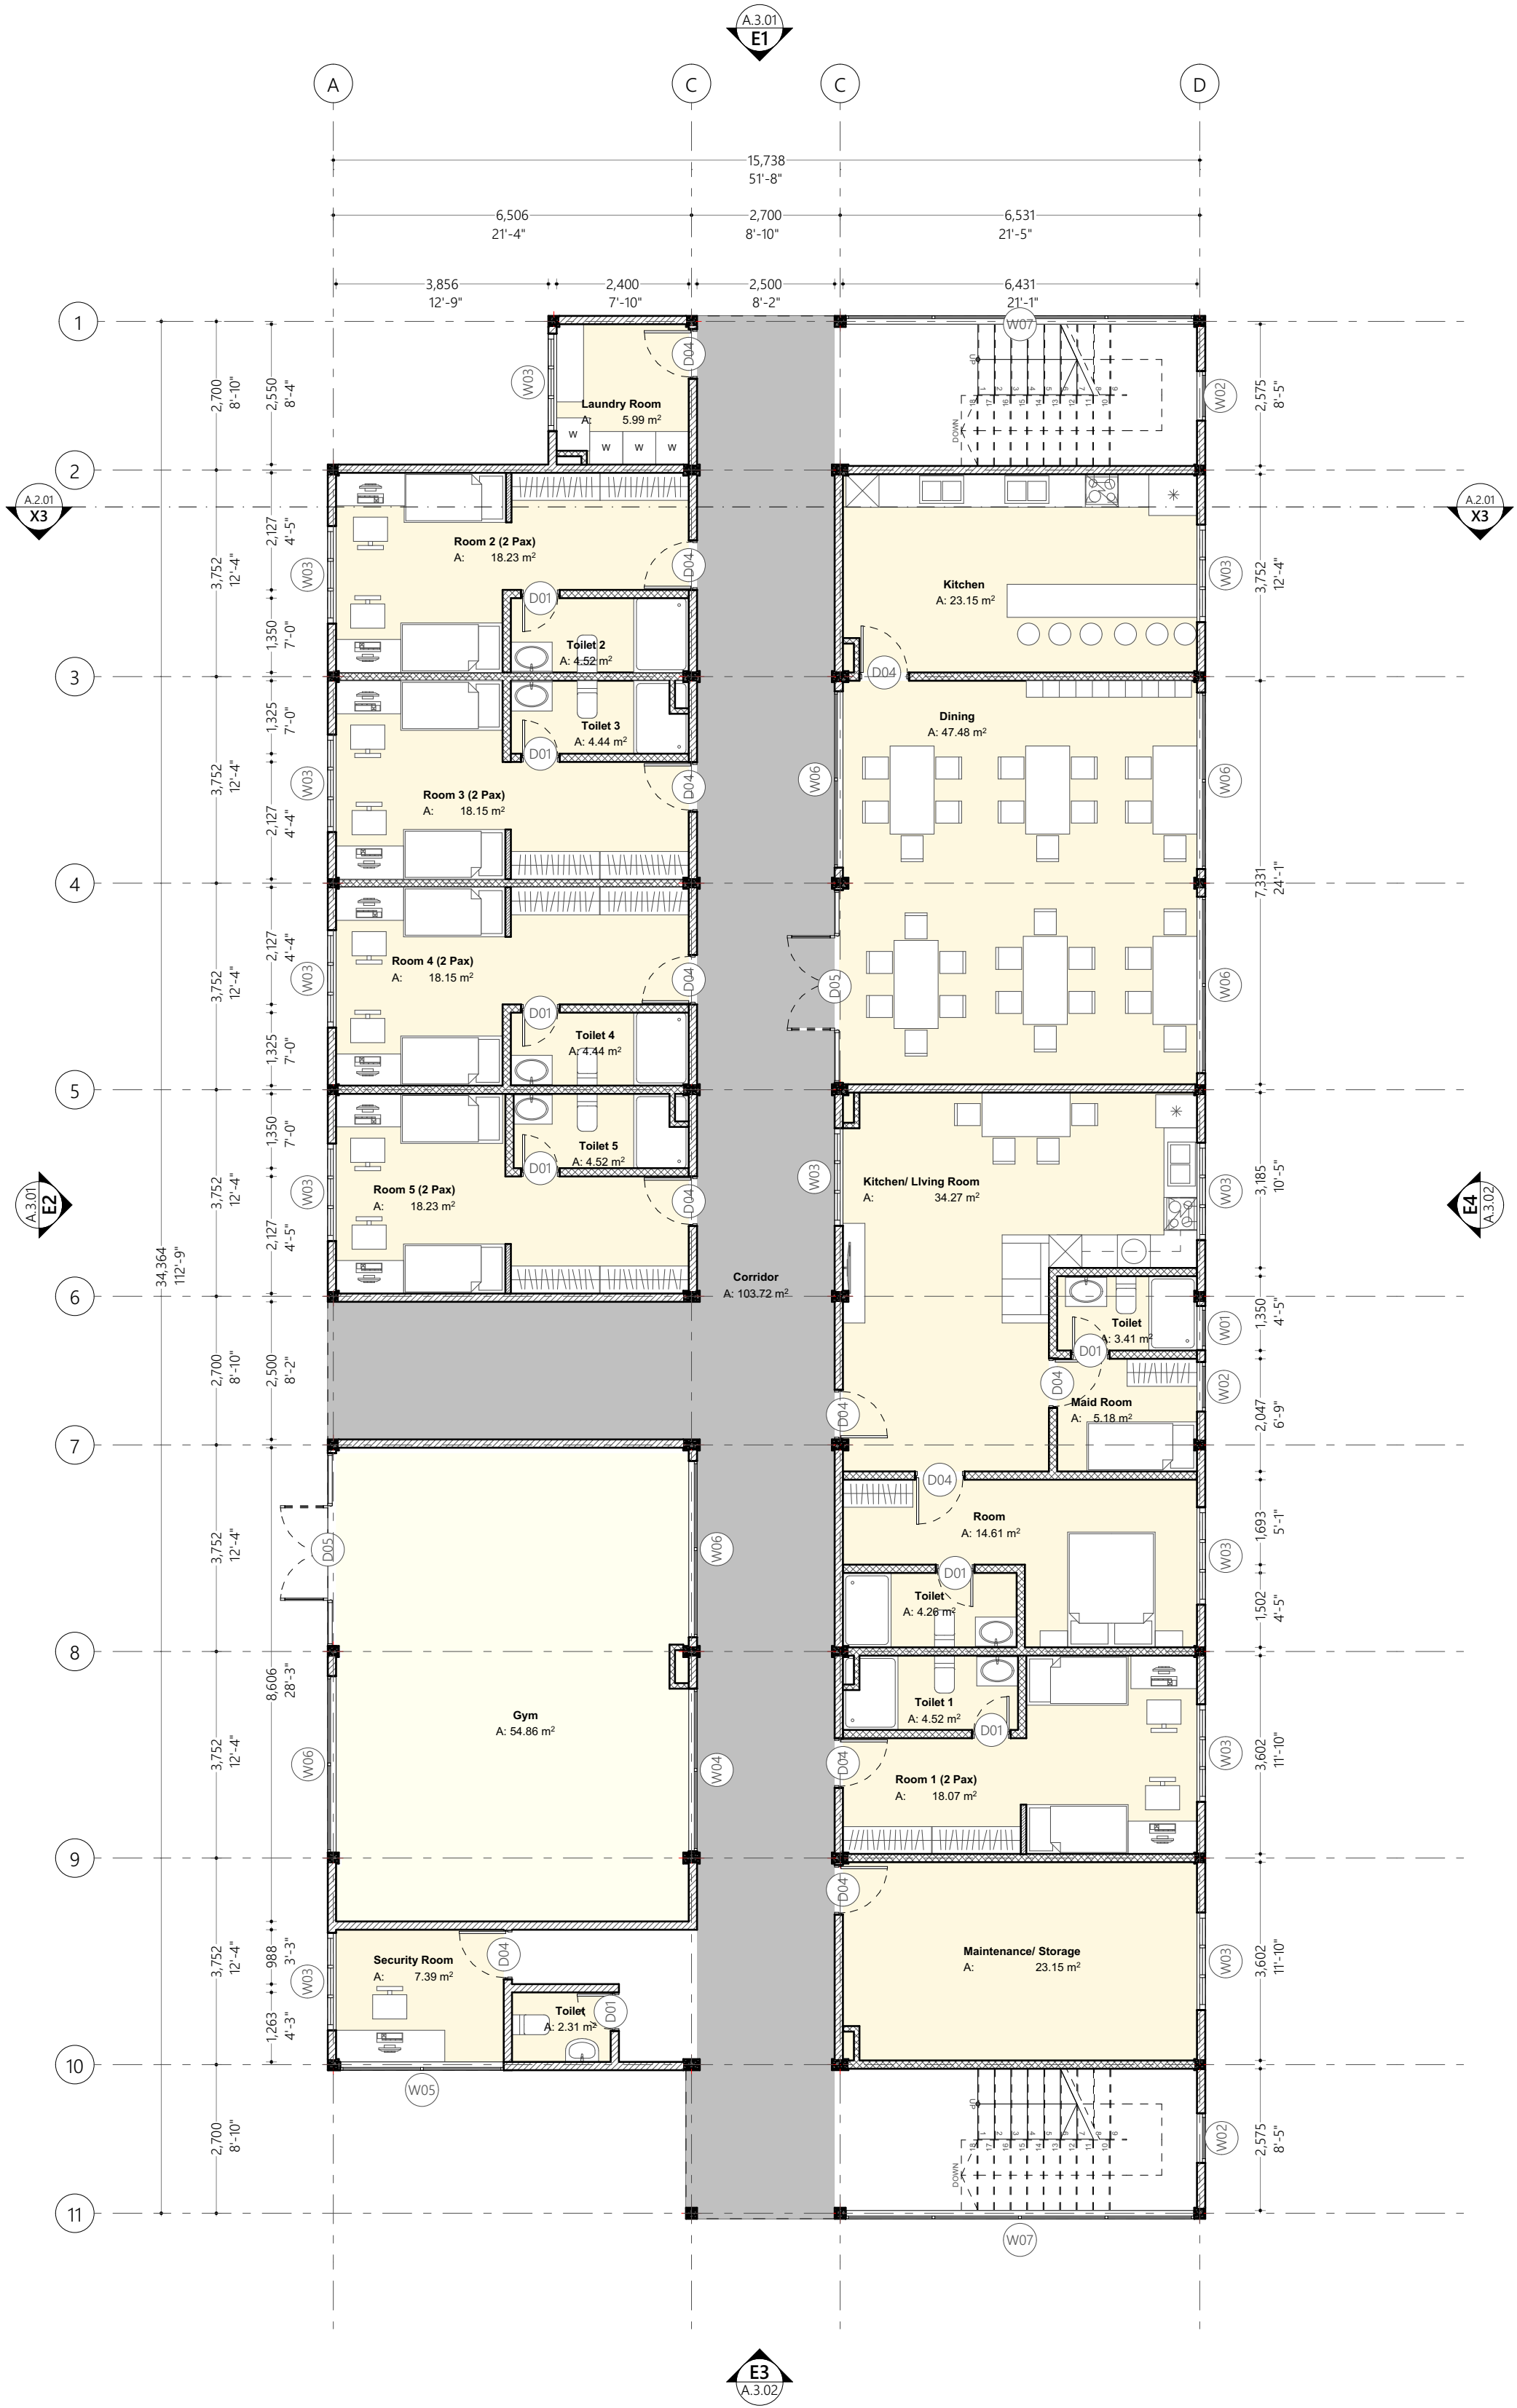

Ground Floor Plan  
1:100

Wall Legend	
2D Plan View	Description
	100mm Reinforced concrete wall
	100mm thick dry walls with smoothed putty and semi gloss white paint
	150mm thick interior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint

Proposed  
Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo


Client  
Ministry of Higher Education  
8/2/2023  
Architect  
Engineer  
Drawn By  
Fathmath Ithudha Amir  
Muawiyath Abdul Sattar  
Aishath Shadhy Afzal



P (+960) 33 33 526 E info@epochassociates  
W epochassociates A 3/B3/3rd Floor,  
Hunnuheema Magu, Male', Maldives

Rev: Page:

Wall Legend	
2D Plan View	Description
	100mm Reinforced concrete wall
	100mm thick dry walls with smoothed putty and semi gloss white paint
	150mm thick interior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint

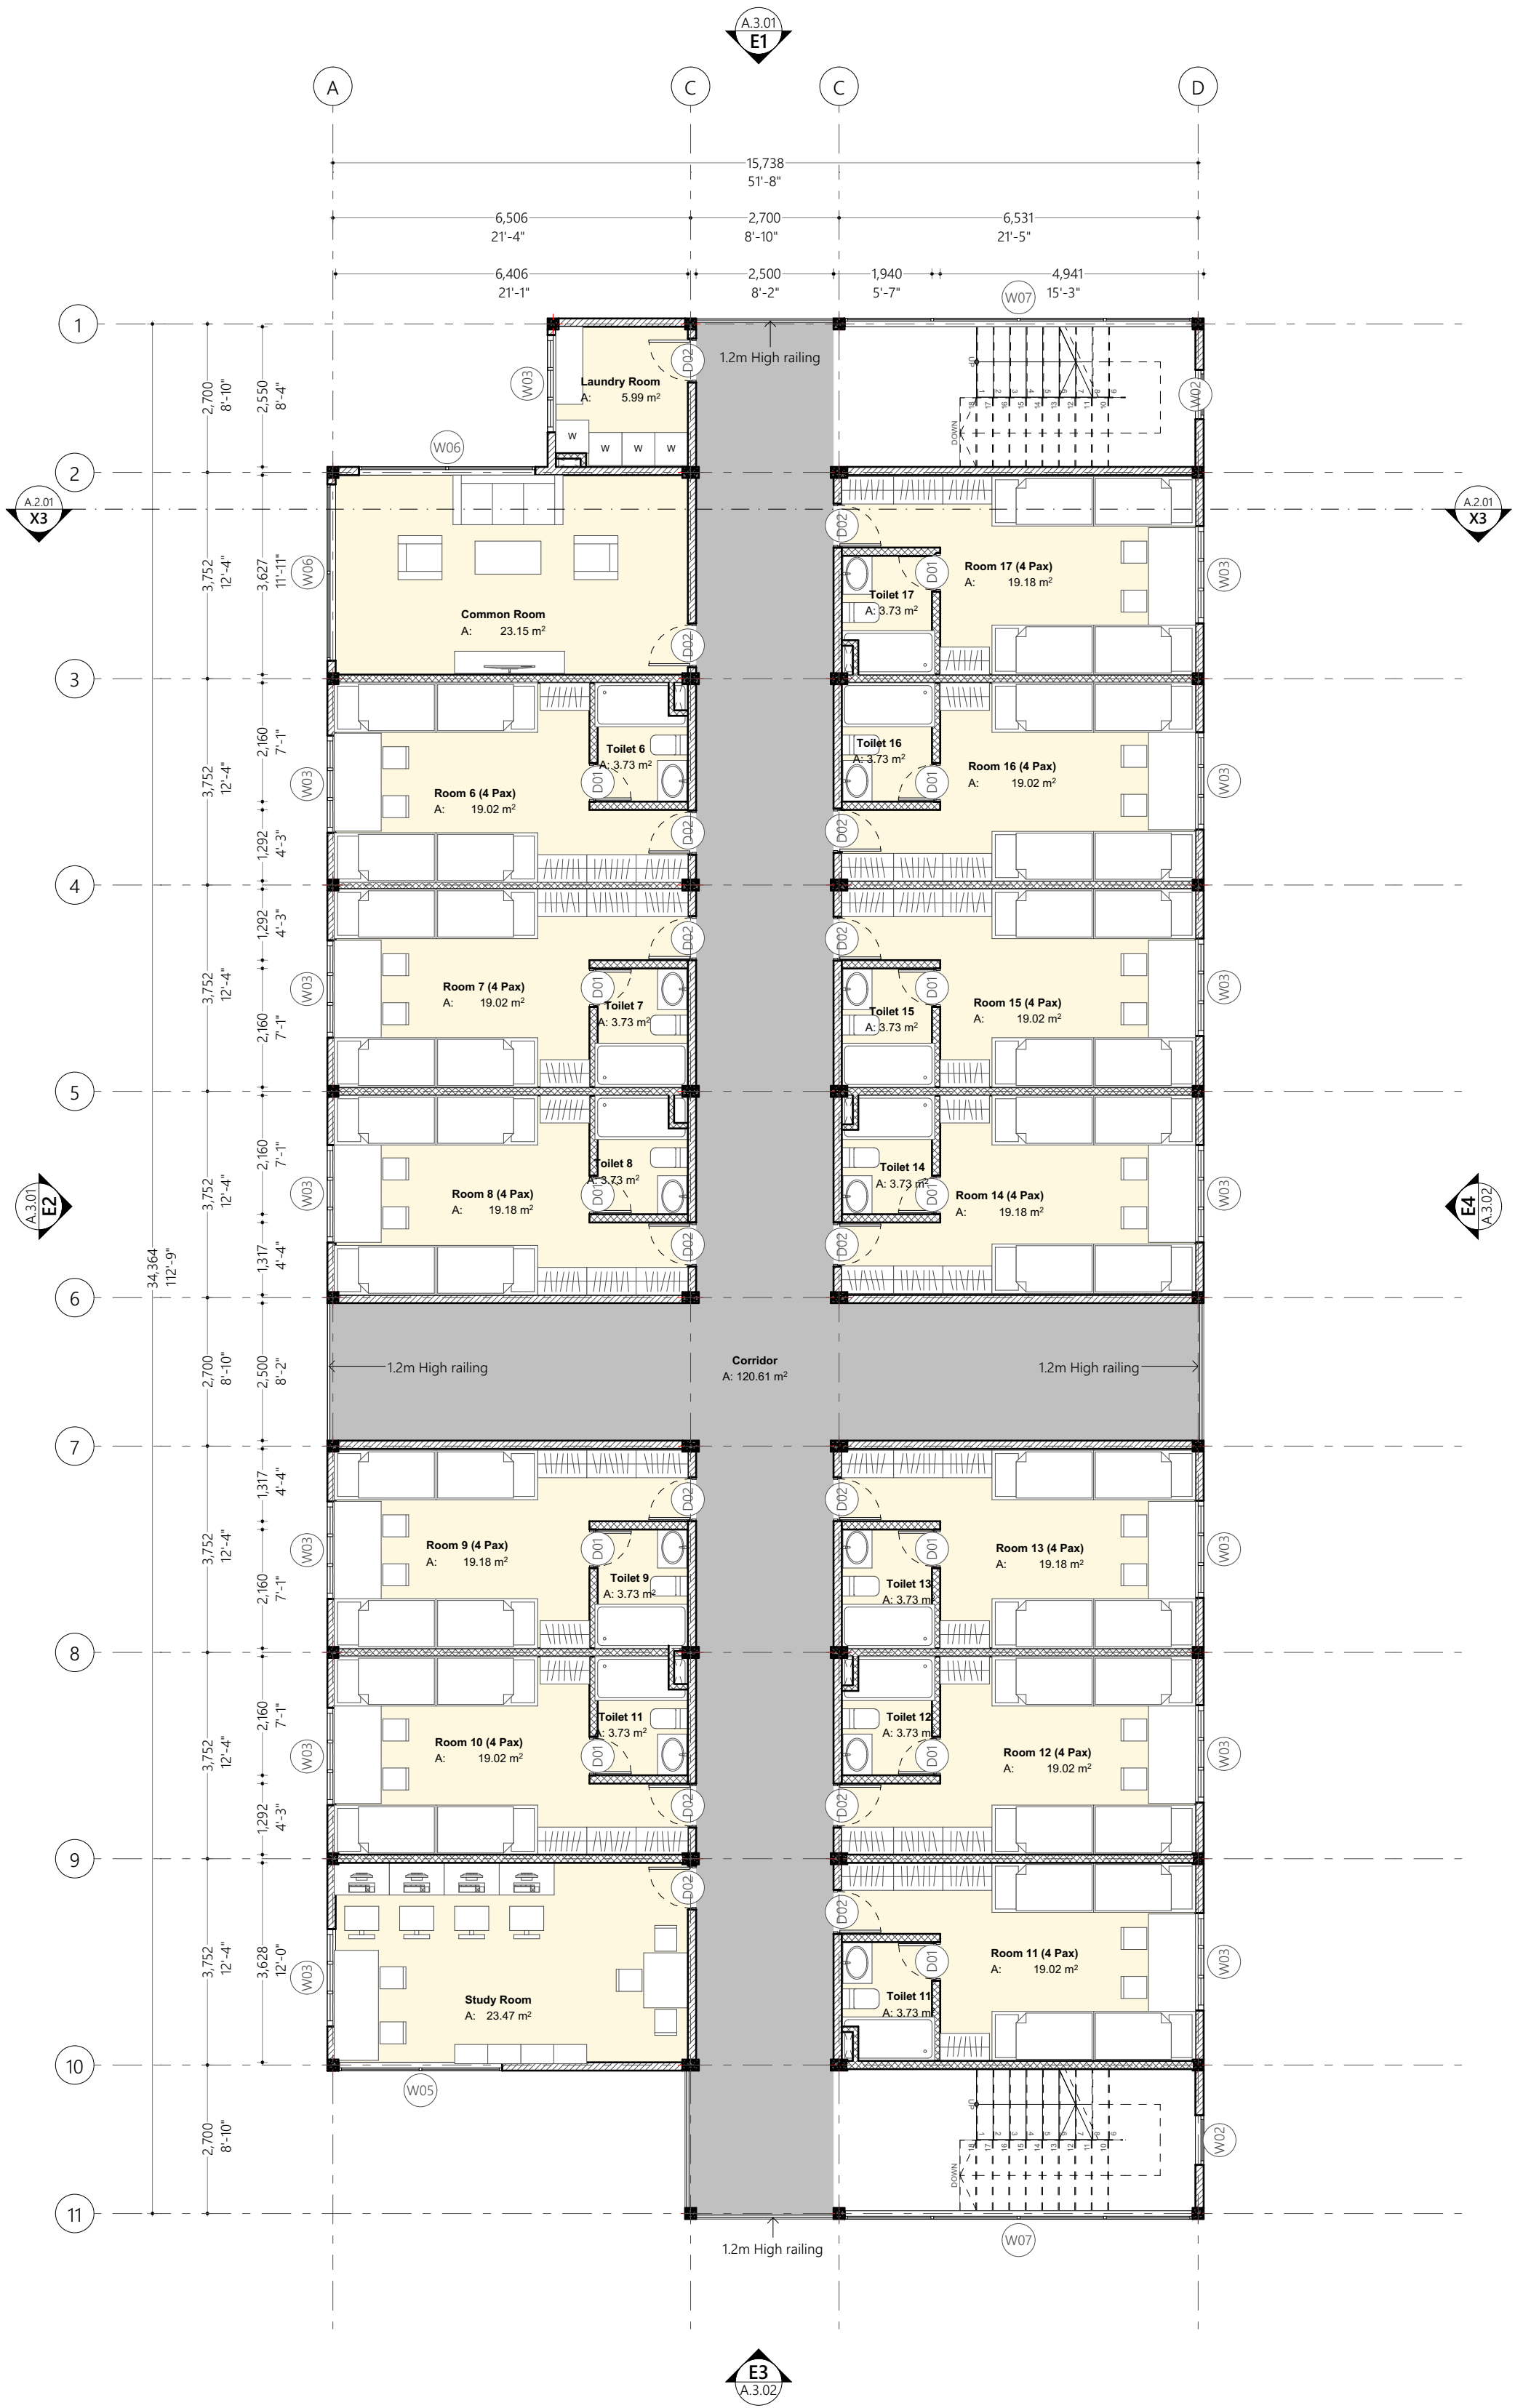

First Floor Plan  
1:100

Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**  
8/2/2023  
Architect **Fathmath Ithudha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epochassociates.com  
W epochassociates.com A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

Rev: Page:  
**A.1.02**

Wall Legend	
2D Plan View	Description
	100mm Reinforced concrete wall
	100mm thick dry walls with smoothed putty and semi gloss white paint
	150mm thick interior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick solid masonry block exterior wall with 25mm plaster on exterior and 16mm plaster on interior finished with smoothed putty and semi gloss white paint

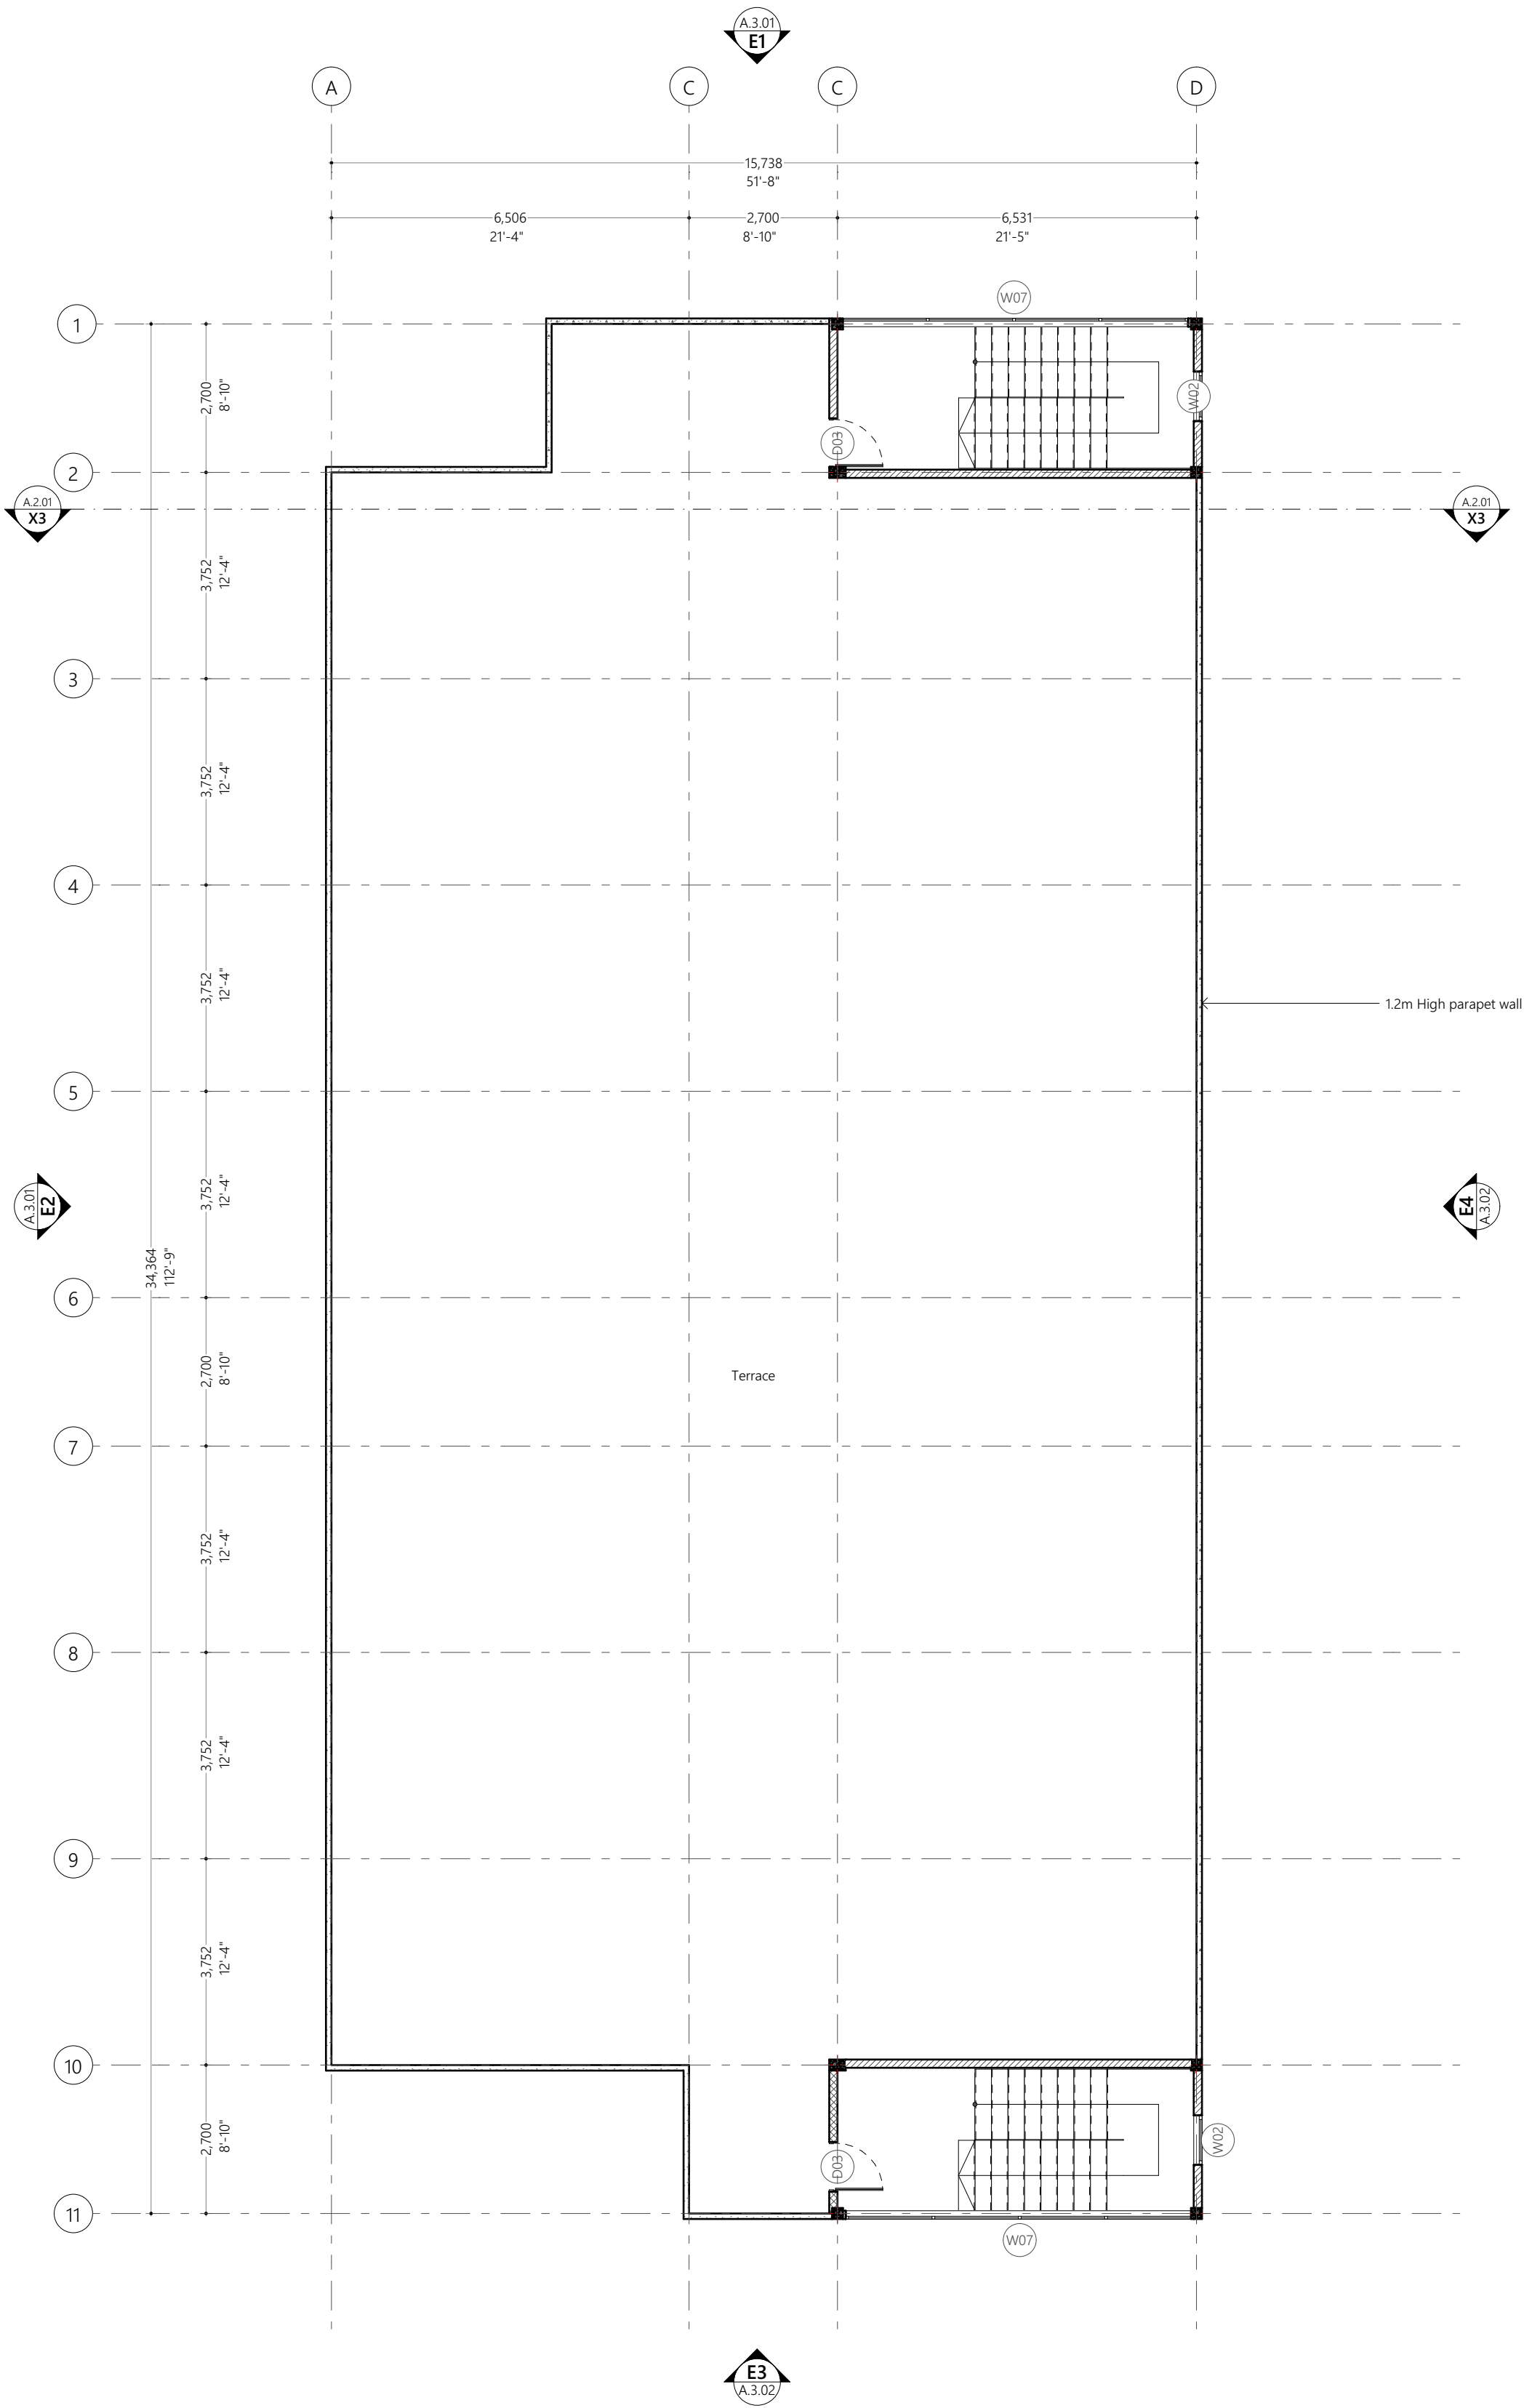


Terrace Plan  
1:100

Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/2/2023  
Architect **Fathmath Ihudha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

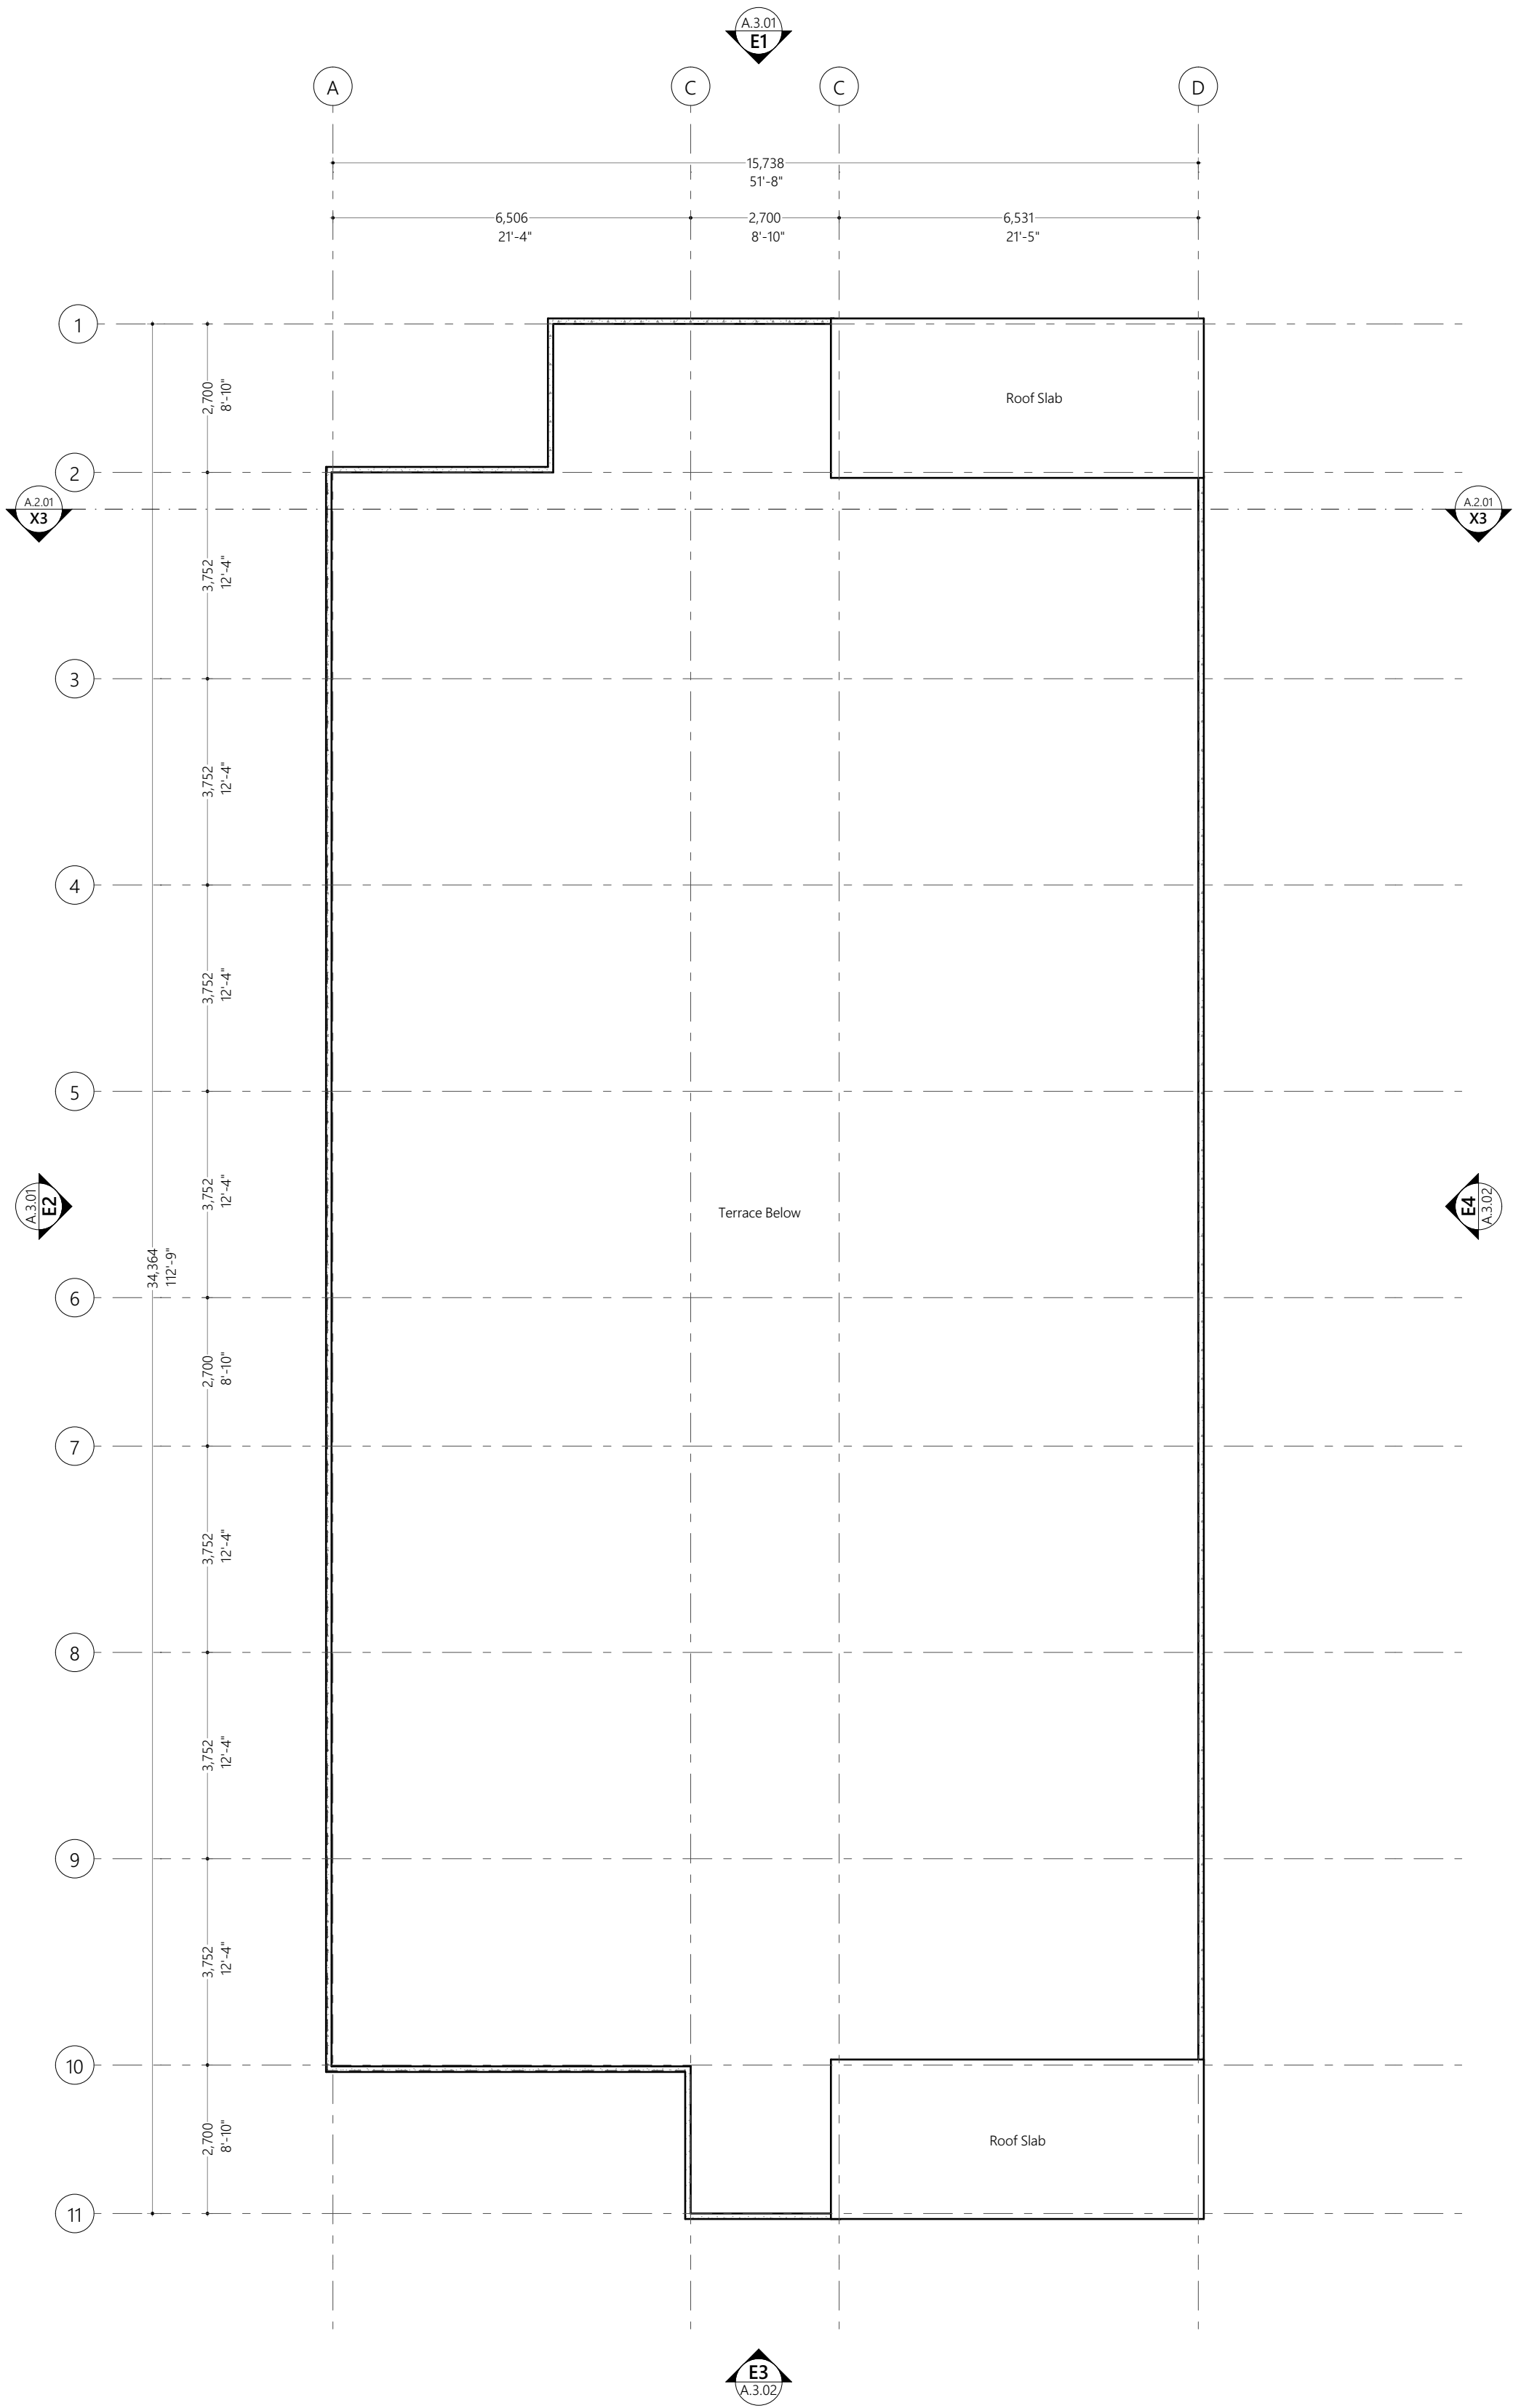


Roof Plan  
1:100

Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
Ministry of Higher Education  
8/2/2023  
Architect: Fathmath Ihudha Amir  
Engineer: Muawiyath Abdul Sattar  
Drawn By: Aishath Shadhny Afzal



P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

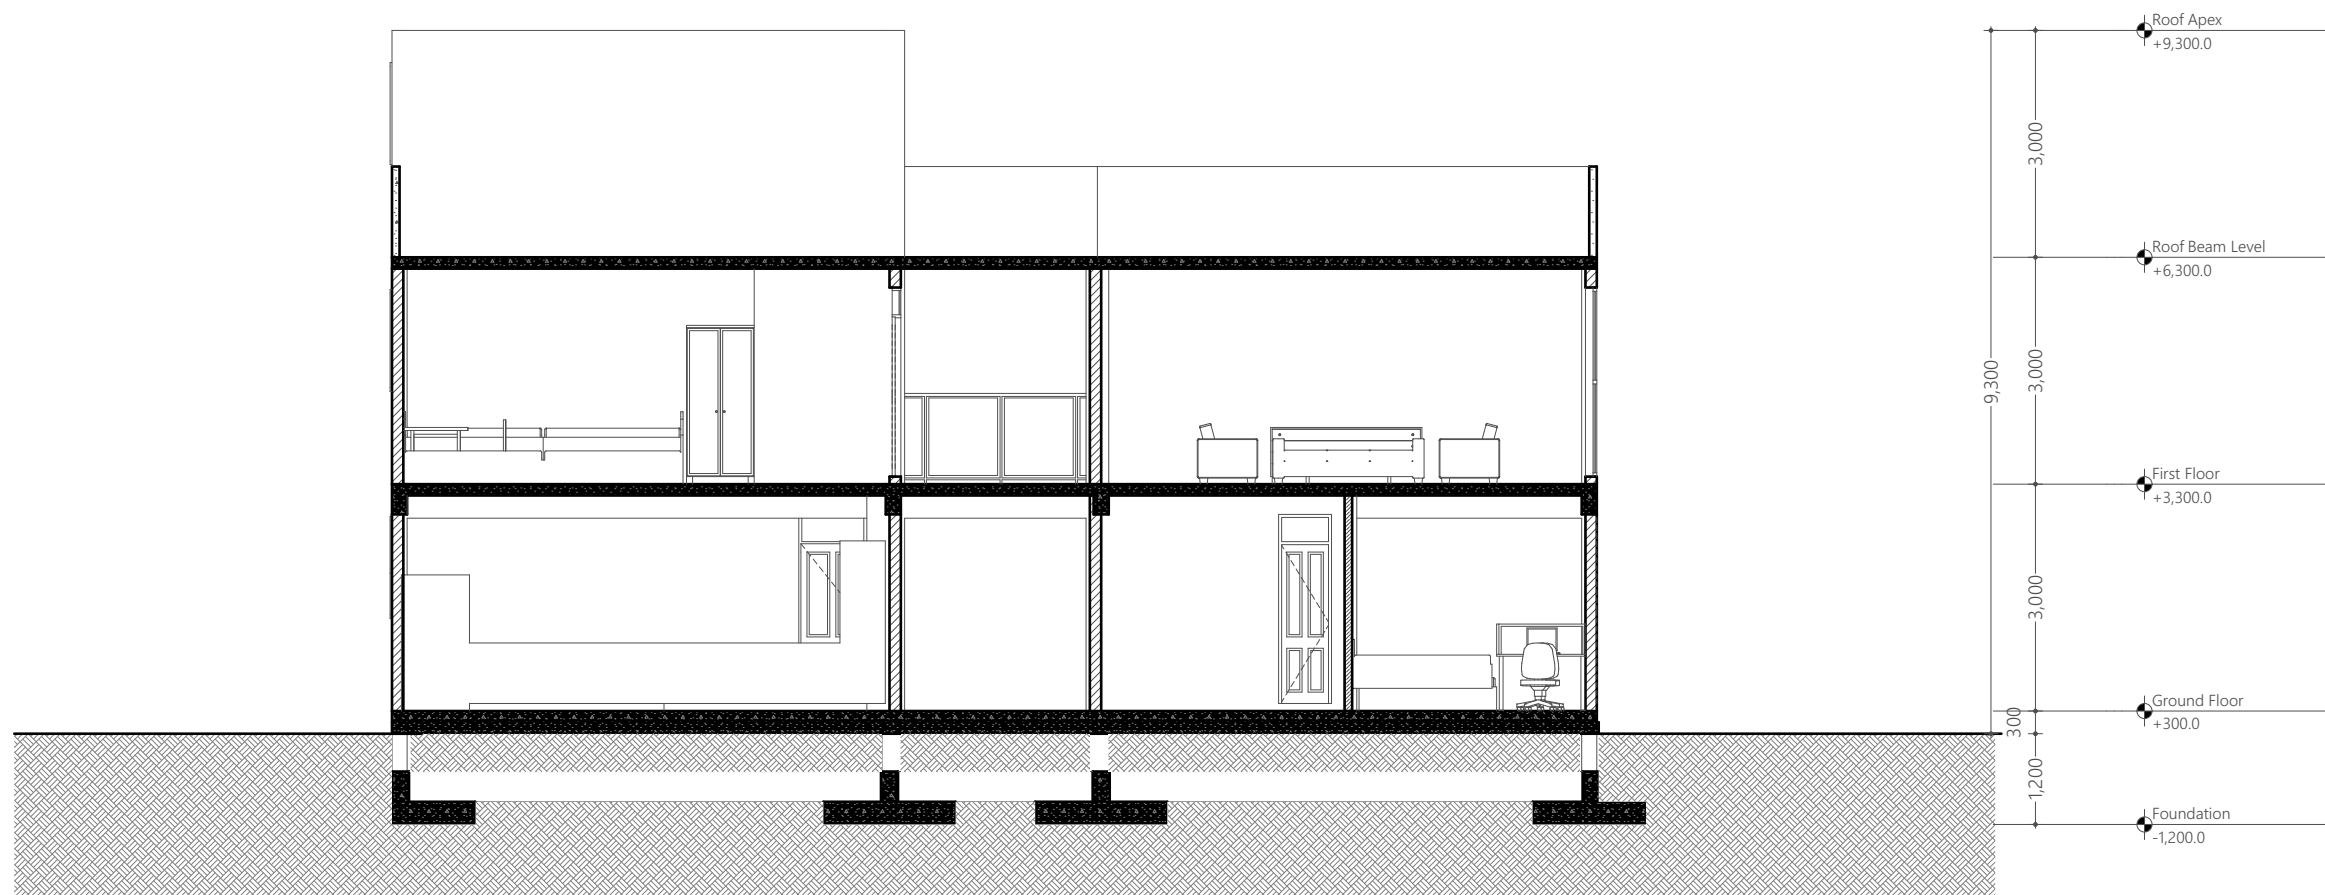

Building Section  
1:100

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**


8/12/2021

Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**


**EPOCH**

P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives



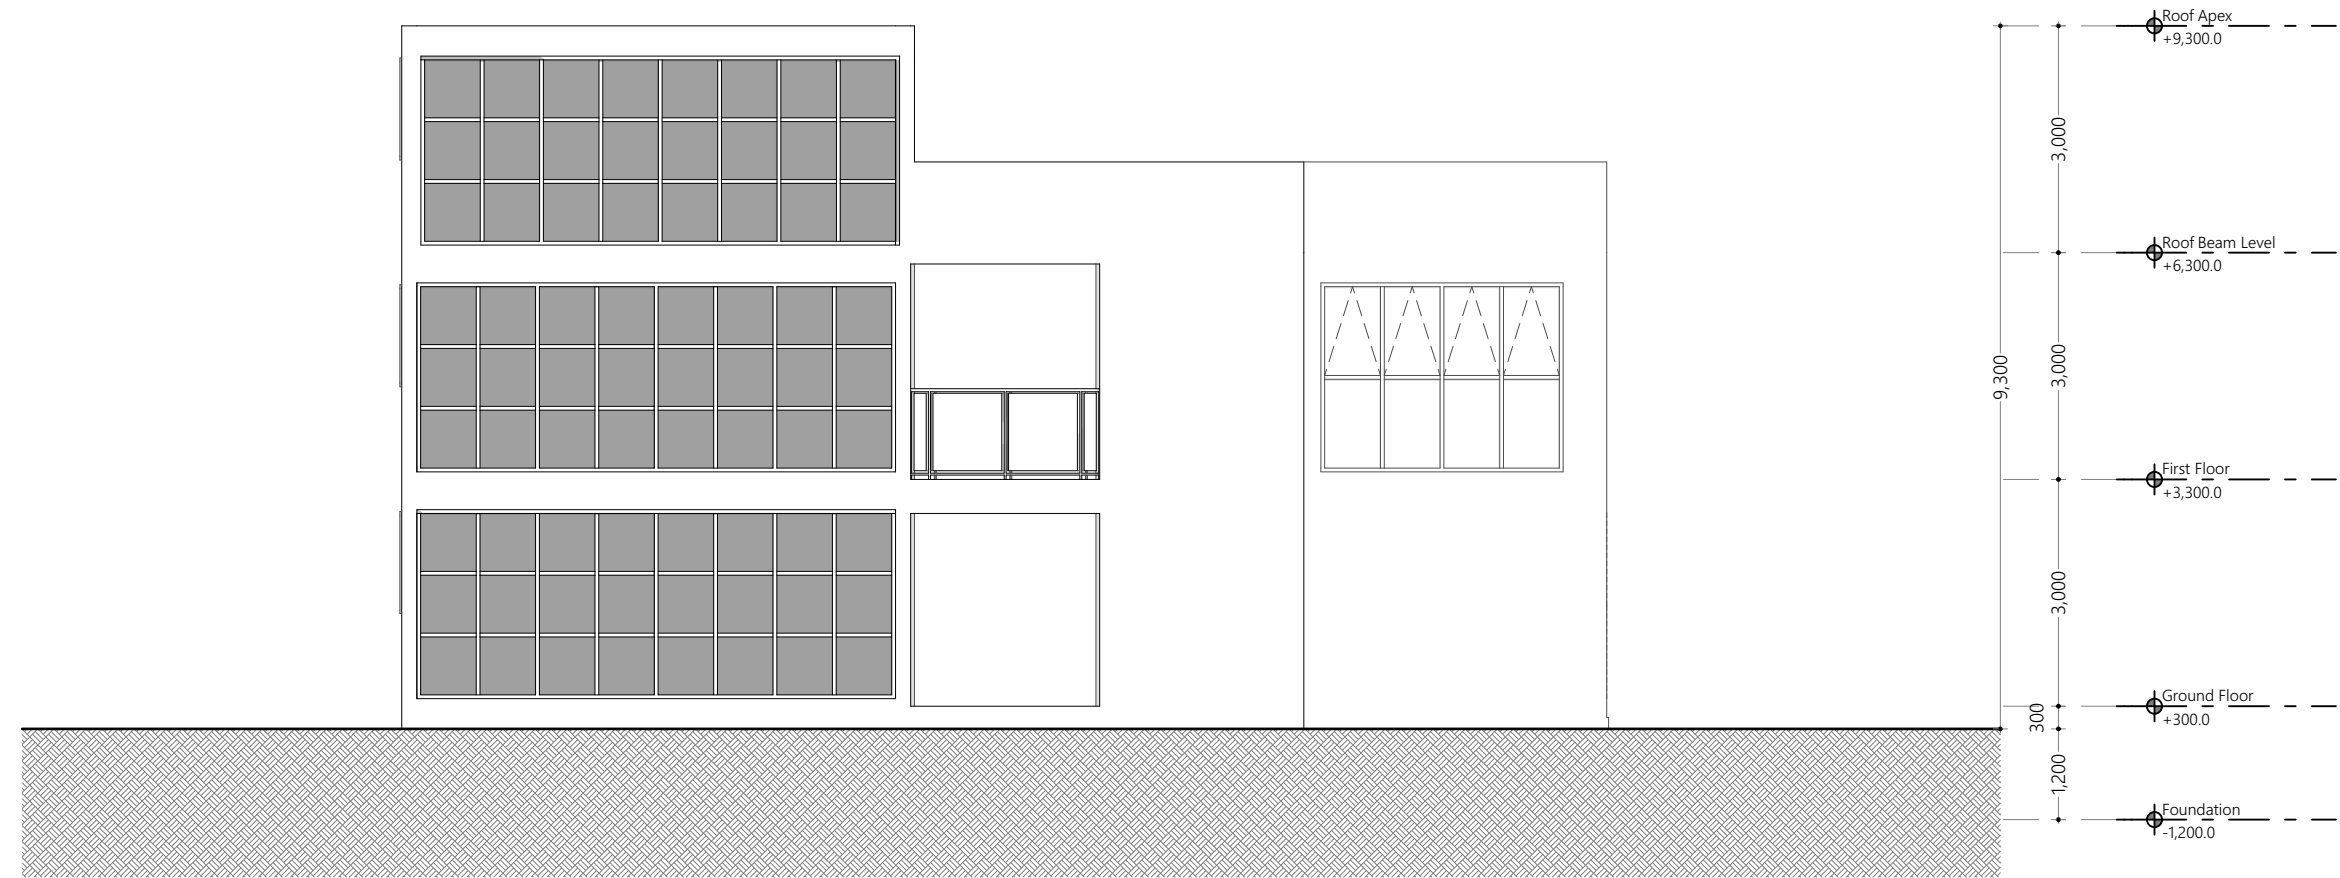

Elevation E1  
1:100

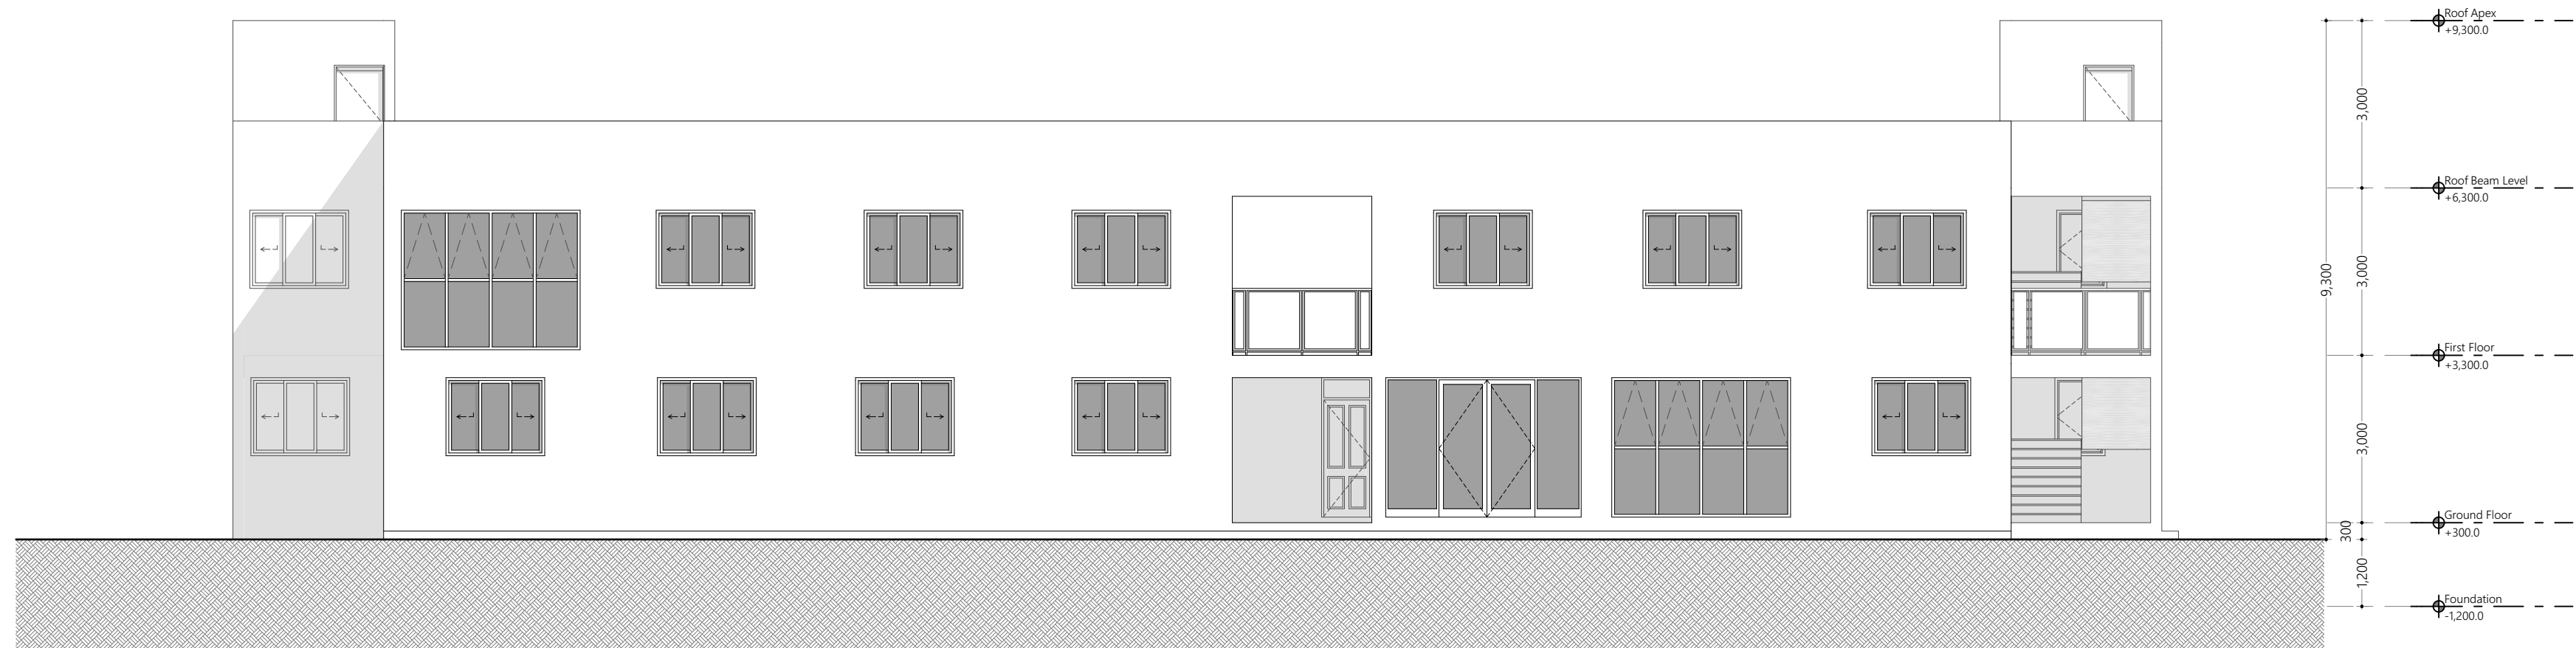

Elevation E2  
1:100

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client

**Ministry of Higher Education**

8/12/2021

Architect **Fathmath Ikhda Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**




P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Gilmary West 3rd Floor,  
Hussheena Magu, Malé, Maldives

Rev:


Page:

A.3.01















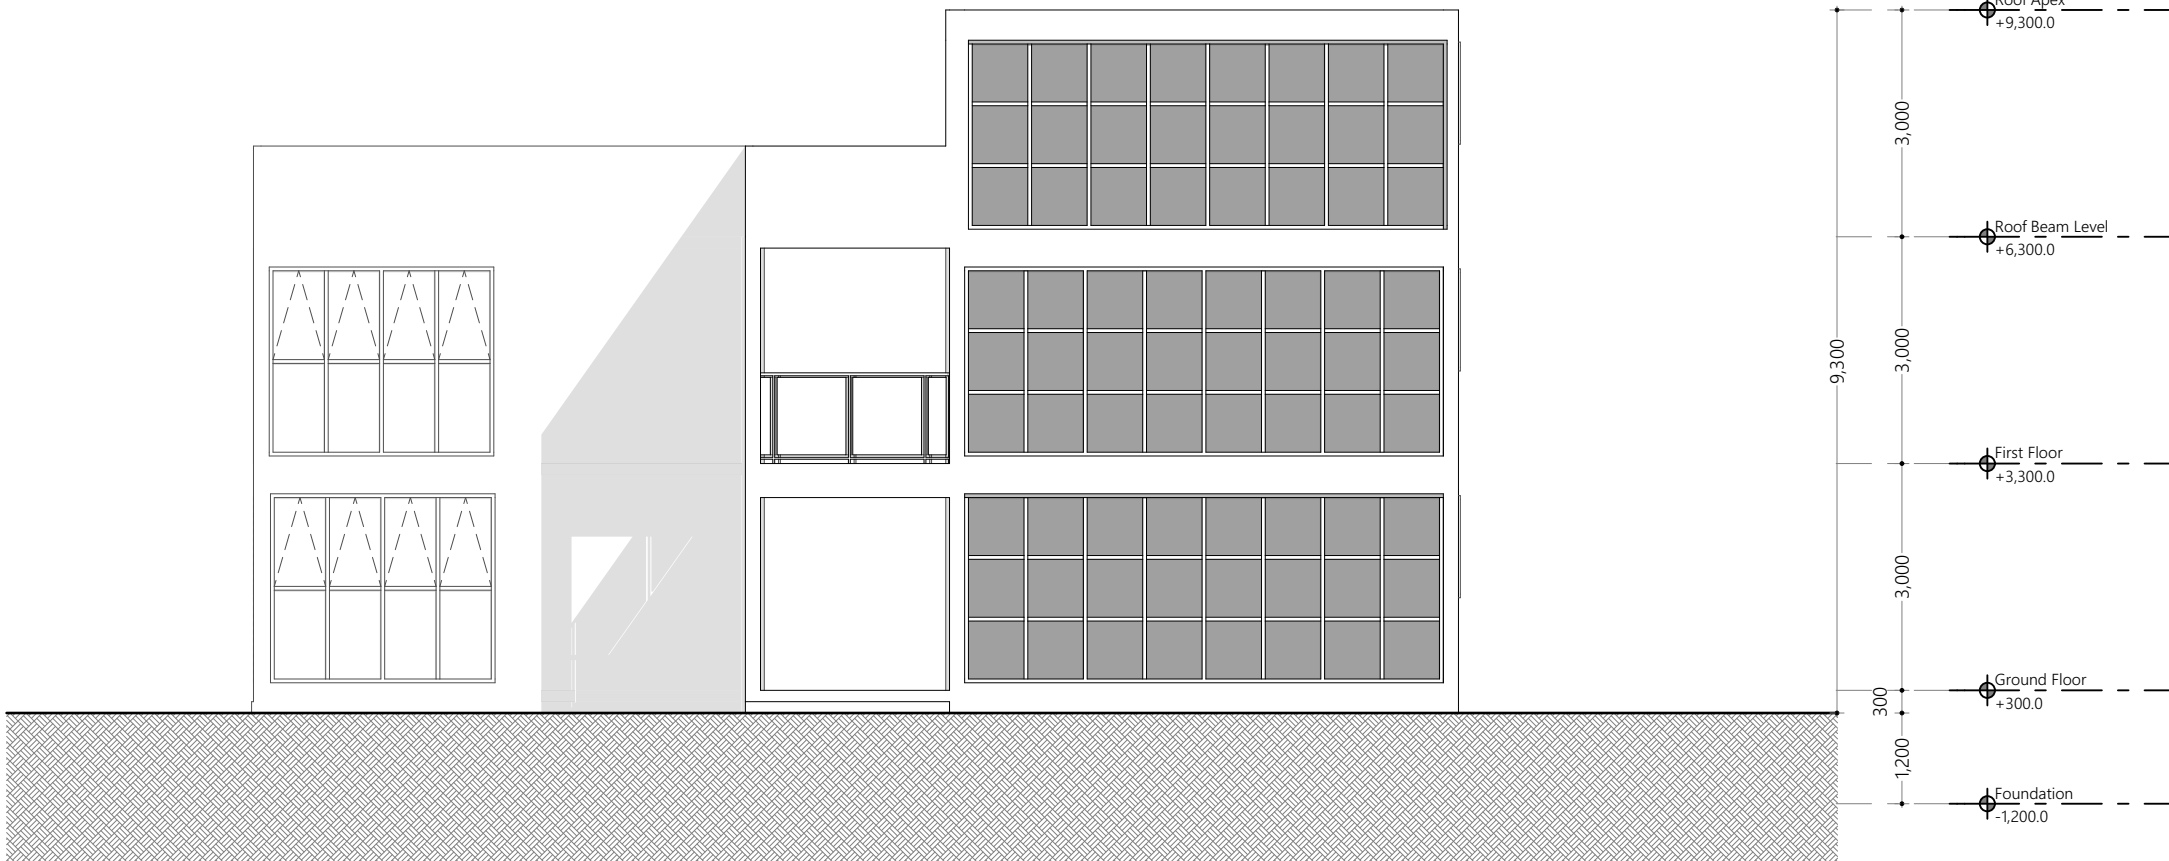

Elevation E3  
1:100

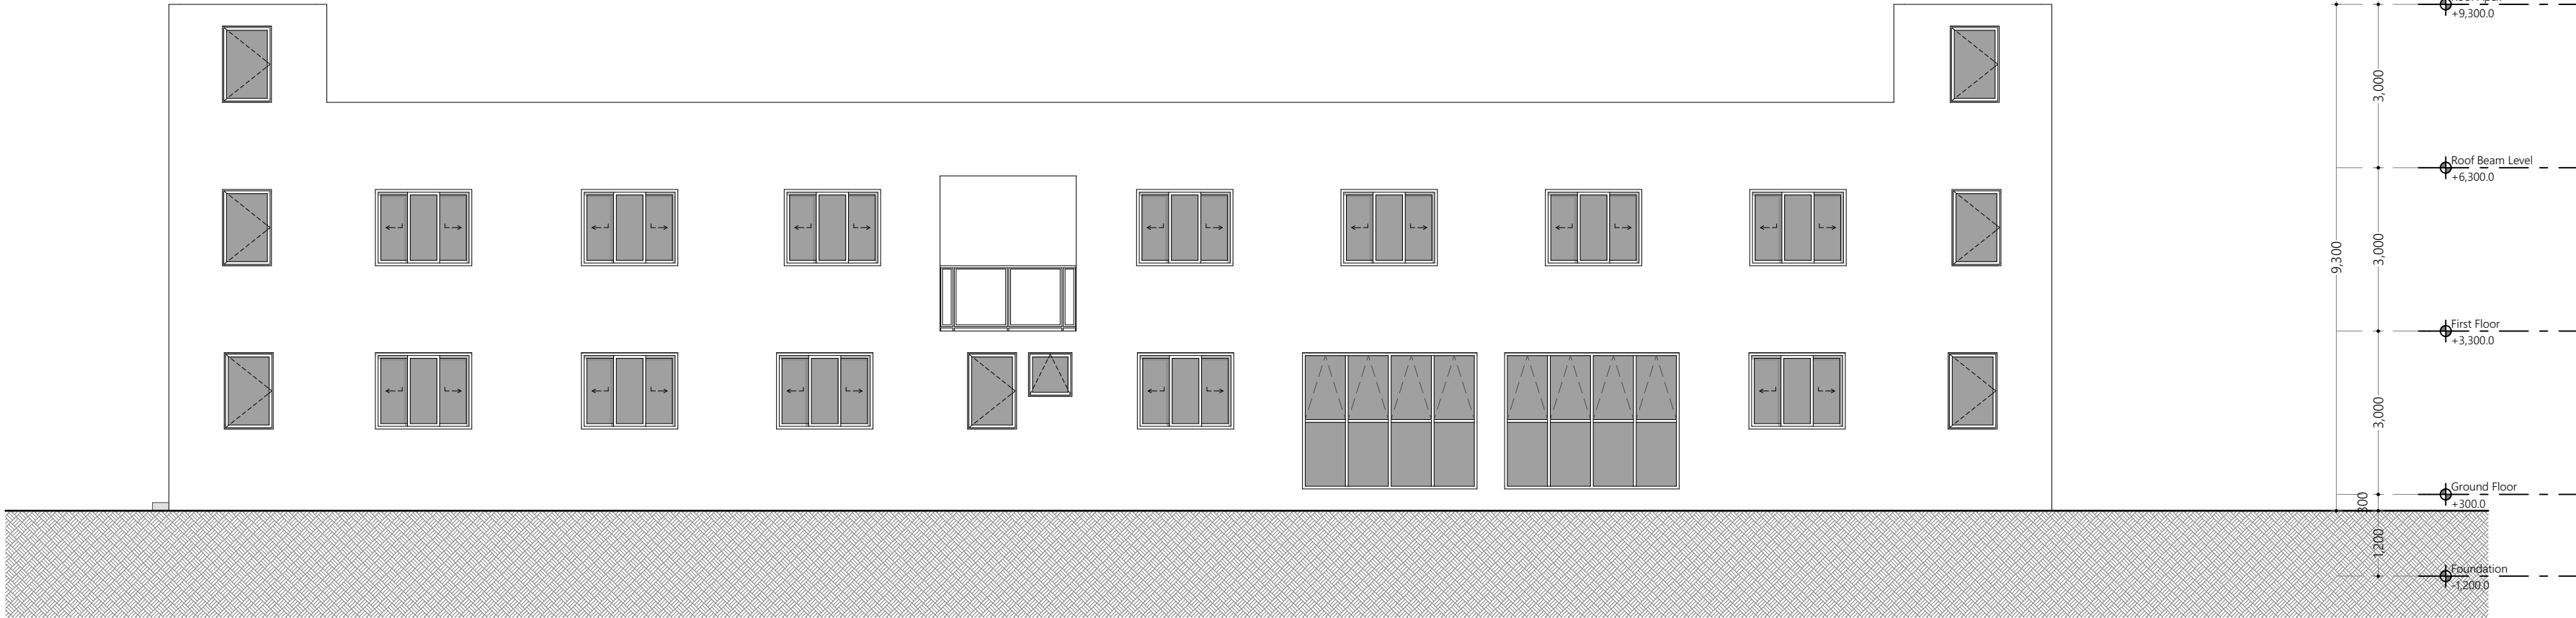

Elevation E4  
1:100

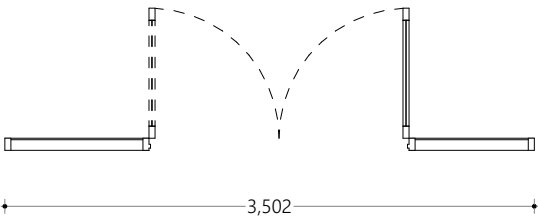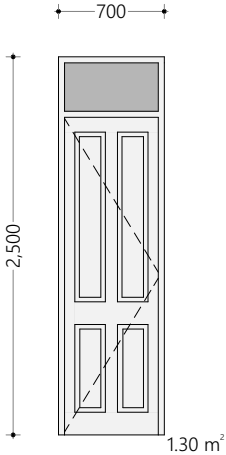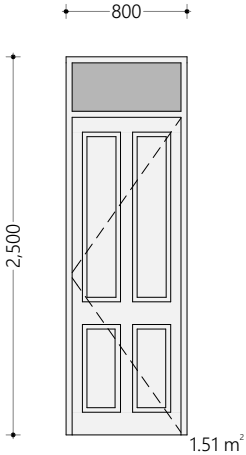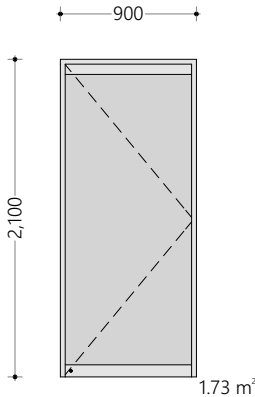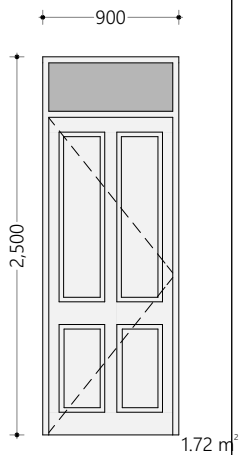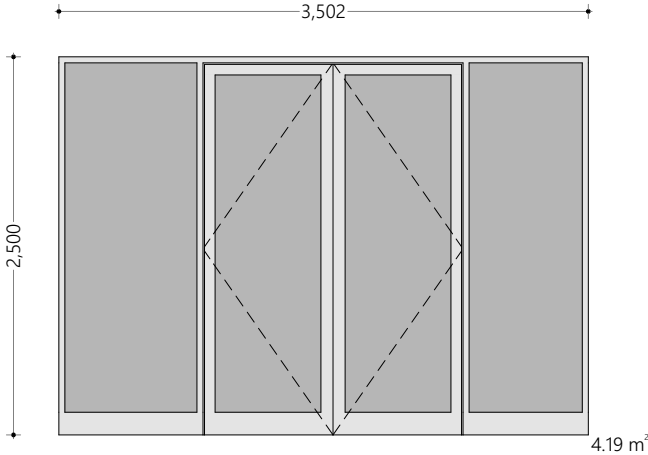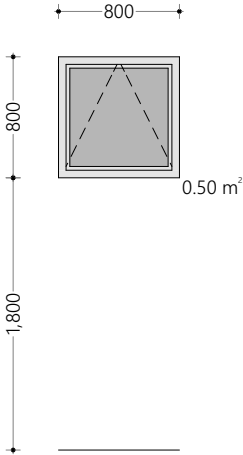All Openings Schedule						
Element ID	D01	D02	D03	D04	D05	W01
Quantity	20	15	2	12	2	1
W x H Size	700×2,500	800×2,500	900×2,100	900×2,500	3,502×2,500	800×800
Sill height	100	100	100	100	100	1,800
Head height	2,600	2,600	2,200	2,600	2,600	2,600
2D Symbol						
View from Side Opposite to Opening Side						
Frame	02 Solid Core Hardwood	02 Solid Core Hardwood	50mm Thick powder coated (60 microns) Aluminum frame of selected colour	02 Solid Core Hardwood	50mm Thick powder coated (60 microns) Aluminum frame of selected colour	50mm Thick powder coated (60 microns) Aluminum frame of selected colour
Door Leaf	02 Solid Core Hardwood	02 Solid Core Hardwood	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	02 Solid Core Hardwood	50mm Thick powder coated (60 microns) Aluminum frame of selected colour	---
Window Sash	---	---	---	---	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour
Glazing	01 Reflective Glass	01 Reflective Glass	01 Clear Glass	01 Reflective Glass	01 Reflective Glass	01 Reflective Glass

Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame

All frame depths are 100mm  
All door leaf thicknesses are 35mm  
All window sash thickness are 25mm  
All frame edges shal be trimmed 3mm  
All wodden components should be wood stained finish  
All aluminum components to be powder coated (min. 60 microns)

All aluminum panels should be of 6mm thick unless specified  
All glazing should be of 6mm unless specified

External units must comply the following weather conditions:  
Wind pressure: 200 kg/sqm  
Water tightness: 25 kg/sqm

All external frames / wall joints must be sealed with silicon sealant  
and the wedges trimmed with 12X12mm hardwood beading fixed to  
frames by brass nails

Sealent shall be provided at all joints while fabrication

All hardware should be provided for the performance of al functions  
of the units  
Hinges shall confirm to

1) Door size more than 700X1900mm  
WD: 125mm X2 sets  
SD: 150mm X3 sets

2) Door size less than 700X1900mm  
WD: 100mm X2 sets  
SD: 125mm X2 sets

Locks shall be cylindrical with master key sets  
Door knobs shall be1000mm above FFL

All Openings Schedule  
1:1

Proposed









Client  
Ministry of Higher Education

8/12/2021

Architect Fathmath Ihudha Amir  
Engineer Muaviyath Abdul Sattar  
Drawn By Aishath Shadhny Afzal

EPOCH

P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

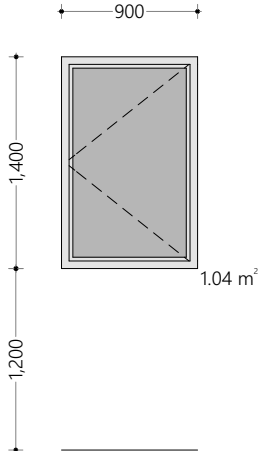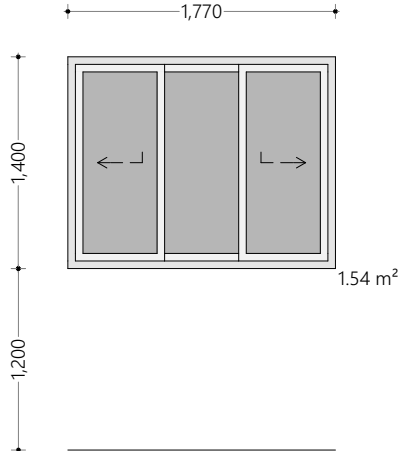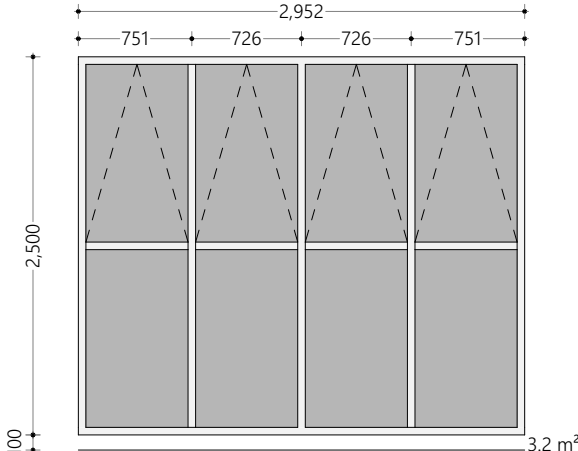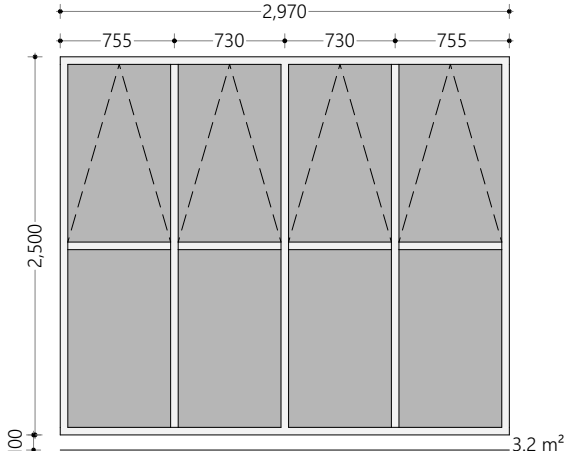All Openings Schedule				
Element ID	W02	W03	W04	W05
Quantity	7	26	1	2
W x H Size	900×1,400	1,770×1,400	2,952×2,500	2,970×2,500
Sill height	1,200	1,200	100	100
Head height	2,600	2,600	2,600	2,600
2D Symbol				
View from Side Opposite to Opening Side				
Frame	50mm Thick powder coated (60 microns) Aluminum frame of selected colour	50mm Thick powder coated (60 microns) Aluminum frame of selected colour	03 Powder Coated Aluminum	03 Powder Coated Aluminum
Door Leaf	---	---	---	---
Window Sash	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	50mm Thick powder coated (60 microns) Aluminum panel of selected colour	03 Powder Coated Aluminum	03 Powder Coated Aluminum
Glazing	01 Reflective Glass	01 Reflective Glass	01 Reflective Glass	01 Reflective Glass

Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame

All frame depths are 100mm  
All door leaf thicknesses are 35mm  
All window sash thickness are 25mm  
All frame edges shal be trimmed 3mm  
All wodden components should be wood stained finish  
All aluminum components to be powder coated (min. 60 microns)

All aluminum panels should be of 6mm thick unless specified  
All glazing should be of 6mm unless specified

External units must comply the following weather conditions:  
Wind pressure: 200 kg/sqm  
Water tightness: 25 kg/sqm

All external frames / wall joints must be sealed with silicon sealant  
and the wedges trimmed with 12X12mm hardwood beading fixed to  
frames by brass nails

Sealent shall be provided at all joints while fabrication

All hardware should be provided for the performance of al functions  
of the units  
Hinges shall confirm to

1) Door size more than 700X1900mm  
WD: 125mm X2 sets  
SD: 150mm X3 sets

2) Door size less than 700X1900mm  
WD: 100mm X2 sets  
SD: 125mm X2 sets

Locks shall be cylindrical with master key sets  
Door knobs shall be1000mm above FFL

All Openings Schedule  
1:1

Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**





**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accomodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:

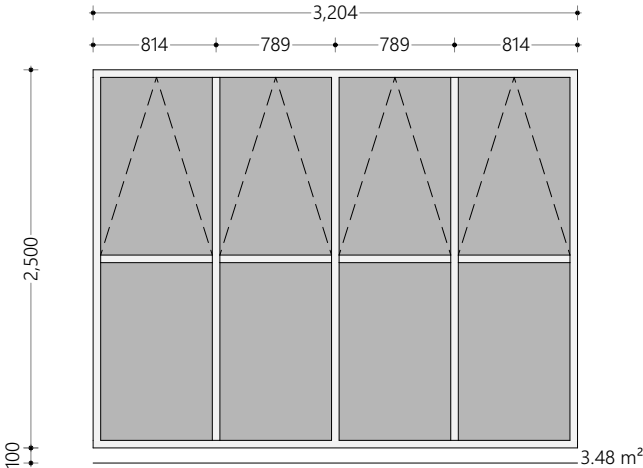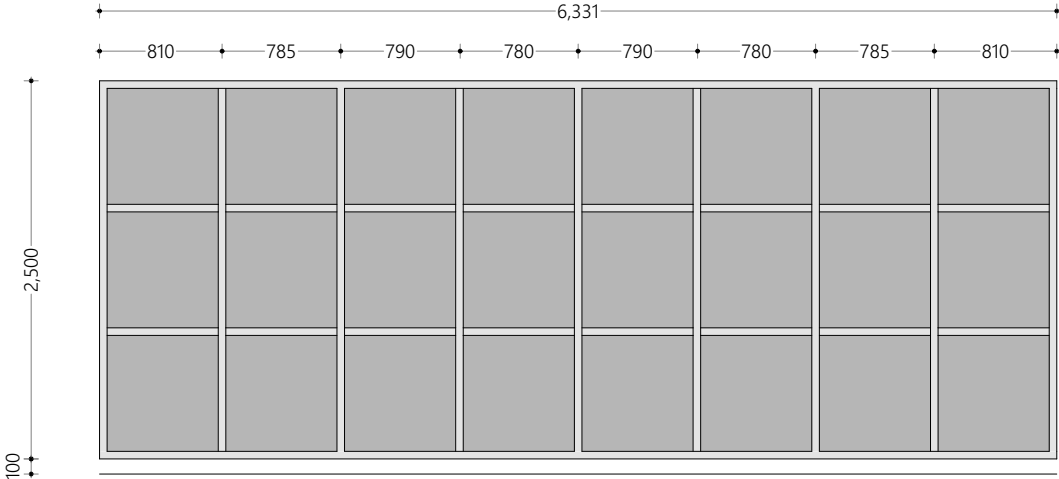All Openings Schedule		
Element ID	W06	W07
Quantity	7	6
W x H Size	3,204×2,500	6,331×2,500
Sill height	100	100
Head height	2,600	2,600
2D Symbol		
View from Side Opposite to Opening Side		
Frame	03 Powder Coated Aluminum	50mm Thick powder coated (60 microns) Aluminum frame of selected colour
Door Leaf	---	---
Window Sash	03 Powder Coated Aluminum	50mm Thick powder coated (60 microns) Aluminum panel of selected colour
Glazing	01 Reflective Glass	01 Reflective Glass

Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame

All frame depths are 100mm  
All door leaf thicknesses are 35mm  
All window sash thickness are 25mm  
All frame edges shal be trimmed 3mm  
All wodden components should be wood stained finish  
All aluminum components to be powder coated (min. 60 microns)

All aluminum panels should be of 6mm thick unless specified  
All glazing should be of 6mm unless specified

External units must comply the following weather conditions:  
Wind pressure: 200 kg/sqm  
Water tightness: 25 kg/sqm

All external frames / wall joints must be sealed with silicon sealant  
and the wedges trimmed with 12X12mm hardwood beading fixed to  
frames by brass nails

Sealent shall be provided at all joints while fabrication

All hardware should be provided for the performance of al functions  
of the units  
Hinges shall confirm to

1) Door size more than 700X1900mm  
WD: 125mm X2 sets  
SD: 150mm X3 sets

2) Door size less than 700X1900mm  
WD: 100mm X2 sets  
SD: 125mm X2 sets

Locks shall be cylindrical with master key sets  
Door knobs shall be1000mm above FFL

All Openings Schedule  
1:1

Proposed

Centre of Excellence  
for Food Processing  
and Fisheries –  
Accomodation Block  
Ha. Dhidhdhoo

Client  
Ministry of Higher Education  
8/12/2021  
Architect Fathmath Ihudha Amir  
Engineer Muaviyath Abdul Sattar  
Drawn By Aishath Shadhny Afzal



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:

Ventilation Schedule

Room Name	Room Area	Opening	Required Opening	Designed Opening	Opening %
Ground Floor					
Laundry	5.99	W3	0.599	1.54	25.71
Dining	47.86	W6x3, D5	4.786	14.63	30.57
Maintanace Storage	MECHANICAL VENTILATION				
Kitchen	23.15	W3	2.315	1.54	6.65
Room 1	18.07	W3, D4	1.807	3.26	18.04
Toilet 1	MECHANICAL VENTILATION				
Room	14.47	W3,D4	1.447	3.26	22.53
Toilet	MECHANICAL VENTILATION				
Maid Room	5.18	W2	0.518	1.04	20.08
Living/Kitchen	34.27	W3x2 ,D4	3.427	4.8	14.01
Room 5	18.14	W3,D4	1.814	3.26	17.97
Toilet 5	MECHANICAL VENTILATION				
Room 4	18.15	W3,D4	1.815	3.26	17.96
Toilet 4	MECHANICAL VENTILATION				
Room 3	18.15	W3,D4	1.815	3.26	17.96
Toilet 3	MECHANICAL VENTILATION				
Room 2	18.23	W3,D4	1.823	3.26	17.88
Toilet 2	MECHANICAL VENTILATION				
Security	7.39	W3, W5	0.739	4.74	64.14
Security Toilet	MECHANICAL VENTILATION				
Gym	54.86	W4, W6x2	5.486	10.16	18.52
First Floor					
Laundry	6.11	W3	0.611	1.54	25.20
Study Room	23.47	W5, W3	2.347	4.74	20.20
Room 10	19.02	W3, D2	1.902	3.05	16.04
Toilet 10	MECHANICAL VENTILATION				
Room 9	19.18	W3, D2	1.918	3.05	15.90
Toilet 9	MECHANICAL VENTILATION				
Room 8	19.18	W3, D2	1.918	3.05	15.90
Toilet 8	MECHANICAL VENTILATION				
Room 7	19.02	W3, D2	1.902	3.05	16.04
Toilet 7	MECHANICAL VENTILATION				
Room 6	19.02	W3, D2	1.902	3.05	16.04
Toilet 6	MECHANICAL VENTILATION				
Common Room	23.15	W6x2	2.315	6.96	30.06
Room 11	19.02	W3, D2	1.902	3.05	16.04
Toilet 11	MECHANICAL VENTILATION				
Room 12	19.02	W3, D2	1.902	3.05	16.04
Toilet 12	MECHANICAL VENTILATION				
Room 13	19.18	W3, D2	1.918	3.05	15.90
Toilet 13	MECHANICAL VENTILATION				
Room 14	19.18	W3, D2	1.918	3.05	15.90
Toilet 14	MECHANICAL VENTILATION				
Room 15	19.02	W3, D2	1.902	3.05	16.04
Tilet 15	MECHANICAL VENTILATION				
Room 16	19.06	W3, D2	1.906	3.05	16.00
Toilet 16	MECHANICAL VENTILATION				
Room 17	19.18	W3, D2	1.918	3.05	15.90
Toilet 17	MECHANICAL VENTILATION				

Ventilation Schedule  
1:153.85

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accomodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

1. General notes

1.1.Do not scale the drawingsAll dimensions shall be read from the drawing or computed.Elevations are in millimeters, distances and reinforcement bar sizes are in millimeters

1.2. In the interpretation of these drawings, indicated dimensions shall govern and distances or sizes shall not be scaled for construction purposes

1.3. The contractor shall coordinate with the arse, ee and other utility and equipment plans for the exact size number and locations of all sleeves or openings through floor slabs, beams and walls. Any discrepancies or conflict in the setting out lineslevels, details, locations,sizes, reinforcement etc. Of the structural member shall be brought to the attention of the engineer prior to commencement of work.

1.4. All reinforced concrete work shall be done in accordance with the british structural code bs 8110 or ec-en2 building code

1.5. All structural steel work shall be done in accordance with the british structural code bs 5950 parts 1to 9 and ec-en3 in so far as they do not conflict with the local building code requirements

1.6. All slabs, beams and other structural elements which are not indicated, detailed, designated or inadvertently omitted but are necessary to be coordinated with architectural and other allied engineering plans as well as to complete the structural works in accordance with the intent of the plans and specifications shall be brought up during pre-bids/meetings/negotiations. It is understood that the contractor has provided and included all these items in his bid.

1.7. The contractor shall produce shop drawings and schedules as required for completion of the works and record drawings of the asbuilt and builder works for the consultant's approval.

1.8. Contractor shall do full coordination between structural,architectural and mep drawings in wet areas to allow for drainage pipes

1.9. All discrepancies shall be brought to the attention of the consultant engineer proceeding with the work on site

1.10. All materials to be used in conjunctions shall comply with the requirements of the specified codes, standards and ordinance of relevant building authorities unless noted otherwise in the project specification and /or drawings.

1.11. All dimensions and levels shown on the drawings shall be verified by the contractor . Any discrepancies shall be brought to consultants attention prior to construction

1.12. The contractor shall ensure that during constructionno part of the structure is overstressed by excessive construction loads until their completion. Temporary bracing and propping to be provided were required

1.13. Once the excavation is done to a specified depththe bearing capacity of the soil shall be confirmed by relevant test, if the value is less than the design bearing capacity the engineer is to be informed immediately

1.14. The contractor shall submit a method statement for all elements of work and shall not proceed until consultant's written approval is given The method statement shall provide the contractor's preferable options where such options are available.

1.15. The contractor shall comply with all requirements of the local regulations and requirements of all concerned authorities

1.16. Quality of concrete finish for all nonplastered columns and beams is to be in accordance with fair faced concrete as reflected on the architectural drawings and specifications.

1.17. Any structural requirements specified by relevant authorities, which are not covered in notes and specifications are assumed to be duly considered by the contractor.

1.18. All typical details and notes shown on drawings shall apply unless noted otherwise. Typical detail may not necessary be indicated on the plans but shall still apply as shown or described in the details where particular details are noted on the drawings the specified details shall be used.

1.19. The design life of the structure of this project shall maintain a minimum of50 years life period The primary structural components are to be designed and detailed to satisfy this requirement. Concrete mix supplier shall submit a life cycle analysis which reflect a 50 years design life without maintenanceinspection and repair requirement during this period.

2. Concrete

2.1. All concrete works shall conform to the bs8110 or ec-en, a grade of c25/30 indicates that concrete shall have a fcu compressive strength of 30n/mm2 established from test cubes at 28 days equivalent to a compressive strength of 25n/mm2 established from cylinder tests at 28 days.

concrete mix design shall comply with bs8500-1:2006 as follows:

Miz Number	1	2	3	4
Grade	C30/37	C25/30	C25/30	C16/20
Min cement content (kg/m³)	380	340	340	300
Cement Type	SRC	SRC / OPC	OPC	SRC
Max free W/C ratio	0.4	0.45	0.45	0.55
Slump	75 ± 25	75 ± 25	75 ± 25	100 ± 25
Aggregate	20	20	20	20

mix 1 - used in reinforced concrete works for structures at sea/exposed to sea, water retaining structures and tank structures.

mix 2 - used in reinforced concrete works for ground level and below (sub-structutre) or any reinforced concrete works in contact with soil or water.

mix 3 - used in reinforced concrete works above ground fir lvl (superstructure) for horizontal members (beams/slabs) and vertical members (columns/walls).

mix 4 - used for plain concrete blinding and mass fill.

2.2. Contractor shall implement a trial mix in accordance with the project specifications & authority requirements. Trial mix results shall be submitted for engineer's review & approval prior to commencing concreting.

2.3. Contractor shall submit the details of additives, plasticizers, micro silica, curing compounds, waterproofing agents, etc. Application should follow strictly the manufacturer recommendation. It is contractors responsibility to ensure that all constituents of concrete are compatible to each other.

2.4. Maximum percentage (by weight) of salt contents permissible in aggregates used for concrete, hollow blocks & hourdi blocks, etc, shall be as follows:  
a) acid soluble chlorides in aggregate - (fine 0.03%, coarse 0.02%)  
b) acid soluble sulphate in aggregate - (fine 0.3%, coarse 0.2%)

2.5. Concrete shall be cured by an approved means in accordance with the specifications.

2.6. Aggregates shall be from approved source and in accordance with the specifications.

2.7. Openings, sleeves:  
a) no holes, sleeves or penetrations be placed vertically or horizontally through beams unless approved by the engineer.  
b) no holes to be made in slabs unless approved by the engineer.

2.8. Construction joints:  
a) the contractor shall submit to the engineer for approval a plan marked up showing the location of all construction joints  
b) horizontal construction joints shall not be made in beams, unless approved by the consultant or engineers.  
c) vertical construction joints may be located at midspan of slabs or beams after reviewed and approved by the engineers.  
d) contractor shall submit shear friction and the additional required reinforcement calculation of construction joint at any location) for engineers review and approval.

3. Reinforcement

3.1. The reinforcement used in the reinforced concrete shall be round, deformed type 2 bars marked as (t) to indicate high yield strength of 460n/mm2 to bs4449 or type 500b to ec-en. The carbon equivalent of rebars should not exceed 0.51 for grade 460.

3.2. Reinforcement details shown are indicative. The contractor shall prepare detailed shop drawings & full bar schedules in accordance with the design drawings and shall be cut and bent in accordance with bs 8666 and aci 315-09 for the engineer's approval at least four weeks prior to commencement of reinforced concrete work and after coordinating with all concerned parties.

3.3. Lap lengths and anchorage lengths of reinforcement shall be as per bs 8110 and ec en. Additional lapping if required to be provided with engineer's approval. The minimum lap length of reinforcement shall be the maximum of (45 bar dia in general and 50 dia for tension) or the values of the table a.

Table a : schedule of lap splices

Bar dia	lap splices length (mm)
10	500
12	600
16	800
20	1000
25	1250

3.4. Spacer bars in beams shall be a minimum t25 or the size of bar if greater at 1000mm c/c; chairs in slabs shall be a minimum t12@1000mm c/c; and minimum ties in walls shall be t8@1000mm c/c.

3.5. Clear cover to reinforcement including links, stirrups, and ties shall be as follows:

- A) structure in contact with ground
- Footings = 55mm
- Wall and column = 50mm
- Ground beam = 50mm
- Slab at ground level = 50mm
- B) super structure
- Columns = 40mm
- Beams = 35mm
- Slabs = 30mm
- Walls = 40mm
- All concrete elements in contact with water/splash zone = 75mm

3.6. Reinforcement bars to be cut, bent or adjusted to clear all openings and interfering structures to suit at site to the approval of the consultant or engineer.

3.7. For holes in slabs up to 300x300 sq., reinforcement is to be cut and replacement bars fixed adjacent to the hole extending 50x bar diameter beyond the hole.

4. Fire resistance

4.1. All structural concrete members between units on boundaries are designed to maintain fire resistance of 2 hours.



5. Cracking

5.1. The cracking of the structural concrete in general is restricted to 0.30mm.

6. Earthwork & foundations

6.1. Foundation detail design is based on the assumed safe allowable bearing capacity has been taken as 150kpa. The actual requirement for the foundation design is to be verified based on final geotechnical report for the project.

6.2. Excavations for foundations down to formation level shall be carried out by mechanical means, except for the last 100mm of excavation which is to be carried out by manual methods and recommended by geotechnical consultant.

6.3. The formation level of foundation is to be inspected and approved by the geotechnical engineer before commencement of the work.

6.4. Engineering fill (unless specified otherwise as a higher quality material) shall be selected well graded granular material approved by the engineer with a minimum soaked cbr of 15% compacted not exceeding 250mm in layers to 95% maximum dry density as per geotechnical investigation report recommendations in accordance with the specification. However, a minimum cover of 250mm back fill material shall be provided at the top of foundations below the blinding to cast against.

6.5. Efficient site drainage during and after construction of the project should be provided by the contractor.

6.6. Site inspection by a qualified engineer should be carried out after completion of the excavation works and after preparation of the proposed foundation level to ensure that the contact surface is free from any loose/soft layer and properly prepared for the foundation.

7. Concrete workmanship

7.1. All concrete without plaster shall be fair finish unless noted otherwise.

7.2. All concrete surface to have plaster are to be hacked to have an adequate surface key.

7.3. All concrete is to be cured by an approved method-water pounding or curing compound.

7.4. All types of construction joints in concrete shall be at a specified locations and approved by the engineers.

7.5. All substructure concrete works shall be protected with water proofing as per standard details & specifications.

7.6. All concrete shall be compacted using a mechanical vibration process.

7.7. 25x25mm chamfers to external corners and edges shall be provided in accordance with specifications and directed by the engineer.

8. Structural steel

8.1. All structural steel works shall be in accordance with bs 5950 parts 1 to 9 or ec-en3.

8.2. Maximum dimension of holes shall be in accordance with bs 5950 : part 1 : 2000 table 35, unless indicated otherwise.

8.3. The contractor shall provide whatever temporary ties or bracing necessary for a safe and proper erection of the steel structures.

8.4. Welding shall comply with bs en 1011-1: 2009, bs en 1011-2 : 2001 and bs bs en 1011-8 : 2004.

8.5. Contractor shall do a detailed design for aluminum shades and to submit full design calculations and detailed shop drawings for all steel sections and connections to the engineer for approval prior to commencement of fabrication.

8.6. All rolled products and plates shall conform to bs en 10025-2. Cold form welded structural hollow sections shall conform to bs en 10219-1. Hot finish hollow sections shall conform to bs 10210-1 unless noted otherwise on drawings.

8.7. All connections shall be made with minimum 2nos. Galvanized grade 8.8 to bs 3692 with a minimum diameter of 20mm and minimum yield strength of 627mpa and minimum ultimate strength of 765mpa and electrodes to bsd 639, unless noted otherwise.

8.8. Unless noted otherwise on the drawings, all connections shall be in accordance with the following minimum requirements:

- A) all welds shall be at least 6mm continuous fillet welds all around.
- B) all structural bolted connections should be galvanized minimum 85 micron and with a minimum of 2 bolts per connection. Purlin bolts shall be in accordance with the suppliers recommendations.
- C) all gusset plates shall be at least 4mm thick.
- D) all cap plates shall be at least 4mm thick.
- E) all base plates shall be at least 4mm thick.

8.9. As minimum all structural steel members shall be shot blasted to sa 2.5, galvanized, primed & painted as below unless noted otherwise:

- A) hot galvanization (dft 200micron)
- B) primer coat to contain 2 coats of zinc rich epoxy primer (dft 75 micron)
- C) top coat to contain 2 coats of polyurethane enamel paint (dft 125 micron)

8.10. All structural steel work shall be corrosion protected in accordance with the structural specifications.

8.11. All steel should conform to the following:

- A) shs, rhs and chs sections bsen 10210 s275 fy=275mpa
- B) all angles and channels u.n.o bsen 10025 s275 fy=275mpa

8.12. All steel columns to be central on grids or equally spaced between grids unless noted otherwise.

8.13. All steel beams to be central on grids or equally spaced between grids unless noted otherwise.

8.14. All steel dimensions are to center line of section unless noted otherwise.

8.15. All bracing is to be set out on the centroids of bracing members and on the center line of beams and columns unless noted otherwise.

8.16. Where bracing is shown offset from center of members the contractor shall design and provide all necessary stiffeners.

8.17. Contractor to provide all leader railing as required to support free edges not trimmed with cold formed or mild steel work. To be provided in accordance with architect’s drawings.

8.18. Location of any connections, splices not shown in the drawings shall be submitted with design for engineer’s approval. No splices shall be made unless shown in the drawings and as approved by the engineers.

8.19. Contractor shall do a full coordination between architecture and structural drawings for the steel support for shade elements, locations and sizing connections with structural concrete elements and sections. Care shall be taken to prevent dissimilar metal corrosion.

9. Masonry blocks

9.1. Design and construction of all blocks shall comply with bs 5628 : parts 1.2 & 3 : 1992 or en-ec6. The contractor shall submit a construction method statement prior to commencing the works.

9.2. Wall ties in accordance with bs 1248 - cp 121 part 1.73.

9.3. All block wall joints to manufacturers specifications.

9.4. All block work walls are to be considered as non-load bearing partitions unless noted otherwise in drawings

9.5. Block walls shall be reinforced horizontally and vertically as per manufacturers requirements.

9.6. Masonry wall mechanical properties

young's modulus	= 3.5e+006 kn/m <sup>2</sup>
poisson's ratio	= 0.25
density	= 20kn/m <sup>3</sup>
min.compressive strength	= 3.5 mpa

10. Design & loading

10.1. Consultant design

design and construction of reinforced concrete structural members, shall be in accordance with bs8110 & ec-en2 and the structural steel members to bs 5950 & ec-en3.

10.2. Contractor design

the contractor is responsible for the design of all temporary works. (shoring for excavation, signage... Etc) and the following items of permanent secondary works. (subjected to engineers review and approval)

- a) precast concrete elements
- b) architectural facade and support steelwork
- c) non load bearing feature columns
- d) all secondary steel works
- e) structural steelwork connections
- f) structural support for mep services
- g) shade structures
- h) balustrade and crash barrier
- i) structural glass
- j) interior signage

the design of the primary structure is considering the interfaces with these structures) loading reactions, opening...etc.) And were detailed to accommodate these elements into the design.

the contractor shall submit a full detail design for the wall and boundary wall foundation; also the contractor to do full coordination between the structural foundation for villas (including the water tanks, and the boundary wall for clashes, the contractor shall produce shop drawings for the boundary walls for engineer's approval.

10.3. Loading

- a) superimposed (dead loads & live loads) as per bs 6399 or en-ec1.
- b) self-weight & densities as per bs 648 or en-ec1.
- c) wind loads as per bs 6399 or en-ec1 (mean wind speed = 25m/s).

11. Timber

11.1. All timbers shall be in accordance with bs 5268 or ec-en5

11.2. All timber members sizes are indicative. Contractor shall coordinate with supplier and submit detail designs for all prefab timber structure for approval.




Notes:

1. First stirrups location shall be  $\neq 2$  from the face of the column/ support
2. Place one b bar in each bottom corner and one t bar in each top corner of the stirrup cage.
3. Condition shown is at columns Where beams and girder intersect use typical interior girder section
4. All bottom bars and top bars shall be placed in one layer unless two layers are noted in the beam schedule Where to layers are noted provide 25 mm clear between layers If two layers are noted place bar b1 above bar b and bar t above  $\bar{t}$ .
5. Length of exterior top bars are given only when straight bar occurs otherwise hooked bars are required
6. Where a member is supported by a column but has another member running perpendicular to it at the same column the first stirrup spacing shall start from the face of the column and not from the face of the transverse beam
7. Top & bottom reinforcement lapping of both main rebars can be ignored if the main rebars at left and right side of lapping location are identical
8. For 'column width less or equal 2m  $l^* = \text{'column width'}/2$ . For 'column width' greater than 2m,  $l^* = 1\text{m}$


Supplementary abbreviations

- B1 - continuous bottom bars  
B2 - additional bottom bars  
CE - cantilevered end  
D - depth of member, mm  
EE - each end  
EF - each face  
FL - full length  
EW - each way  
H - aci standard hook  
ITB - interior top bar  
LE - left end  
LG - length  
P - paired stirrups  
RE - right end  
REM - remainder  
S - side bars  
T1 - top bars at internal supports  
T2 - top bars at mid-span  
T3 - top bars at end support  
W - width of member, mm

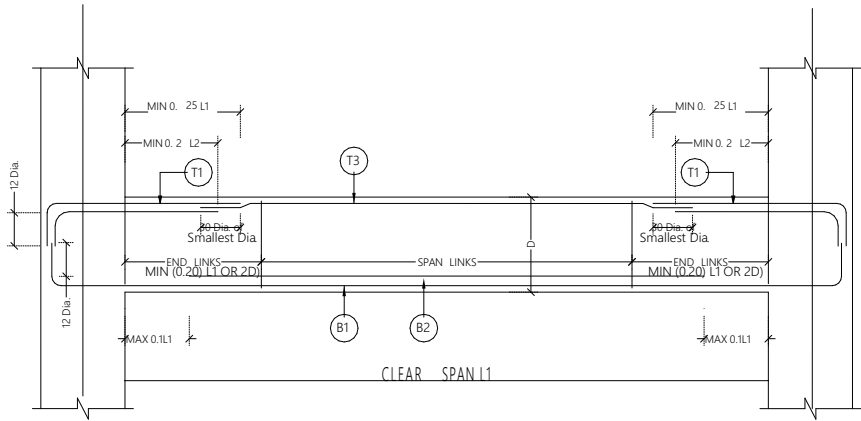


SIMPLE BEAM DETAILS

NTS

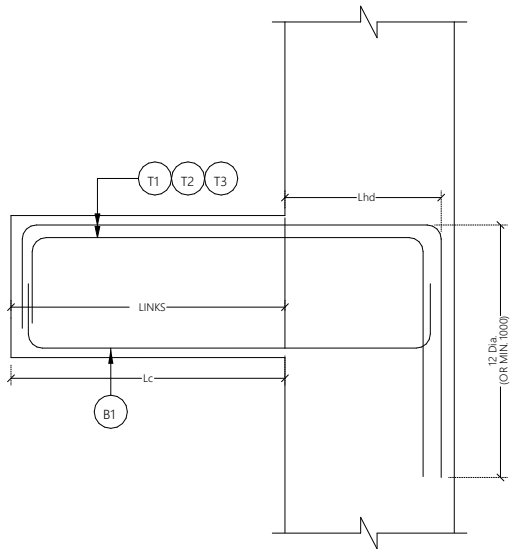


TYPICAL CANTELEVER BEAM FROM COLUMN

NTS

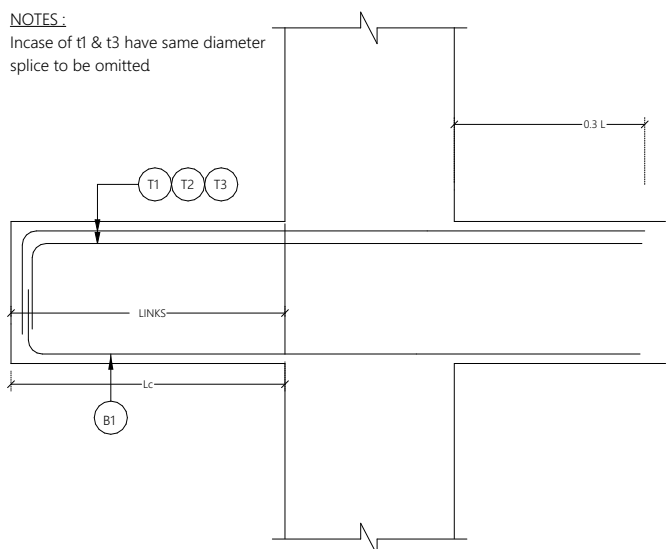

TYPICAL CANTELEVER BEAM CONTINUOUS

NTS

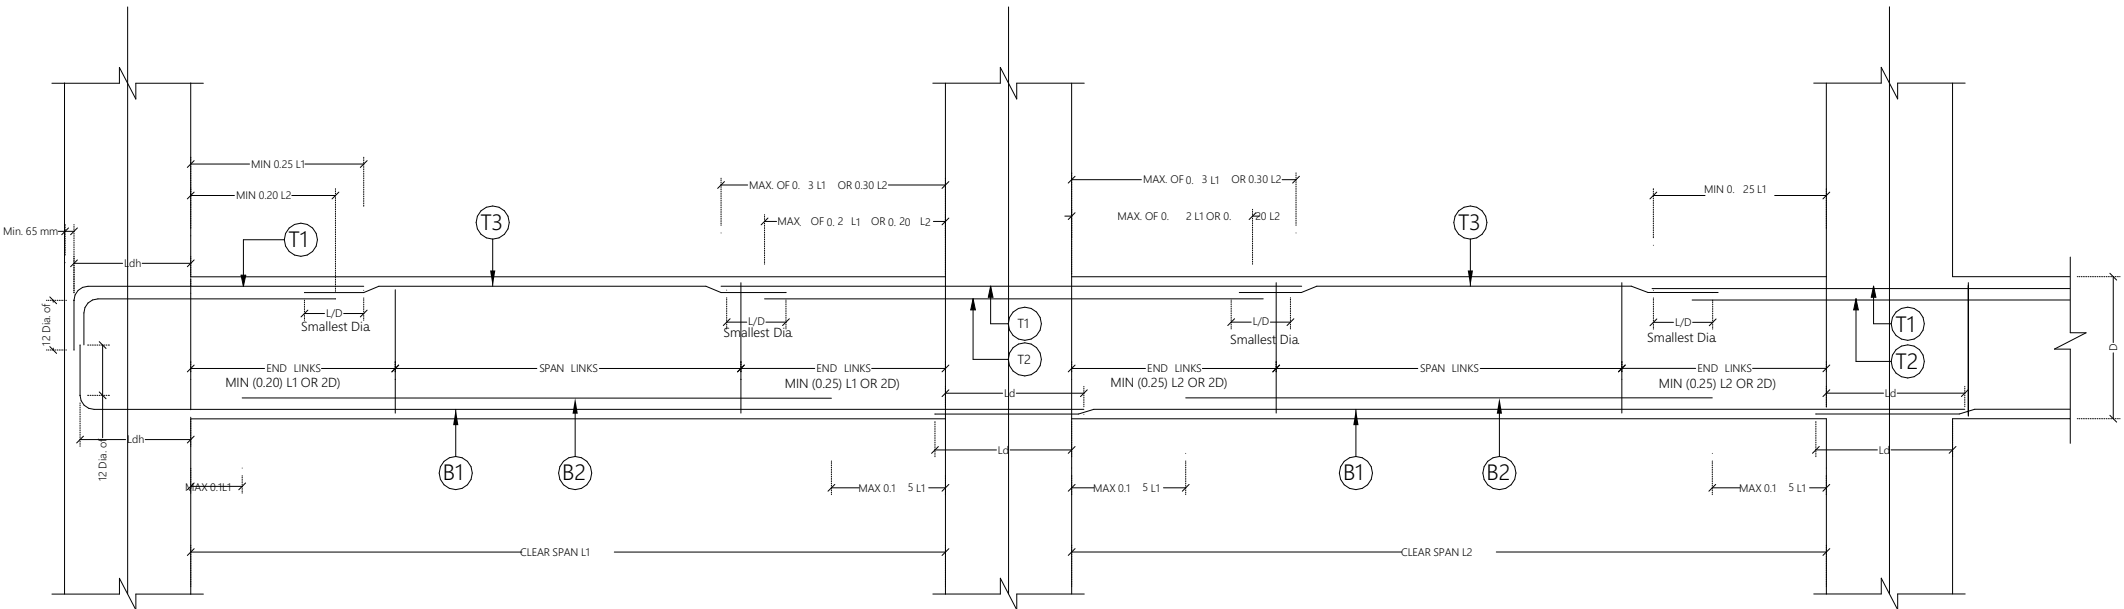

CONTINUOUS BEAM DETAILS

NTS

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accommodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev:

Page:

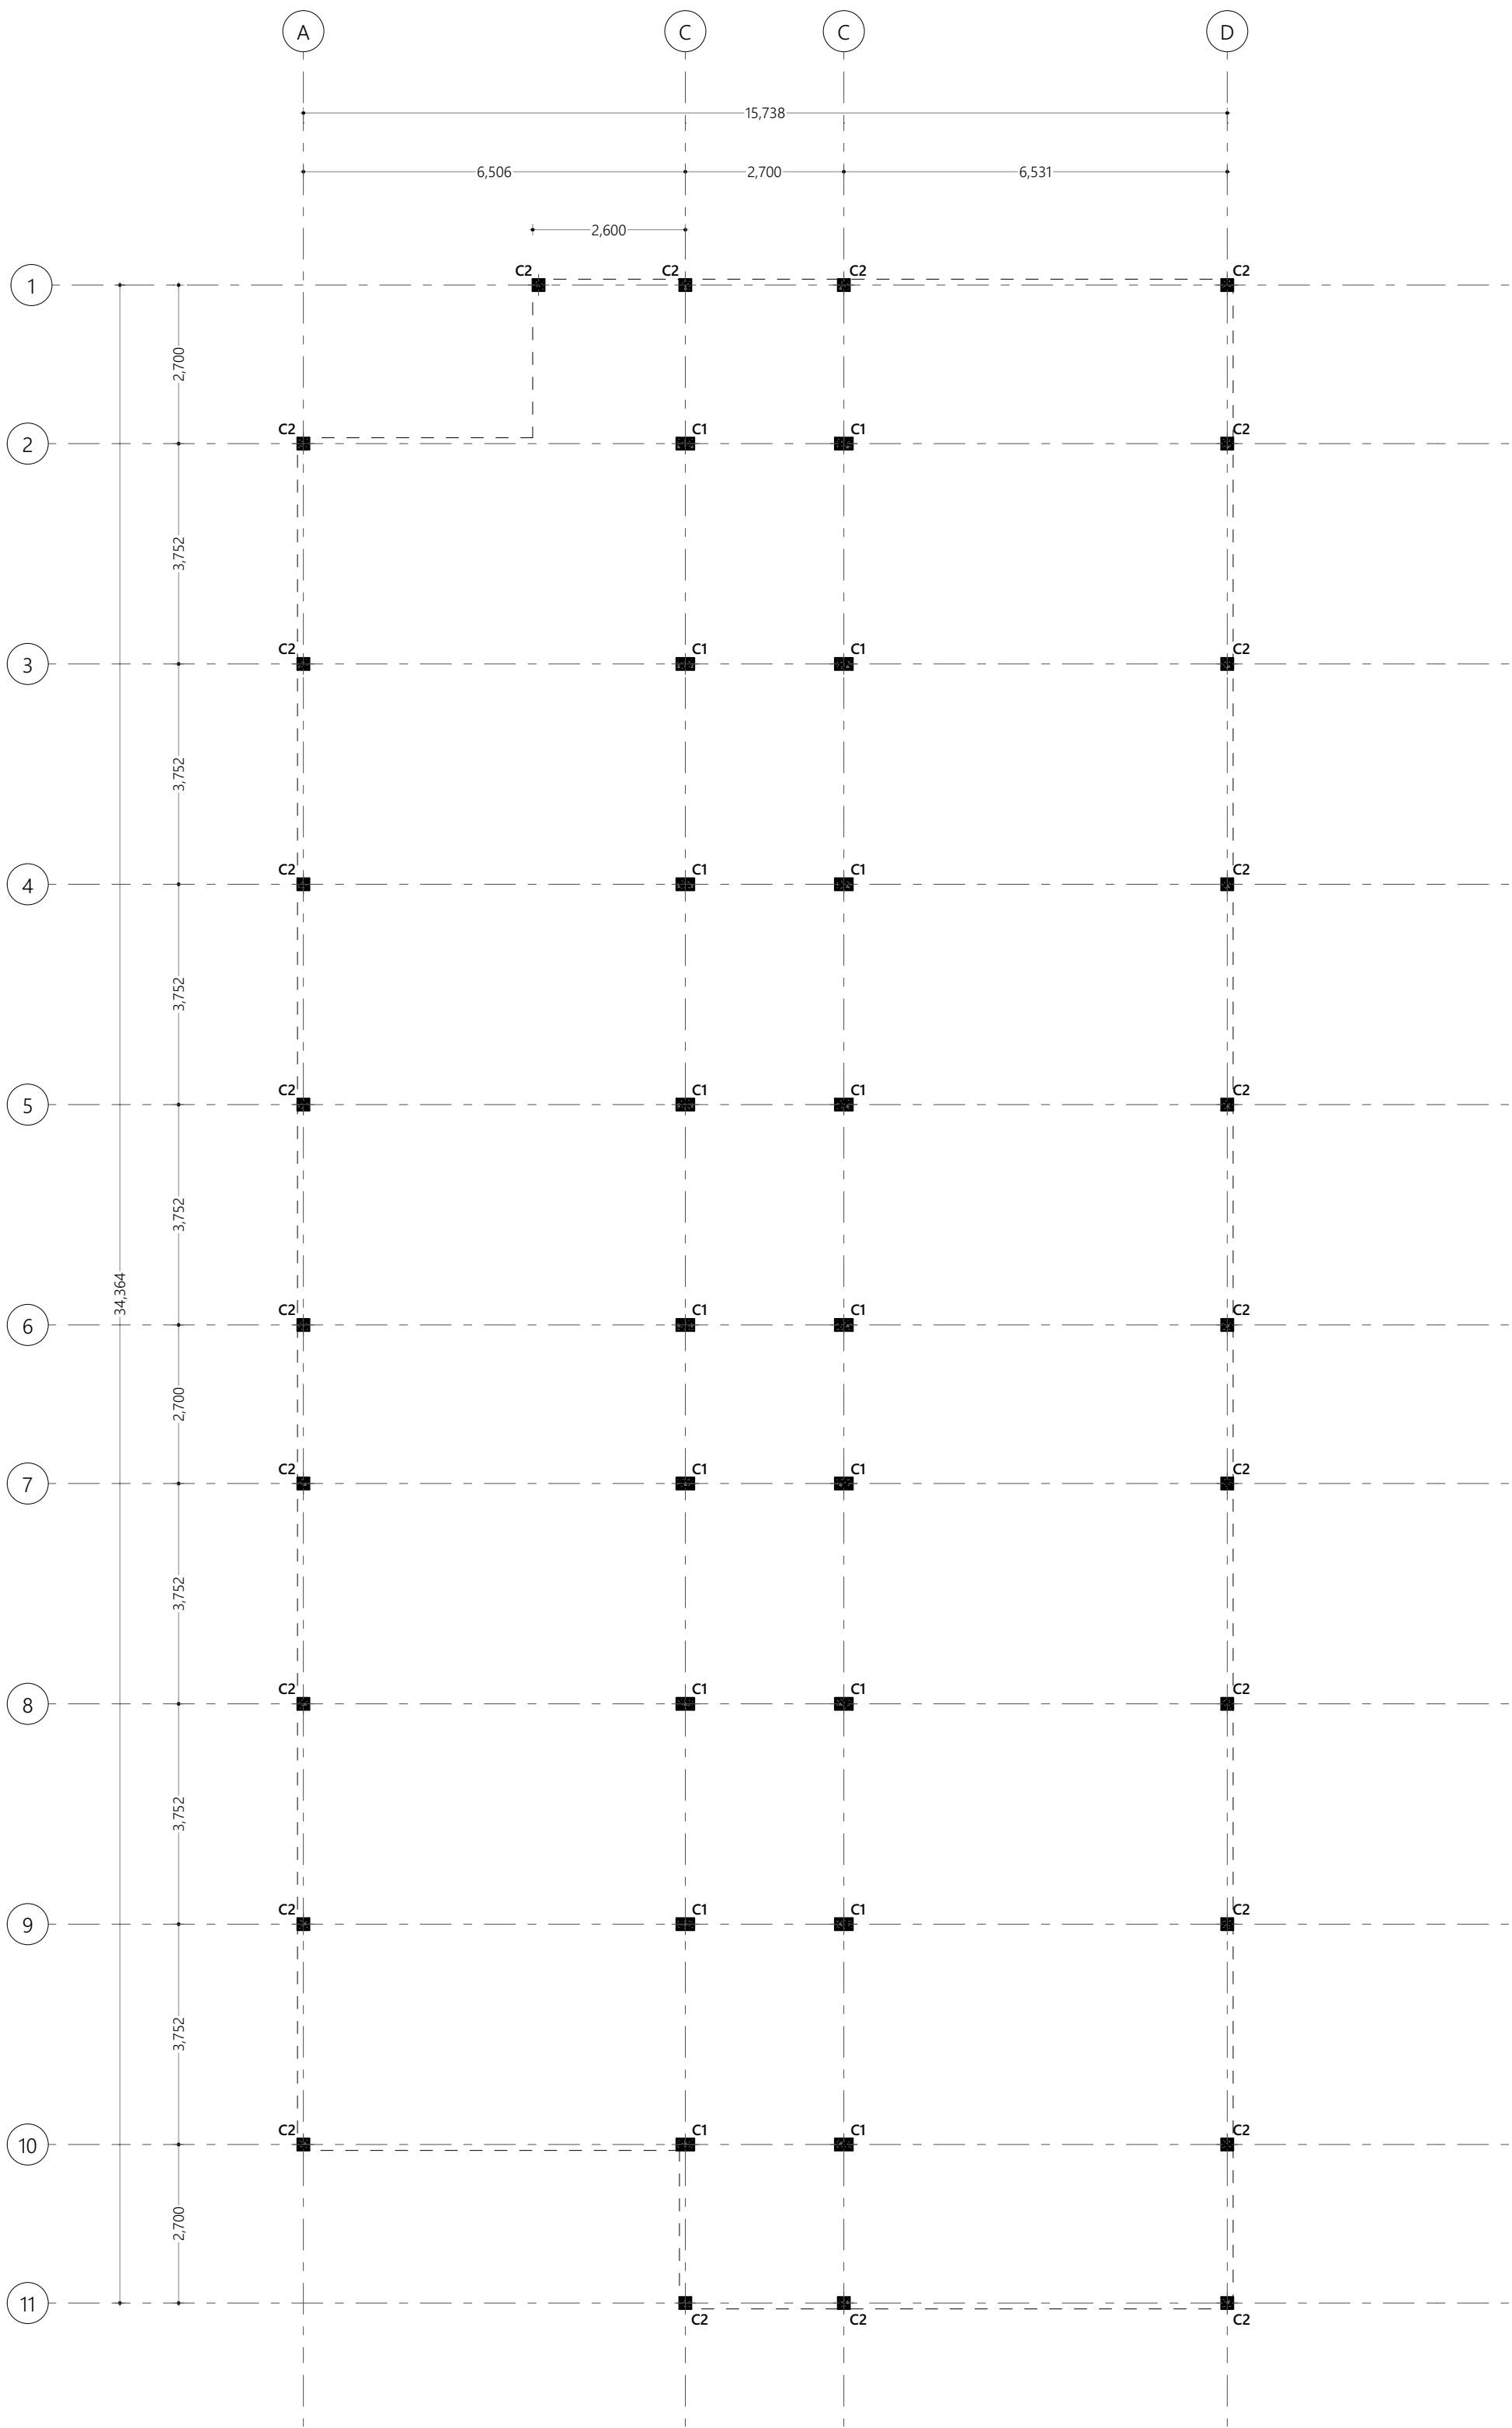

Column Layout  
1:100

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**

8/2/2023

Architect **Fathmath Ihudha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

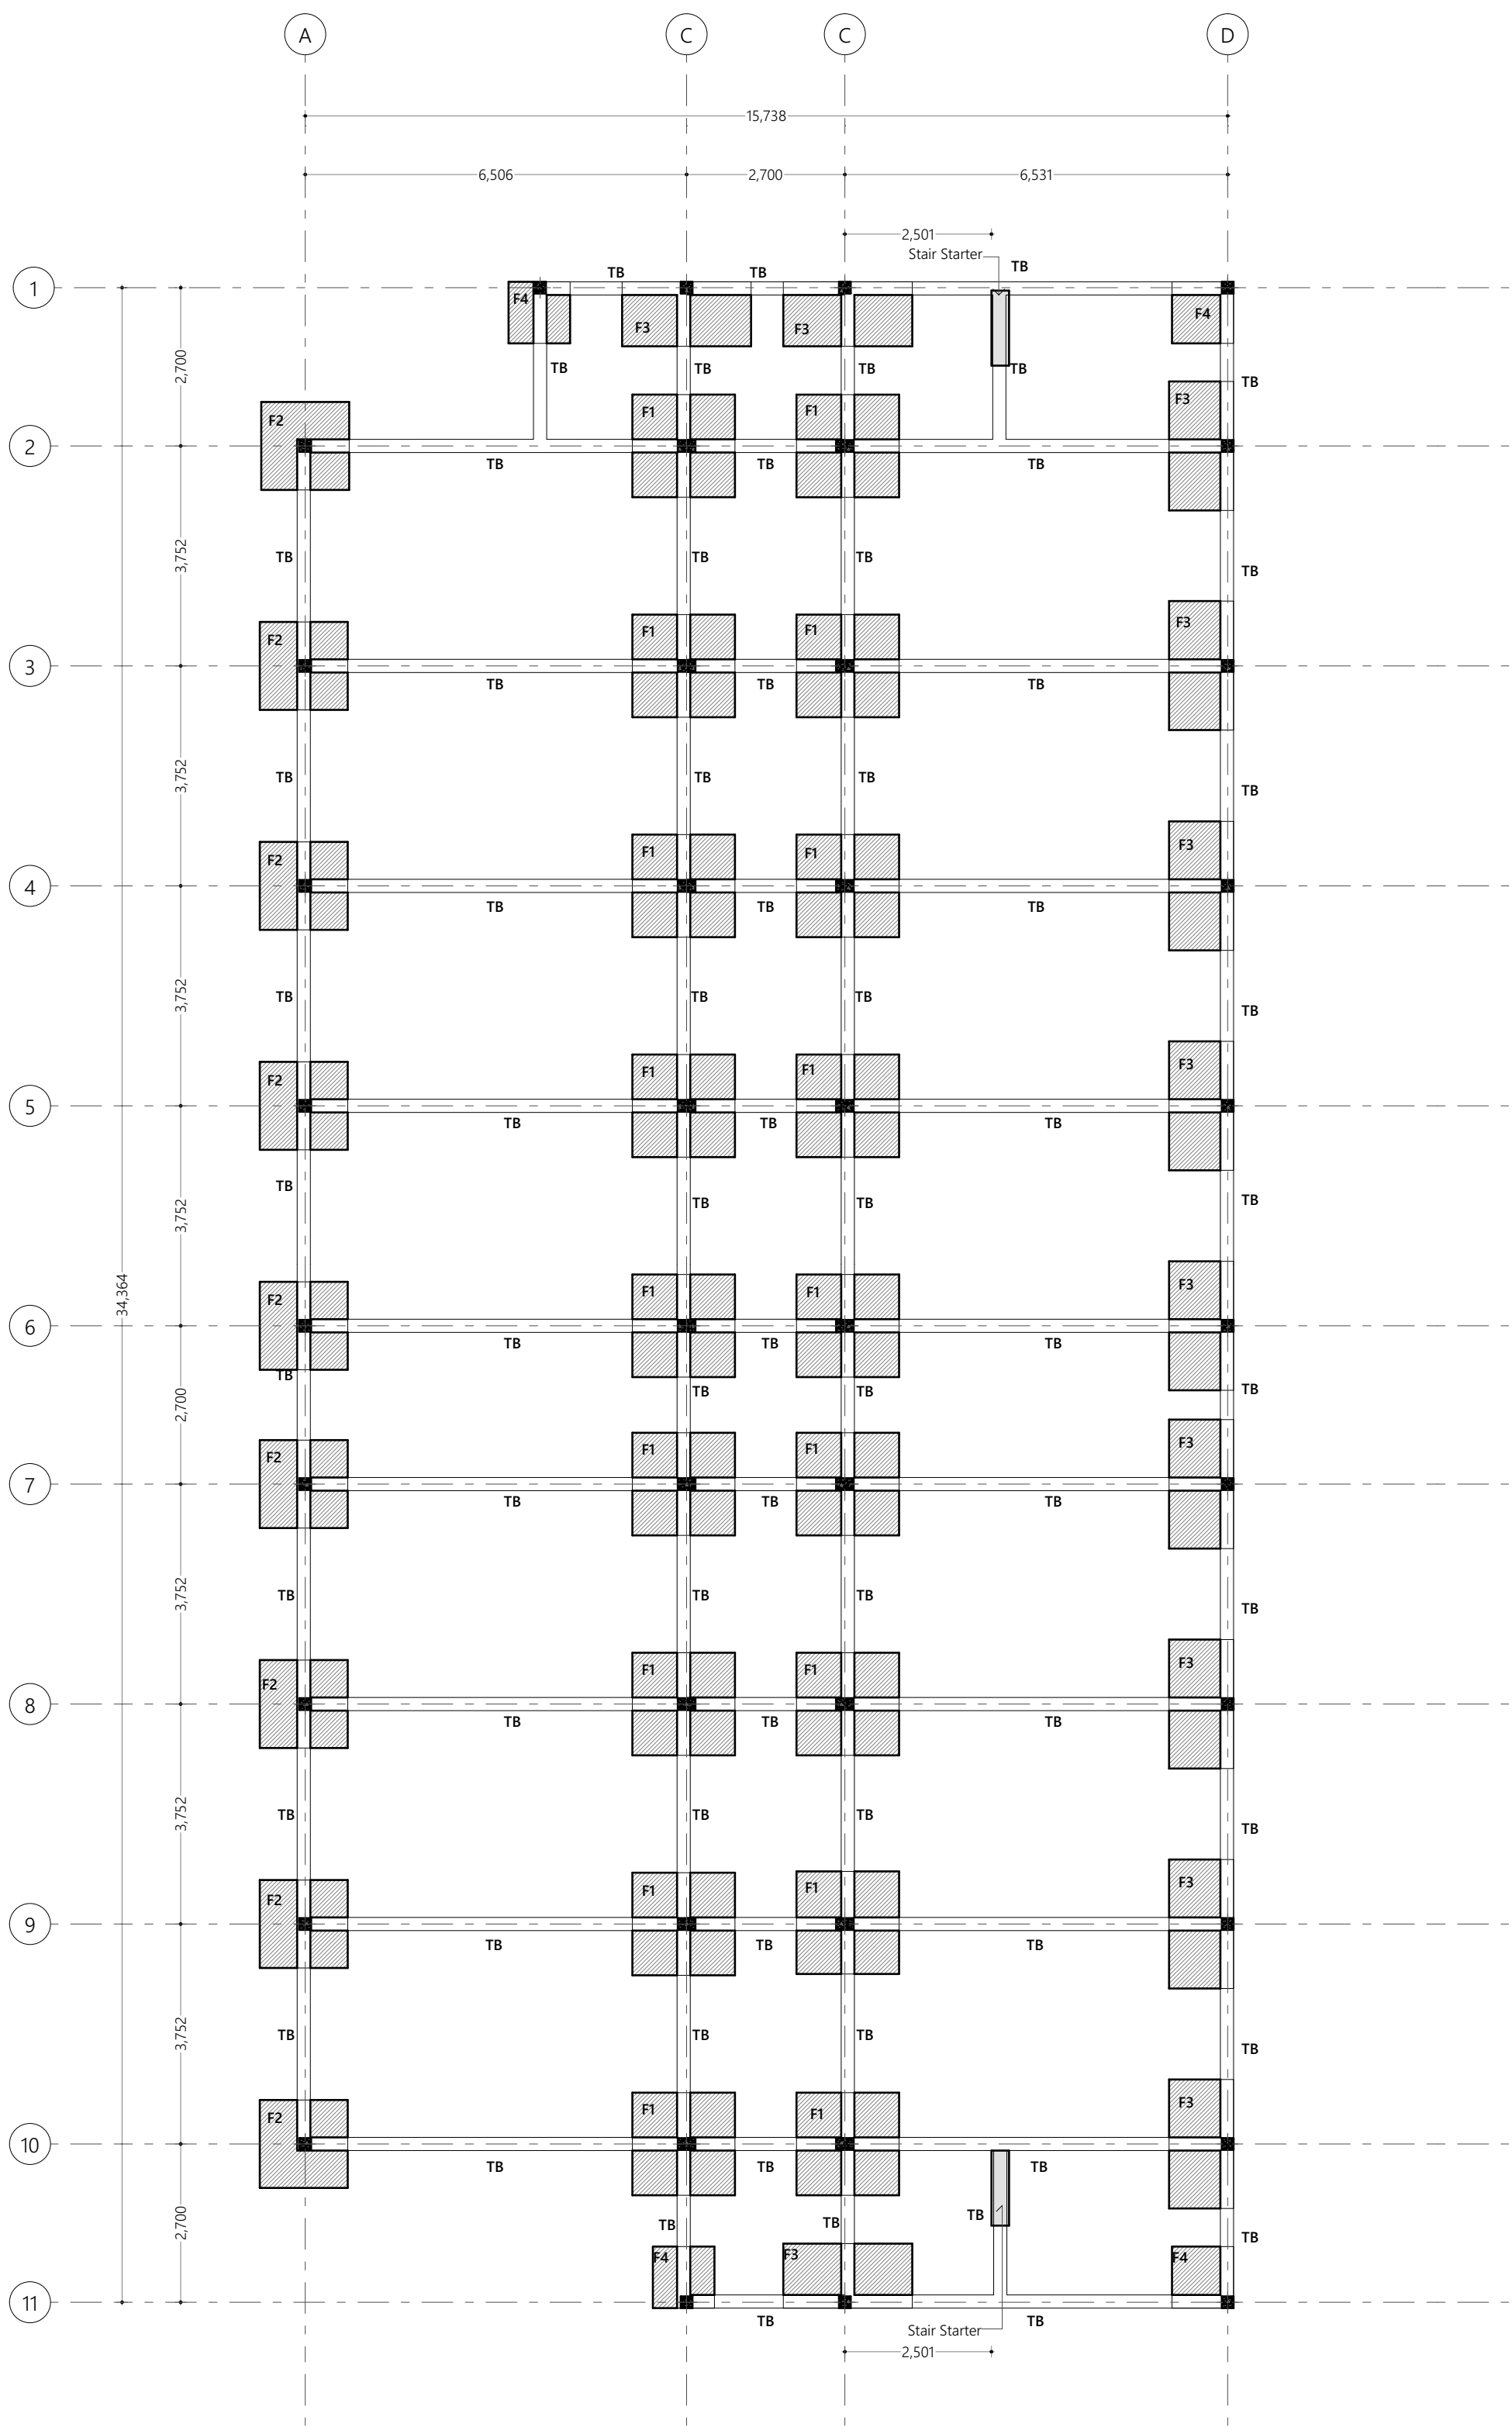

Foundation Plan  
1:100

Foundation Details:

	Dimensions	Reinforcement
F1	1750x1750x300	T12@150C/C B/W (B)
F2	1500x1500x300	T10@150C/C B/W (B)
F3	1100x2200x300	T12@100C/C B/W (B)
F4	1050x1050x300	T12@125C/C B/W (B)

Foundation Depth = 1200mm  
Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete  
Apply waterproofing to all substructure (below ground elements)


Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/2/2023  
Architect: **Fathmath Ihudha Amir**  
Engineer: **Muawiyath Abdul Sattar**  
Drawn By: **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

Rev: Page:

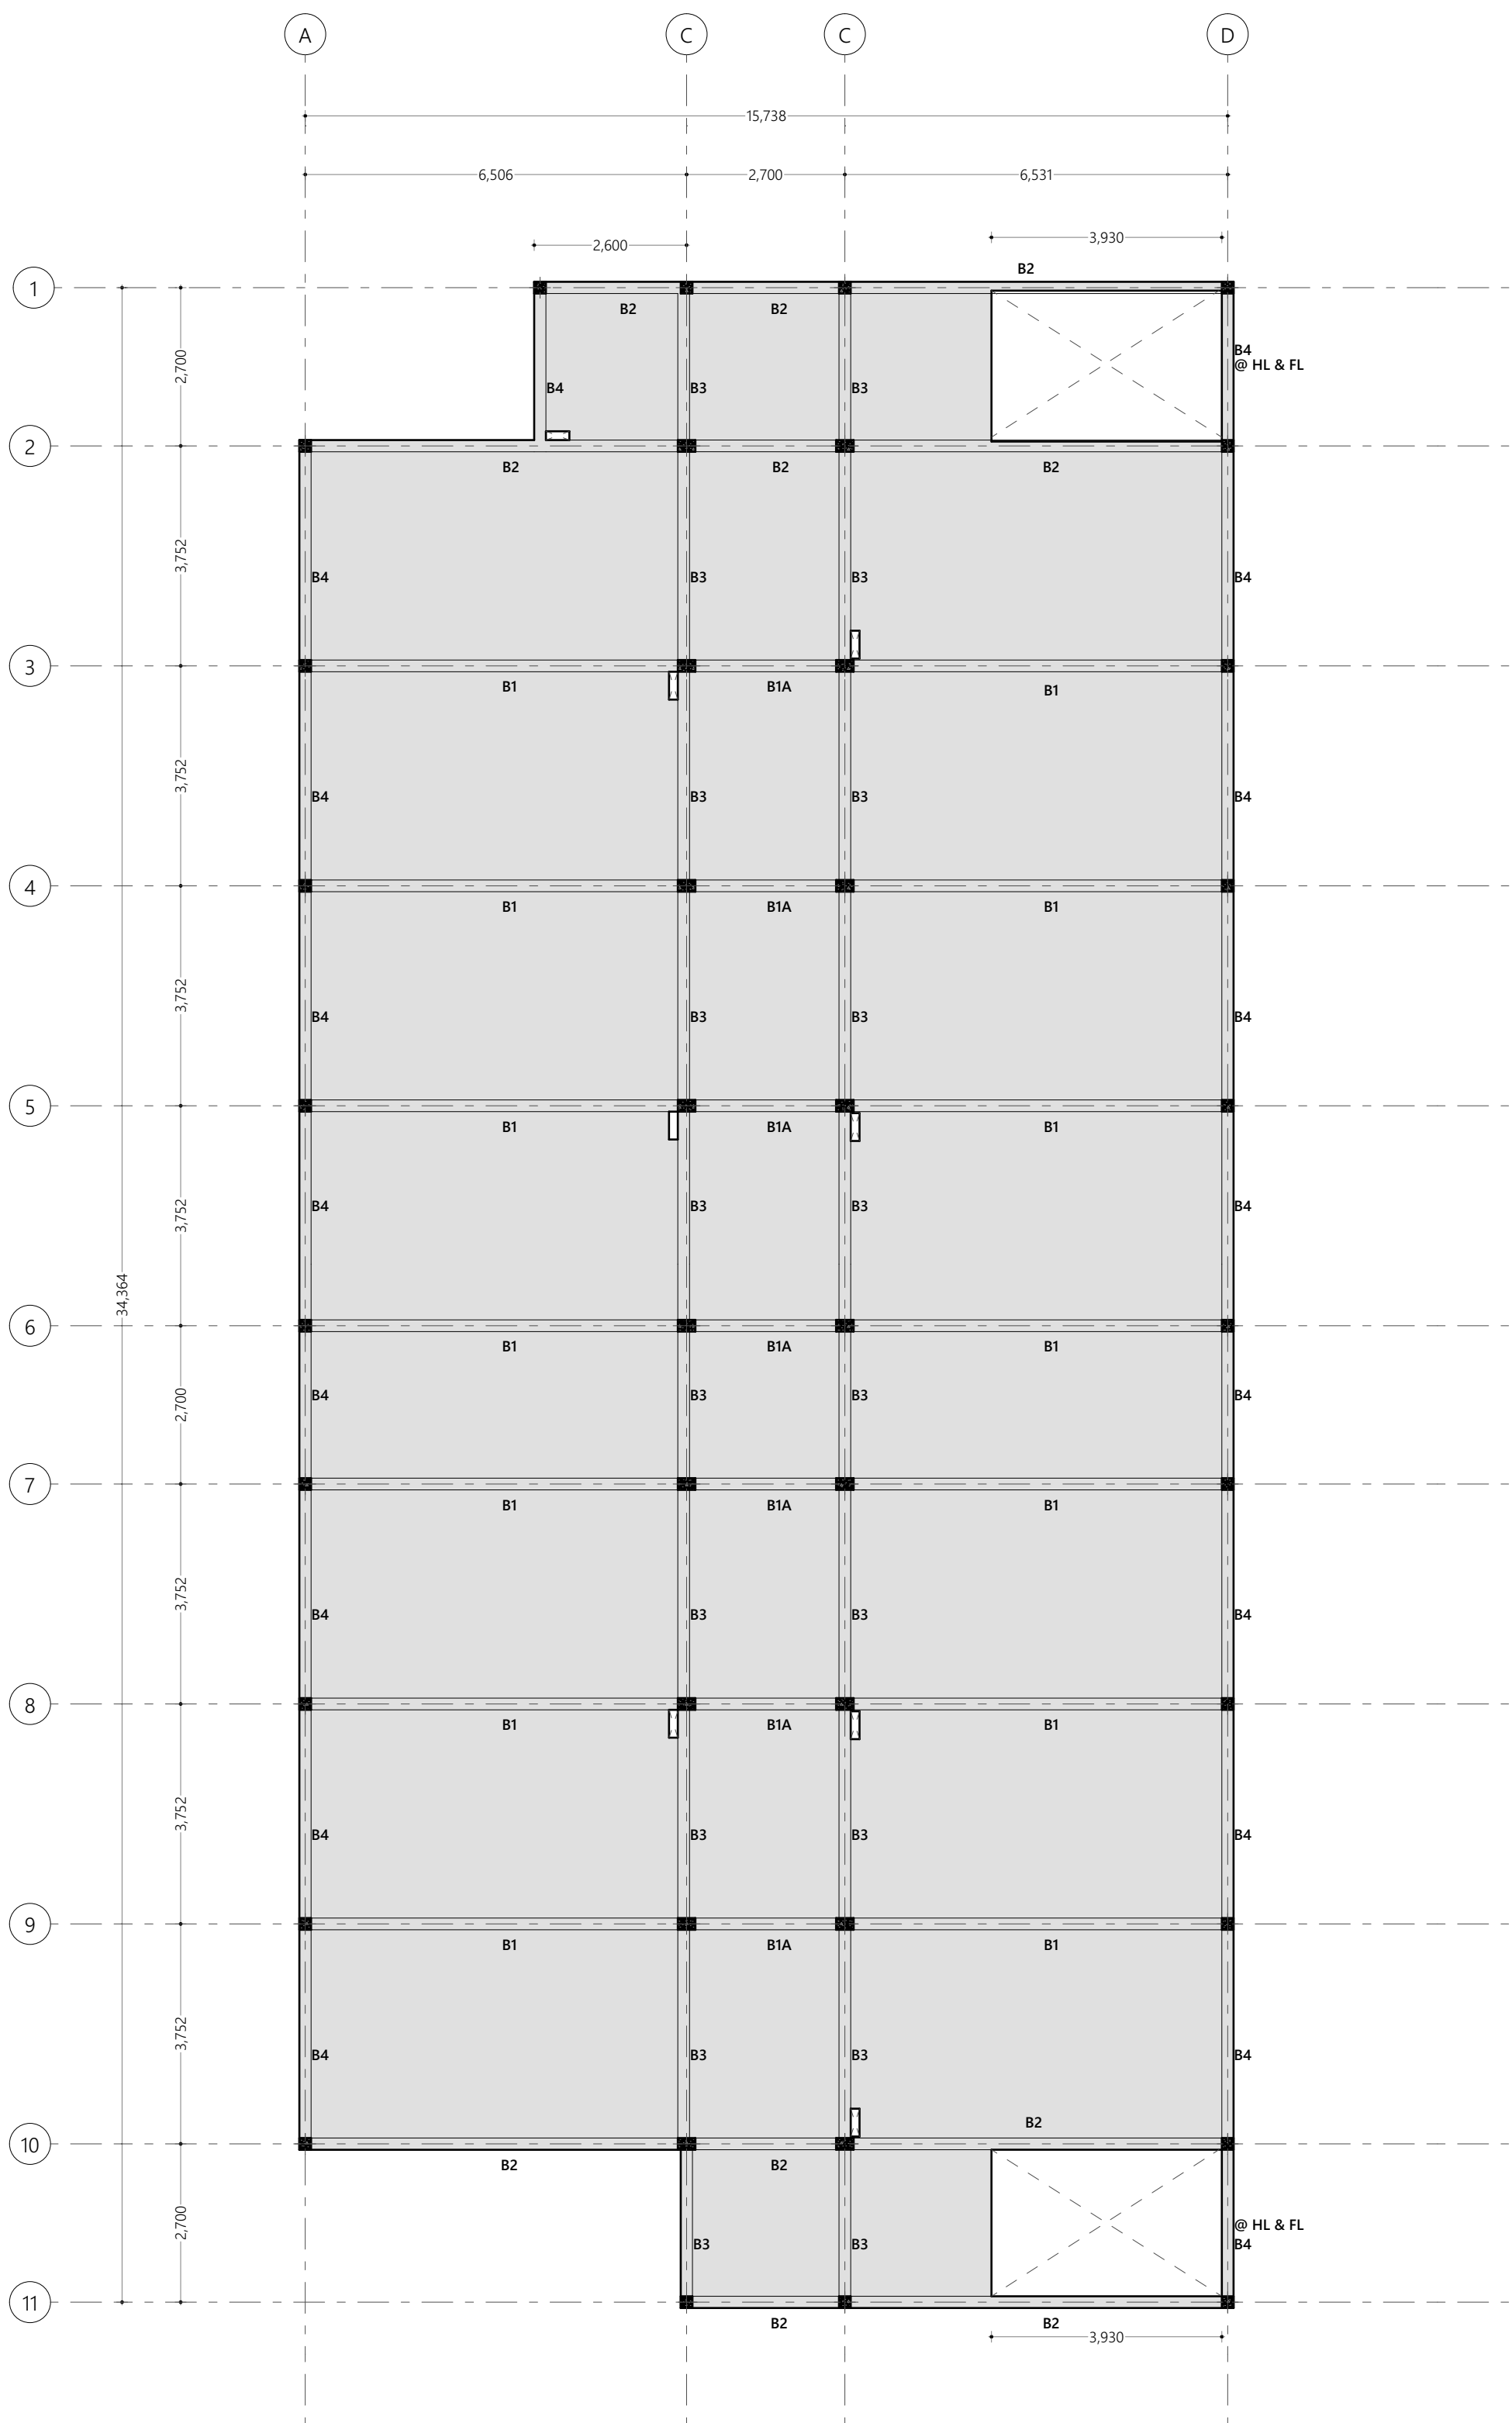

First to Terrace Floor Beam Plan  
1:100


Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/2/2023  
Architect **Fathmath Ikhutha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epochassociates.com  
W epochassociates.com A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

Rev: Page:  
**B.3.01**

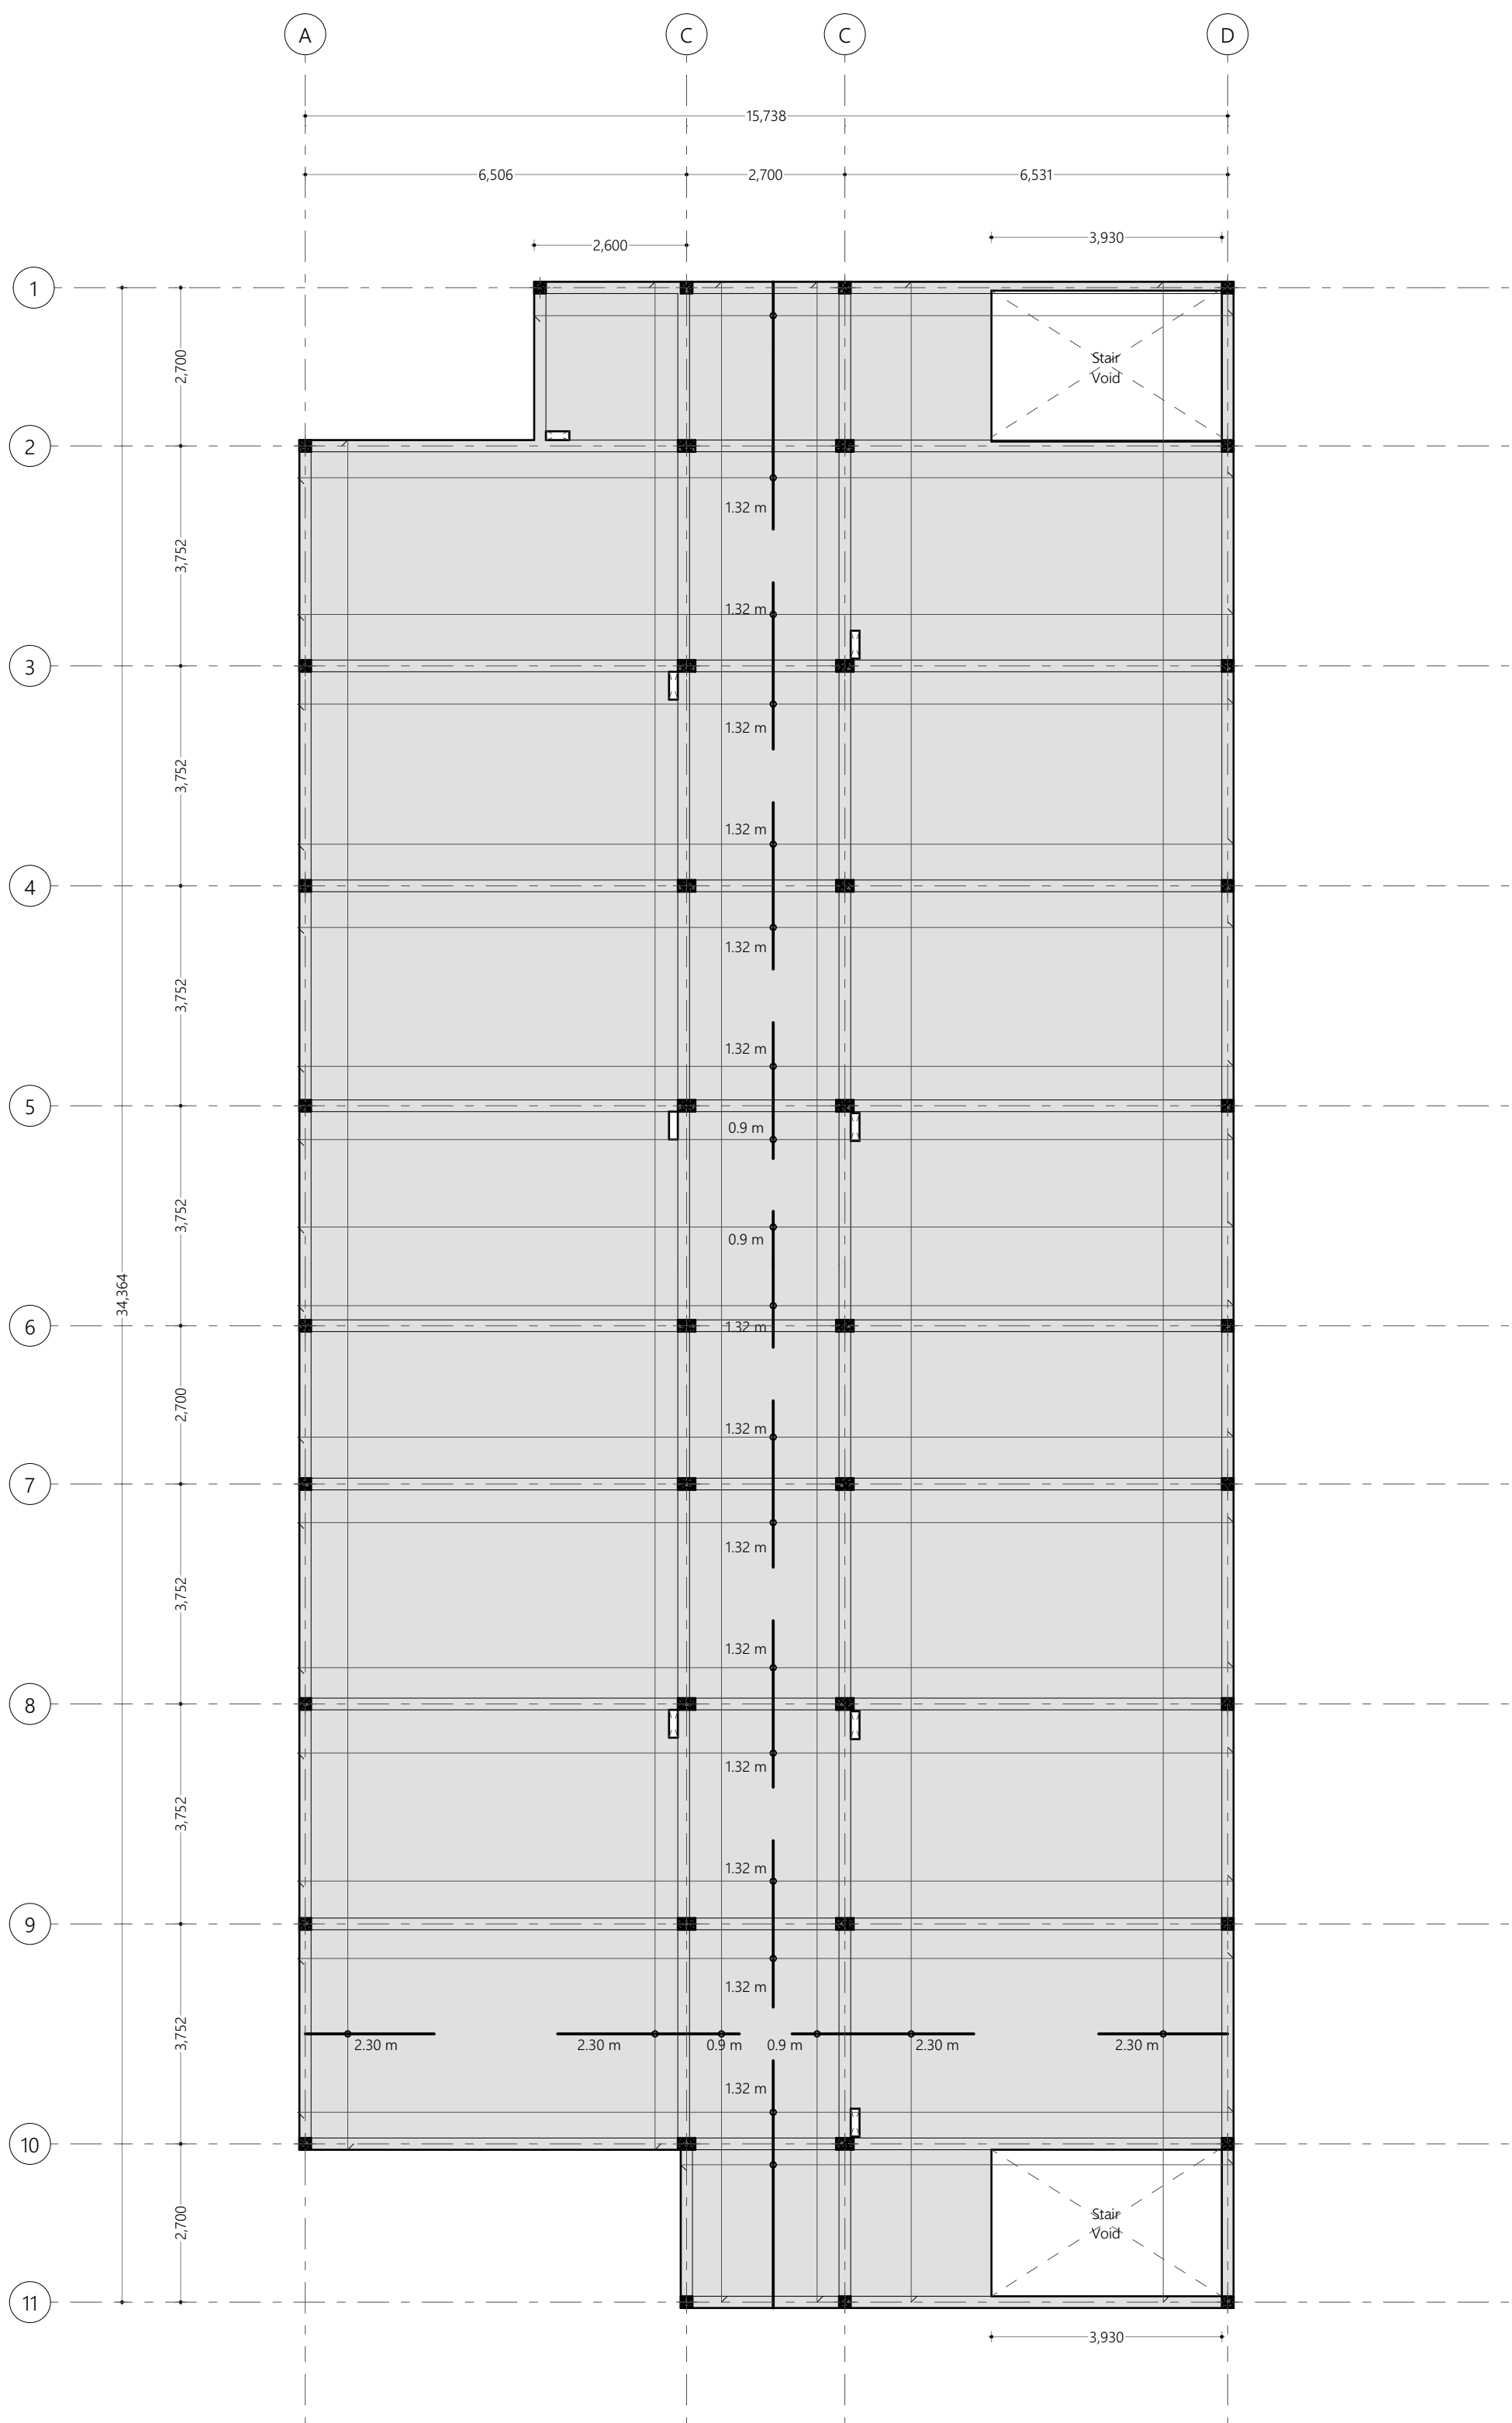

First - Terrace Floor Slab Reinforcement Plan  
1:100

Notes:

Slab thickness: 135mm

Bottom Reinf. - T10@150 C/C B/W (not shown)  
Top Reinf. - T10@150C/C (as shown, unless stated)  
Top Dist. Steel - T10@150 C/C (not shown)  
Corner Bars - 3T10@45C/C as shown  
Reinforcement discontinuous at voids

Proposed  
**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/2/2023  
Architect **Fathmath Ikhutha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**

**EPOCH**

P (+960) 33 33 528 E info@epochassociates.com  
W epochassociates.com A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

Rev: Page:  
**B.4.1**



Roof Beam and Slab Plan  
1:100

Proposed


**Centre of Excellence  
for Food Processing  
and Fisheries -  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/2/2023



Architect **Fathmath Ikhutha Amir**  
Engineer **Muawiyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**




P (+960) 33 33 528 E info@epochassociates  
W epochassociates A Giliberry West 3rd Floor,  
Hunnuheema Magu, Male', Maldives

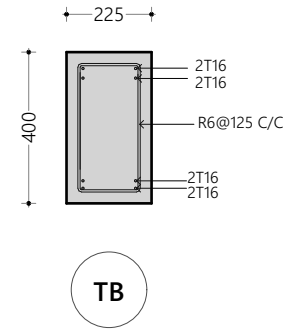

**Tie Beam Details**  
1:20



**Column Detail**  
1:20

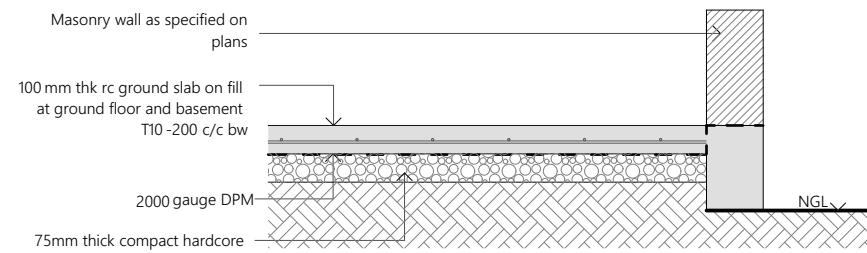


**Note :**


All cover blocks shall be casted using grade C 25 / 30 concrete with 5-10 mm aggregates

For slab, rebar spacer chairs spacing shall be minimum 1m spacing or 1 no. per 1 sqm

**Typical Ground Slab Construction Detail**  
1:20

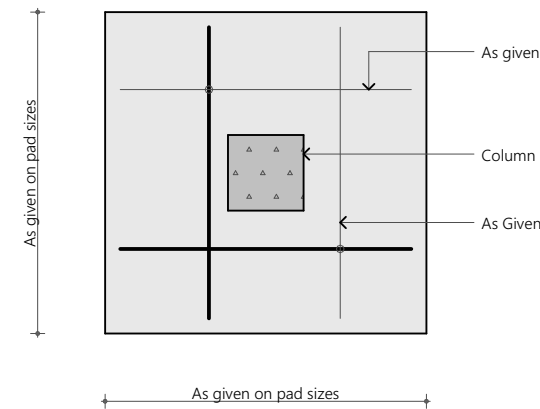

**Plan View**

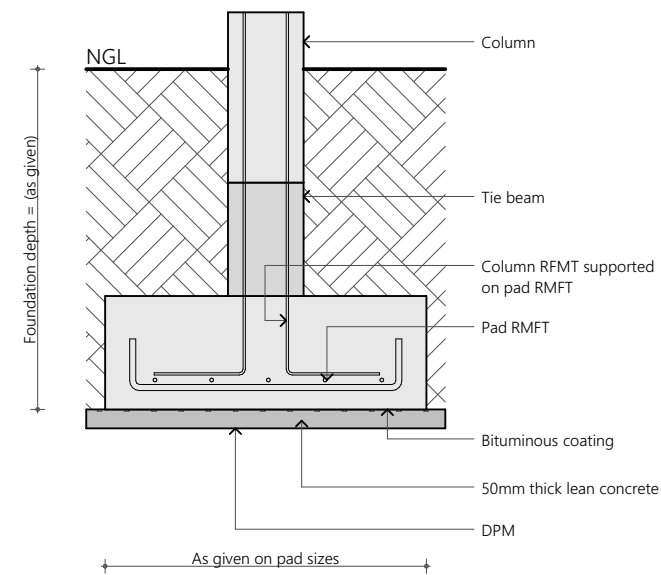

**Sectional View**

**Foundation Details:**

	Dimensions	Reinfrocement
F1	1750x1750x300	T12@150C/C B/W (B)
F2	1500x1500x300	T10@150C/C B/W (B)
F3	1100x2200x300	T12@100C/C B/W (B)
F4	1050X1050X300	T12@125C/C B/W (B)

Foundation Depth = 1200mm

Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete  
Apply waterproofing to all substructure (below ground elements)

**Notes:**

Cover to foundations = 55mm  
Cover to floor slabs =30mm  
Cover to floor beams =35mm  
Cover to columns = 40mm  
Laps = 45Dia (Dia=Bar Diameter)  
Mid bars = 0.85 x Span  
Sup bars = 1/3 x Span  
Concrete mix = 1:2:3 (C:S:A)  
Lean concrete mix = 1:2:5

**Typical Footing Detail**  
1:20

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accomodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:



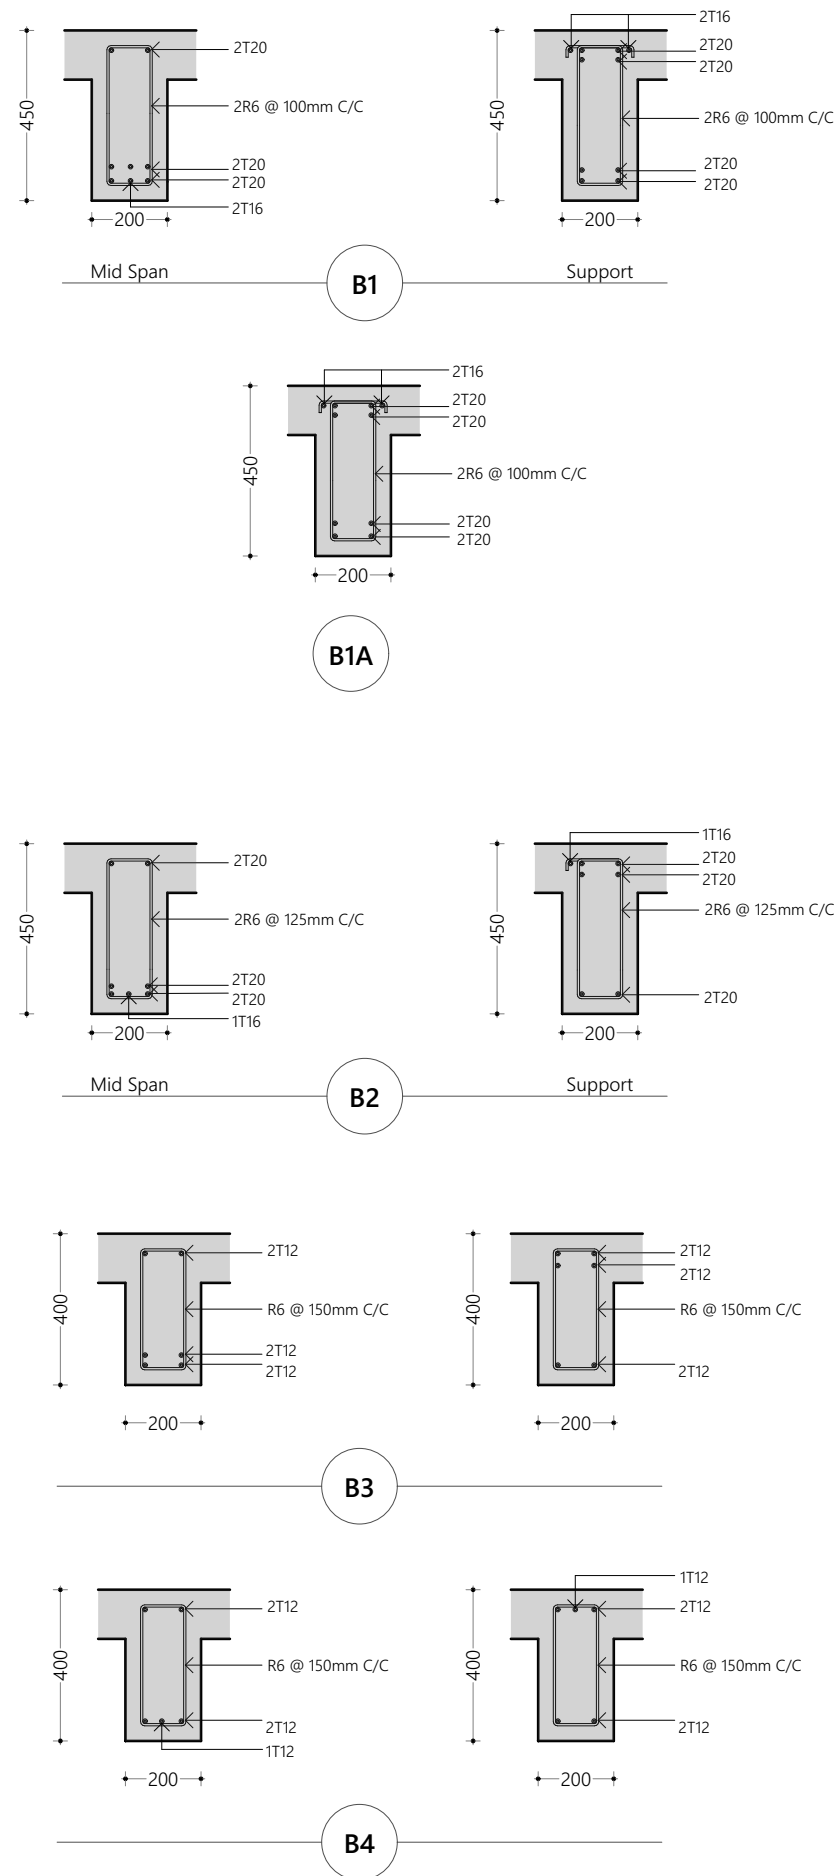

#### Notes:

Cover to foundations = 55mm  
 Cover to floor slabs = 30mm  
 Cover to floor beams = 35mm  
 Cover to columns = 40mm  
 Laps = 45Dia (Dia=Bar Diameter)  
 Mid bars = 0.85 x Span  
 Sup bars = 1/3 x Span  
 Concrete mix = 1:2:3 (C:S:A)  
 Lean concrete mix = 1:2:5

## Beam Details

1:20

Proposed

## Centre of Excellence for Food Processing and Fisheries – Accommodation Block Ha. Dhidhdhoo

Client  
**Ministry of Higher Education**  
 8/12/2021  
 Architect **Fathmath Ihudha Amir**  
 Engineer **Muaviyath Abdul Sattar**  
 Drawn By **Aishath Shadhny Afzal**




P (+960) 33 33 528 E info@epoch.associates  
 W epoch.associates A G.Rosary West 3rd Floor,  
 Husnuheena Magu, Male', Maldives


Rev:

Page:

C.1.2

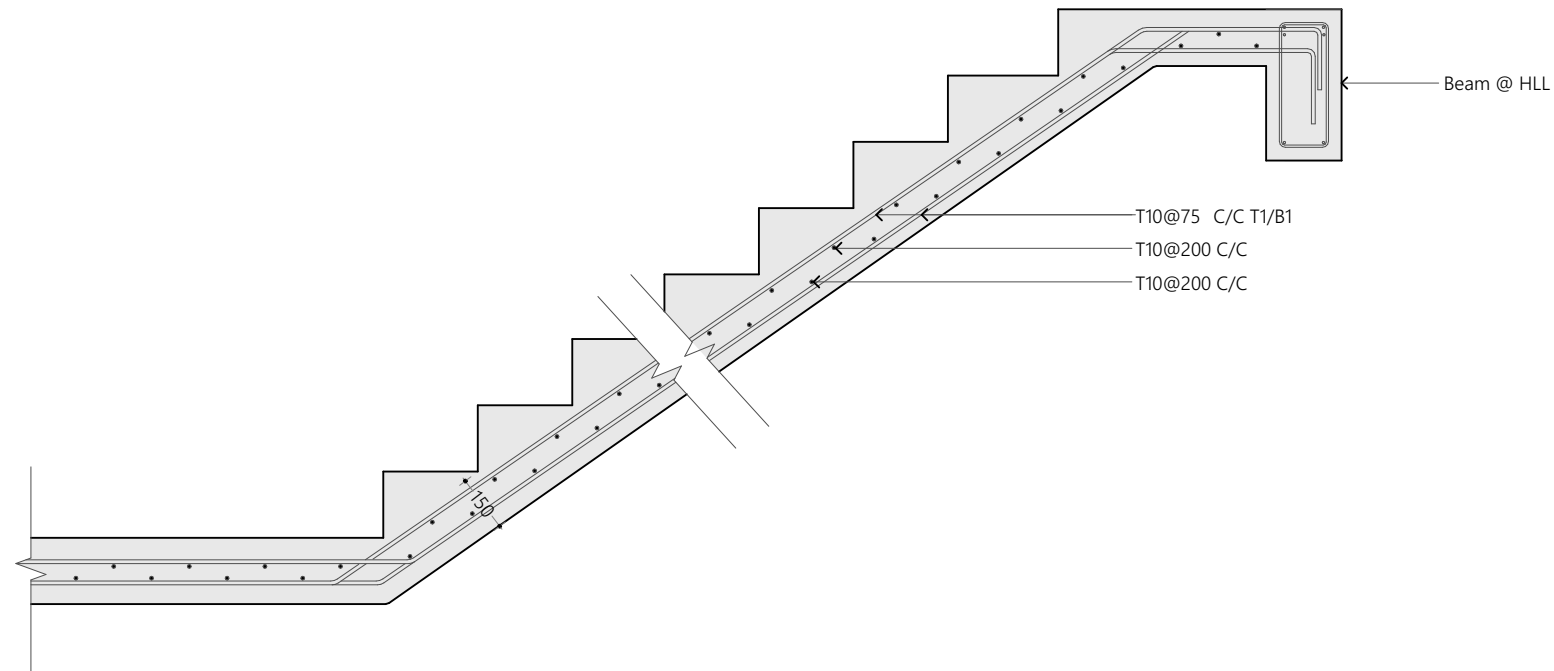

**Staircase Reinforcement Detail**  
1:20

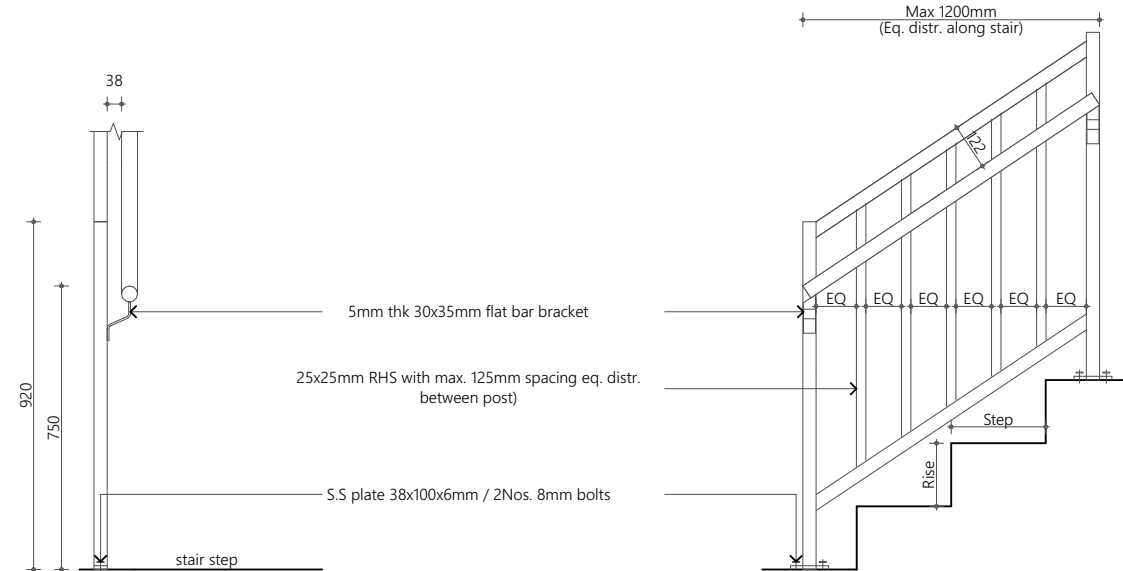

1. Post, top line and bottom line material to be 38X38mm RHS
2. Handrail material to be 38mm Ø S.S or varnished timber
3. Step: 250mm
4. Raise: 167mm

**Staircase Railing Detail**  
1:20

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**

8/12/2021


Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**




P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:

**C.2.1**

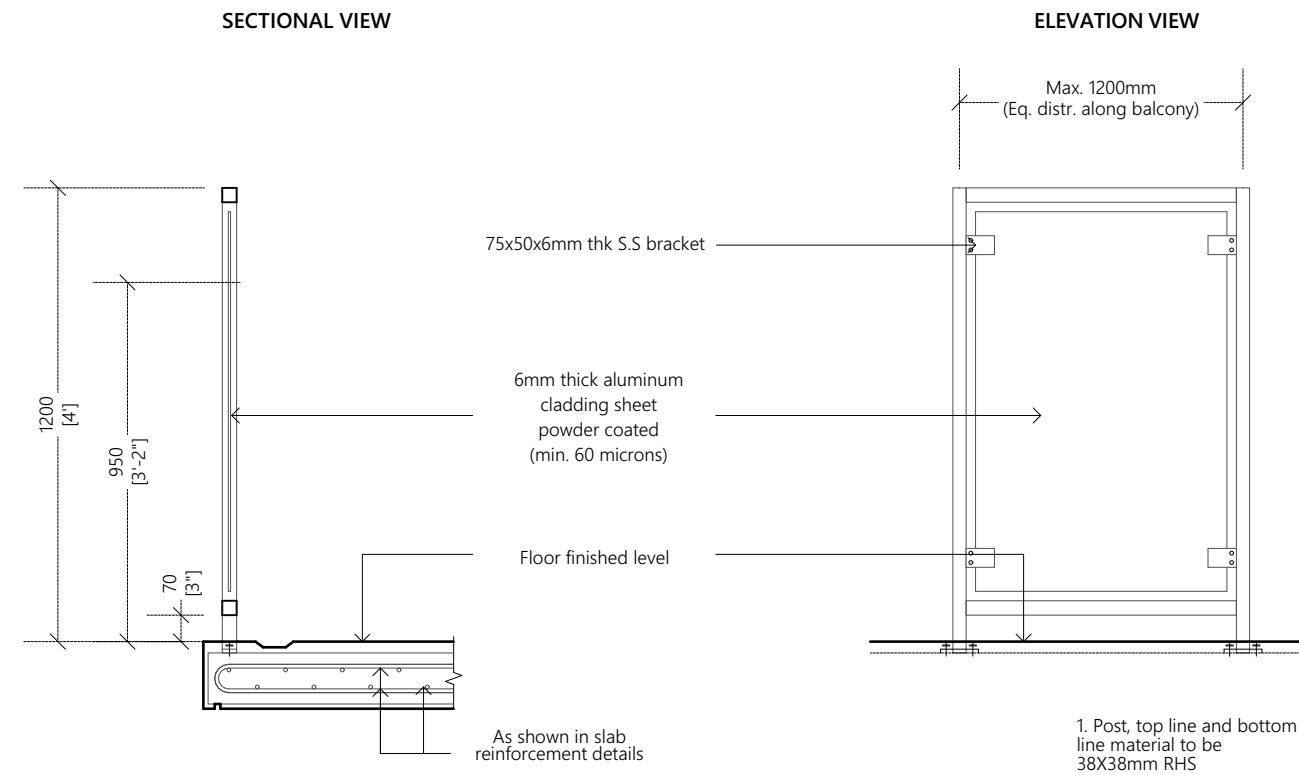

**Balcony Detail**  
1:20

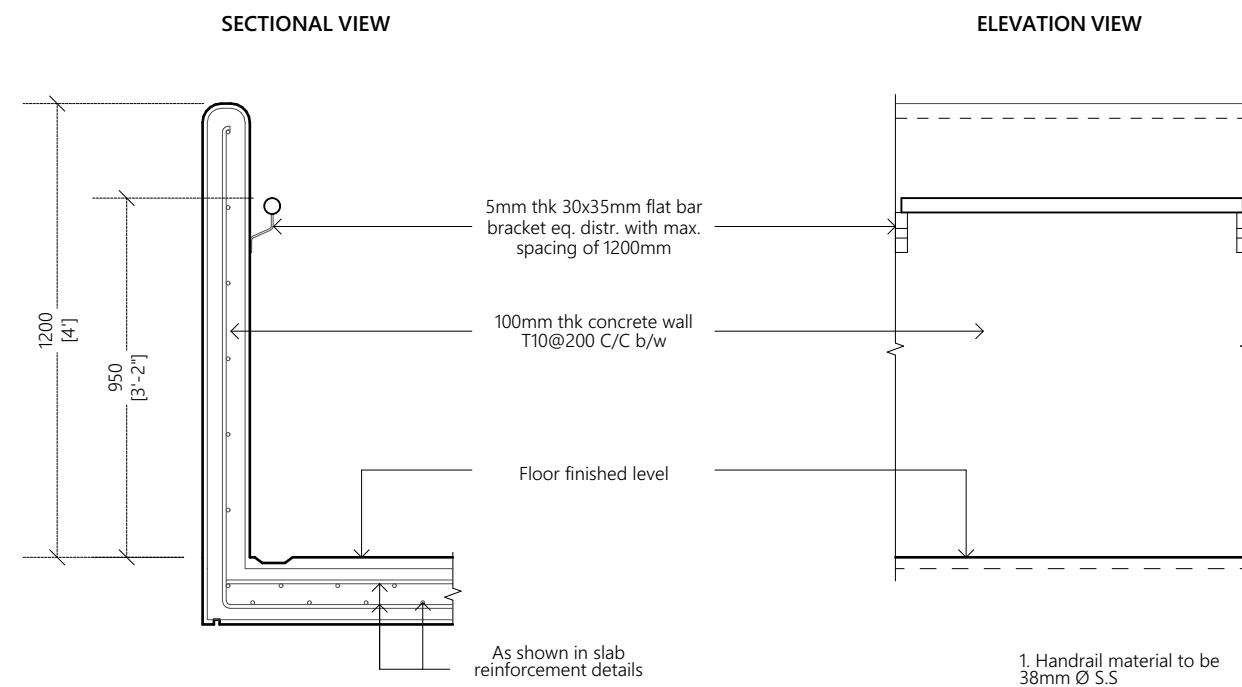

**1.2m High RC Wall Detail**  
1:20

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accommodation Block  
Ha. Dhidhdhoo**


Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**



P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:

**C.2.2**

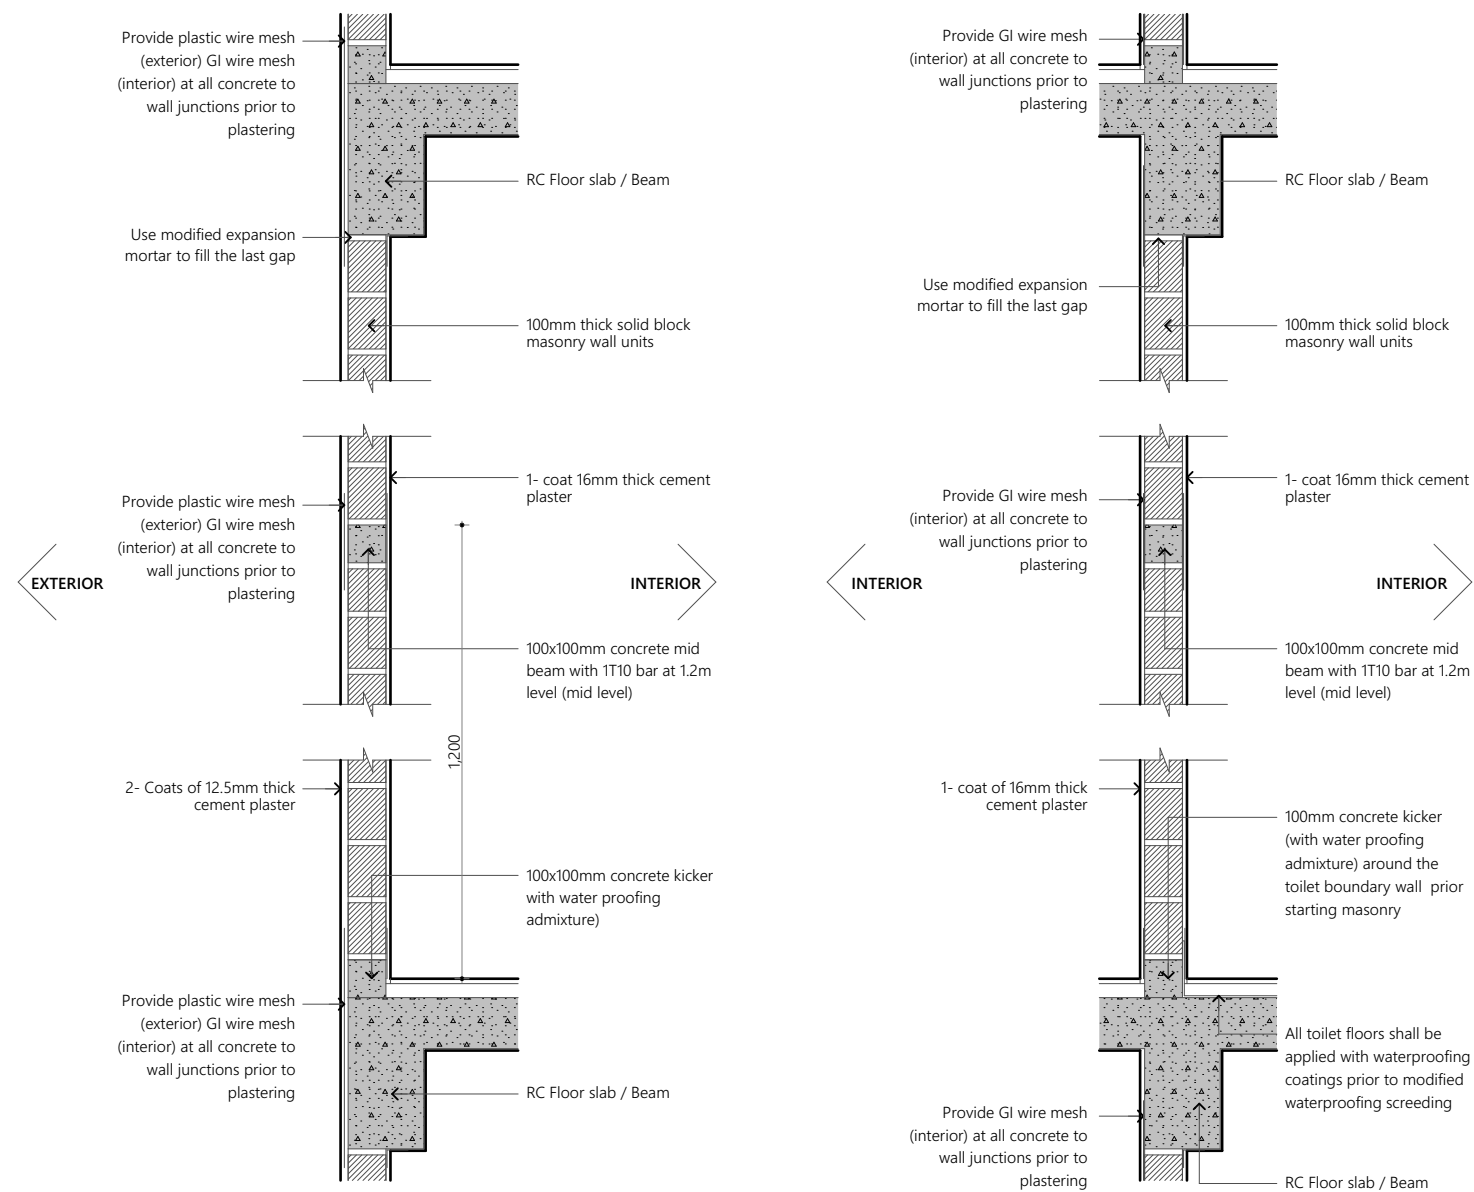

**Note:**

- \* Concrete surfaces shall be thoroughly cleaned with water & applied with mastercast 141 or equivalent bonding mortar prior to plastering.
- \* Plastering mortar mix shall be 1:4 (cement: sand) ratio.
- \* Plaster mix shall be modified using fibre wool & mastercast 141 or equivalent plasticisers as per manufacturer's specification.
- \* Height of placing blocks shall be maximum 1.2m per day.
- \* After initial coat of plastering, water curing shall be provided for minimum 3 days & after final coat water curing shall be provided for 7 days.

## Typical Wall Construction Detail

1:20

Proposed

### Centre of Excellence for Food Processing and Fisheries – Accommodation Block Ha. Dhidhdhoo

Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**




P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev:


Page:

C.2.3




LT1

LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT1 FOR WINDOWS < 1.5M




LT2

LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT2 FOR WINDOWS > 1.5M & <3.0M



LT3


LINTELS OVER ALL DOORS, WINDOWS  
(THAT DOES NOT RISE TO BEAM LEVEL)  
LT3 FOR WINDOWS > 3.0M & <6.0M



LB1

**Sill Beam Detail**  
1:20

**Lintel Beam Detail**  
1:20

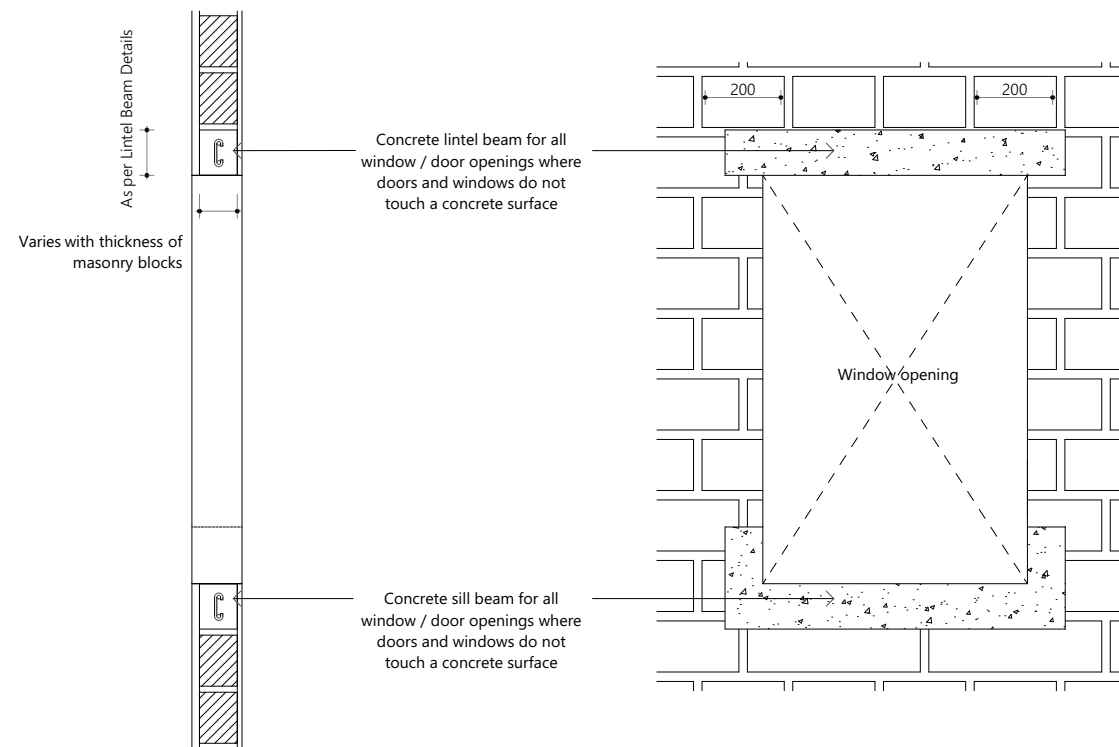

**Typical Window  
Construction Detail**

**Typical Window Construction Detail**  
1:20

Proposed

**Centre of Excellence  
for Food Processing  
and Fisheries –  
Accommodation Block  
Ha. Dhidhdhoo**

Client  
**Ministry of Higher Education**  
8/12/2021  
Architect **Fathmath Ihudha Amir**  
Engineer **Muaviyath Abdul Sattar**  
Drawn By **Aishath Shadhny Afzal**

**EPOCH**

P (+960) 33 33 528 E info@epoch.associates  
W epoch.associates A G.Rosary West 3rd Floor,  
Husnuheena Magu, Male', Maldives

Rev: Page:  
**C.2.4**