

CONSTRUCTION OF PROPOSED
03 STOREY 18 CLASSROOM BUILDING
AT SN.HITHADHOO SHARAFUDDIN SCHOOL

TENDER DOCUMENTS

Volume 2

Section VI: *Technical Specifications*

Section VII: *Drawings*

Section VIII: *Bill of Quantities*

Client: Ministry of Education

Consultant: Riyan Pvt. Ltd.

Funding Agency: Government of Maldives

TECHNICAL SPECIFICATIONS

Contents

| | |
|---|-----------|
| 1. PRELIMINARIES | 4 |
| 1.1 STANDARD AND CODES | 4 |
| 1.2 DRAWINGS AND SPECIFICATIONS | 4 |
| 1.3 TRANSPORTATION TO THE SITE | 4 |
| 1.4 SCHEDULE AND EXECUTION PLAN | 4 |
| 1.5 REPAIRING AND CORRECTION | 4 |
| 1.6 WORKMANSHIP AND MATERIALS | 4 |
| 1.7 OBVIOUS WORK | 5 |
| 1.8 PROTECTION | 5 |
| 1.9 SCAFFOLDING | 5 |
| 1.10 CONSTRUCTION MACHINERY, PLANTS AND EQUIPMENT'S | 5 |
| 1.11 SAMPLES | 5 |
| 1.12 ORDERING MATERIALS | 6 |
| 1.13 WATER AND ELECTRICITY FOR THE WORKS | 6 |
| 1.14 SITE OFFICES FOR CONTRACTOR | 6 |
| 1.15 CONTRACTOR'S SITE AREA | 7 |
| 1.16 PROGRESS MEETINGS | 7 |
| 1.17 PROGRESS PHOTOGRAPHS | 7 |
| 1.18 SETTING OUT | 7 |
| 1.19 BILLBOARDS | 8 |
| 1.20 LOADING IN EXCESS OF DESIGN LOAD | 8 |
| 1.21 BUILDING PERMIT | 8 |
| 1.22 PERMANENT DRAINAGE, ELECTRICITY AND WATER CONNECTION | 8 |
| 1.23 HANDING OVER | 8 |
| 2. SITE WORKS | 9 |
| 2.1 DEMOLITION | 9 |
| 2.2 SITE CLEARANCE | 10 |
| 2.2 EXCAVATION | 10 |
| 2.3 DE-WATERING | 11 |
| 2.4 BACKFILL | 12 |
| 3. CONCRETE WORKS | 13 |
| 3.1 GENERAL | 13 |
| 3.2 CEMENT | 13 |
| 3.3 AGGREGATE | 13 |
| 3.4 WATER | 15 |
| 3.5 HANDLING AND STORAGE OF MATERIAL | 15 |
| 3.6 MIX PROPORTION AND STRENGTH | 15 |
| 3.7 PRODUCTION OF CONCRETE | 16 |
| 3.8 TRANSPORTING AND PLACING | 17 |
| 3.9 CONCRETE CURING | 18 |
| 3.10 TEST | 18 |
| 3.11 CONCRETE | 18 |
| 3.12 DEFECTIVE CONCRETE AND FINISHES | 19 |
| 4. CONCRETE FORMWORK | 19 |
| 4.1 STRUCTURE AND MATERIAL | 19 |
| 4.2 PERFORMANCE | 20 |

| | |
|---|-----------|
| 5. STEEL REINFORCEMENT | 23 |
| 5.1 MATERIAL | 23 |
| 5.2 CLEANING | 23 |
| 5.3 BENDING AND LAPS | 23 |
| 5.4 REINFORCEMENT COVER..... | 23 |
| 5.5 PLACING | 23 |
| 6. WATER PROOFING..... | 24 |
| 6.1 DESCRIPTION OF WORK | 24 |
| 6.2 MATERIALS..... | 24 |
| 6.3 STORAGE OF MATERIALS | 24 |
| 6.4 SURFACE PREPARATION | 24 |
| 6.5 APPLICATION | 25 |
| 6.6 CURING | 25 |
| 7. EMBEDDED DAMPPROOF MEMBRANE..... | 26 |
| 7.1 GENERAL..... | 26 |
| 7.2 PRODUCTS..... | 26 |
| 7.3 WORKMANSHIP | 26 |
| 8. STRUCTURAL STEEL..... | 27 |
| 8.1 SCOPE | 27 |
| 8.2 MATERIALS..... | 27 |
| 8.3 FABRICATION | 27 |
| 8.4 BOLT..... | 28 |
| 8.5 WELDING | 29 |
| 8.6 ERECTION AND FIELD PAINTING | 30 |
| 8.8 ANCHOR BOLT..... | 31 |
| 9. MASONRY | 32 |
| 9.1 MATERIALS..... | 32 |
| 9.2 GENERAL..... | 32 |
| 9.3 BLOCKWORK | 33 |
| 10. PLASTERING..... | 35 |
| 10.1 GENERAL..... | 35 |
| 10.2 MATERIALS AND STORAGE | 35 |
| 10.3 MIXING RATIO | 35 |
| 10.4 THICKNESS OF COATING | 35 |
| 10.5 FINISH | 36 |
| 10.6 GENERAL PREPARATION | 36 |
| 10.7 EXTERNAL PLASTERING..... | 36 |
| 10.8 INTERNAL PLASTERING | 37 |
| 10.9 EXTERNAL RENDERING | 37 |
| 10.10 METAL MESH LATHING / REINFORCEMENT FOR PLASTERED/COATINGS. | 38 |
| 11. CARPENTRY AND JOINERY..... | 39 |
| 11.1 MATERIALS..... | 39 |
| 11.2 PRESERVATION OF TIMBER | 39 |
| 11.3 HARDWARE | 39 |
| 11.4 DIMENSIONS AND FINISH | 39 |
| 11.5 WORKMANSHIP | 39 |
| 12. ALUMINIUM DOORS AND WINDOWS..... | 41 |
| 12.1 ALUMINIUM DOORS AND WINDOWS..... | 41 |
| 12.2 ALUMINIUM LOUVERS | 42 |
| 12.3 TOP HUNG WINDOWS, VENTILATORS AND SIDE HUNG DOORS | 43 |
| 12.4 INSTALLATION | 43 |
| 12.5 SEALING JOINTS | 44 |

| | | |
|------------|---|-----------|
| 12.6 | GLASS INSTALLATION | 44 |
| 13. | METAL WALL PANELS..... | 45 |
| 13.1 | REFERENCES..... | 45 |
| 13.2 | SYSTEM DESCRIPTION..... | 45 |
| 13.3 | SUBMITTALS..... | 46 |
| 13.4 | QUALITY ASSURANCE | 46 |
| 13.5 | DELIVERY, STORAGE & HANDLING | 47 |
| 13.6 | PROJECT CONDITIONS | 47 |
| 13.7 | WARRANTY..... | 48 |
| | PRODUCTS | 48 |
| 13.8 | COMPOSITE FIRE RESISTIVE METAL PANELS | 48 |
| 13.9 | PRODUCT SUBSTITUTIONS | 48 |
| 13.10 | COMPOSITE METAL PANEL MATERIALS | 48 |
| 13.11 | ACCESSORIES..... | 49 |
| 13.12 | RELATED MATERIALS..... | 49 |
| 13.13 | FABRICATION..... | 49 |
| 13.14 | FINISHES | 49 |
| 13.15 | SOURCE QUALITY | 49 |
| | EXECUTION | 49 |
| 13.16 | MANUFACTURER'S INSTRUCTIONS..... | 49 |
| 13.17 | EXAMINATION | 49 |
| 13.18 | PREPARATION..... | 49 |
| 13.19 | INSTALLATION..... | 50 |
| 13.20 | FIELD QUALITY REQUIREMENTS | 50 |
| 13.21 | ADJUSTING | 50 |
| 13.22 | CLEANING..... | 50 |
| 13.23 | PROTECTION | 50 |
| 14. | ROOFING | 51 |
| 14.1 | SCOPE | 51 |
| 14.2 | ROOF CLADDING..... | 51 |
| 14.3 | PRODUCTS..... | 51 |
| 14.4 | WORKMANSHIP..... | 51 |
| 14.5 | FIXING..... | 52 |
| 14.6 | FITTINGS AND FEATURES | 52 |
| 15. | FINISHES | 54 |
| 15.1 | GENERAL..... | 54 |
| 15.2 | MANUFACTURERS | 54 |
| 15.3 | CERAMIC AND VITREOUS TILE MATERIALS | 54 |
| 15.11 | MORTAR MATERIALS..... | 57 |
| 15.12 | CEMENT COLOUR | 57 |
| 15.13 | WATERPROOFING | 58 |
| 15.14 | INSTALLATION REQUIREMENTS..... | 58 |
| 15.15 | FLOOR TILE INSTALLATION | 58 |
| 15.16 | WALL TILE INSTALLATION | 59 |
| 15.17 | GROUTING | 59 |
| 15.18 | DEFECTS IN TILES AND TILE LAYING | 59 |
| 15.19 | GUARANTEES..... | 59 |
| 16. | PAINTING | 60 |
| 16.1 | MATERIAL | 60 |
| 16.2 | DEFINITION OF TERMINOLOGY | 60 |
| 16.3 | PAINT FINISH SYMBOLS | 61 |
| 16.4 | PAINTING IN GENERAL | 61 |

1. PRELIMINARIES

1.1 Standard and Codes

- 1.1.1 The Contractor shall, perform the Works in compliance with all regulations, standard specifications or statutes of the Government of Maldives unless otherwise conform to this specification.
- 1.1.2 The current British Standard Specifications and Codes of Practice shall apply to and form part of these specifications unless otherwise specified in respect of all materials and works to which they have application.

1.2 Drawings and Specifications

- 1.2.1 Drawings and Specifications are intended to complement each other, so that if anything is shown on the Drawings, but not mentioned in the specifications or vice versa, it is to be furnished and built as though specifically set forth in all three. If any discrepancies, errors, ambiguities or omissions occur in the Drawings or Specifications, the same shall be referred to the Consultant before proceeding with the Works, and the Consultant decision on such discrepancies, errors, ambiguities or omissions shall be final.
- 1.2.2 In addition to the Drawings and Specifications attached hereto, the Consultant will during the progress of the Works furnish additional Drawings, Specifications, and instructions as may be necessary, in the opinion of the Consultant for the purpose of the proper and adequate execution and maintenance of the Works, and the Contractor shall make his work conform. Such drawings and instructions shall be deemed to be part of the Contract Documents.

1.3 Transportation to the Site

- 1.3.1 The Contractor shall provide all necessary transport, handling and storage of all materials, components and the like to their points of installation on site including transport to and from storage. The Contractor shall provide all necessary transport of labour to and from the site.

1.4 Schedule and Execution Plan

- 1.4.1 The Contractor shall prepare and submit to the Consultant for approval the construction schedule and an execution plan of temporary facilities, stockyards, etc., before the start of the Works.

1.5 Repairing and Correction

- 1.5.1 Any breakage(s) or defect(s) of existing buildings, road utilities, or part(s) of them caused by the Works including transportation for the works shall be repaired or corrected by the Contractor with his responsibility.

1.6 Workmanship and Materials

- 1.6.1 All workmanship shall be of the best standard. All goods and materials to be incorporated in the Works must be new, unused, of the most recent or current models and incorporate all recent improvements in design and materials unless provided otherwise in the contract.
- 1.6.2 The Contractor shall submit for the approval of the Consultant a list of names and addresses of the manufacturers and trade marks or names of all the various types of materials and

goods he propose to use in the Works. The list shall include reference to the specifications clause or article to which the materials and goods apply.

- 1.6.3 Materials shall be obtained from approved sources and used in accordance with the manufacturer's printed instructions. In the absence of a specification all materials shall comply with a relevant standard. The consultant shall order the removal of any materials, which he has not approved.
- 1.6.4 No orders for materials and goods shall be placed until approval has been obtained for the materials and goods from the consultant.
- 1.6.5 The Contractor shall note that it is his responsibility to include in his price for the cost of the materials and products as specified and no adjustment will be allowed should the consultant reject the alternatives.

1.7 Obvious Work

- 1.7.1 Where an item of work is obviously required for the type of work being undertaken then it shall be deemed to have been included even though the item is not specifically mentioned or shown in the Drawings or Specifications.

1.8 Protection

- 1.8.1 The Contractor shall have the Works and adjoining properties protected from inclement weather. Any loss or damage caused by weather, carelessness or lack of skill of workers, accident or otherwise shall be of such property that is affected. The Contractor shall provide all necessary dustsheets, barriers and guardrails and clear away at completion.
- 1.8.2 The work shall be suspended for such time as may be directed and/or approve by the Consultant if the specified quality of work is difficult to maintain during inclement weather.

1.9 Scaffolding

- 1.9.1 The Contractor shall provide, erect, maintain, dismantle and clear away at completion proper and adequate including that required for subcontractor and suppliers. Putlog holes shall be made good to match the adjacent surface as the scaffolding is dismantled.
- 1.9.2 The Contractor shall be responsible for all safety precautions in connection with the scaffolding including the provision of all bracing, scaffold boards, toe boards and the like and for entire sufficiency for the work.

1.10 Construction Machinery, Plants and Equipment's

- 1.10.1 All necessary construction machines shall be provided and maintained by the Contractor and shall be approved by the Consultant.
- 1.10.2 If cranes or any other type of plant which places any load on the structure are proposed, all details of such plant shall be submitted to the Consultant for approval before the work is actually commenced. If approved by the Consultant and contractually acceptable, permission may be given for the structure to be strengthened, in order to carry out loads, and the Contractor shall be responsible for any resulting additional costs.
- 1.10.3 The Contractor shall be responsible for making good to the satisfaction of the Consultant any damage to the permanent structure that may be caused by his plant and equipment.

1.11 Samples

- 1.11.1 The Contractor shall furnish for the approval with reasonable promptness, all samples as directed by the consultant. The Consultant shall check and approve such materials with reasonable promptness only for conformance with the design concept of the Works and for compliance with the information given in the Contract Document. The Work shall be in accordance with the approved samples
- 1.11.2 All samples shall be delivered to the Consultant's office with all charges in connection therewith paid by the Contractor and deemed to be included in the Contract Price.
- 1.11.3 Duplicate final approved samples, in addition to any required for the Contractor's use, shall be furnished to the Consultant, one for office use and one for the site.
- 1.11.4 Samples shall be furnished so as not to delay fabrication, allowing the consultant reasonable time for consideration of the sample submitted.
- 1.11.5 Each sample shall be properly labelled with the name and quality of the material, manufacturer's name, name of project, the contractor's name and date of submission, and the specification clause to which the sample refers.

1.12 Ordering Materials

- 1.12.1 The Bills of Quantities shall not be used as a basis for ordering materials and the Contractor is entirely responsible for assessing the quantities of materials to be ordered.
- 1.12.2 Upon receipt of the Consultant's order to commence the Works, the Contractor shall immediately place orders for all required materials and will be held responsible for any delays occurring due to late placing of such orders.
- 1.12.3 The Contractor shall pay all expenses, taxes and dues etc. incurred on the procurement of materials from abroad

1.13 Water and Electricity for the Works

- 1.13.1 The Contractor shall make all necessary arrangements and provide all water for the proper execution of the Works, together with all transport, temporary plumbing, storage and distribution, pay all charges and alter, adept and maintain temporary work as necessary and remove and make good at completion.
- 1.13.2 The Contractor shall make all necessary arrangements and provide all artificial lighting and power (maintain a generator if necessary) for the proper execution and security of the Works and its protection, with all meters, temporary wiring and fittings, pay all charges and alter adapt and maintain the temporary work as necessary and remove and make good at completion.

1.14 Site Offices for Contractor

- 1.14.1 The Contractor shall provide maintain and clear away on completion of the Contract all necessary site offices, canteens, messing and welfare facilities, temporary buildings, toilets and the like for all site staff employed by the Contractor and required by subcontractors and suppliers.
- 1.14.2 The offices shall be open at all normal working hours to receive instructions, notices and other communications.
- 1.14.3 The Contractor shall obtain the approval of the Consultant of the proposed site layout, type and drainage arrangement of all the buildings prior to erection of same. All buildings shall be supplied and maintained in good condition and of neat appearance, all maintenance to same as instructed by the Consultant shall be carried out at the Contractor's expense.

- 1.14.4 Under no circumstances shall overnight accommodation be permitted on Site except for the site watchman in carrying out his duties.

1.15 Contractor's Site Area

- 1.15.1 Throughout the period of the Contract the Contractor shall maintain the area of his operation within the limits of the Site in a clean, tidy and safe condition by arranging materials and the like in an orderly manner. All rubbish, debris, waste materials and the like shall be systematically cleared from the Site as it accumulates.
- 1.15.2 The Contractor shall take all steps necessary as directed by the Consultant to minimize or eliminate dust, noise or any other nuisance, which may occur. Plant emitting dust, smoke, excessive noise or other nuisance shall not be permitted.

1.16 Progress Meetings

- 1.16.1 During the course of the Works, progress meetings shall be held at fortnightly intervals for the purpose of co-ordinating the Contractor's works and to ensure that full compliance is maintained.
- 1.16.2 Minutes of such meetings should be recorded; copies will be distributed to all persons concerned and full effect shall be given to all instructions contained therein.
- 1.16.3 Prior to such meetings the Contractor shall give to the Consultant's Representative details in writing of that portion of the Works he proposes to construct during the coming two weeks with details of the plant and method he proposes to employ. These proposals shall be discussed at the meeting and no work based on such proposals shall proceed without the approval of the Consultant's Representative.
- 1.16.4 The Contractor shall submit all reports as instructed by the Consultant in connection with progress meetings and the day to day management of the Works.

1.17 Progress Photographs

- 1.17.1 The Contractor shall supply once a month, at the time of submitting his Interim Certificates, twelve photographs from 36 exposures showing the progress of the Works. The Consultant shall direct the times and position from which the photographs are to be taken.
- 1.17.2 The photographs shall be submitted in three copies un mounted of a size not less than 15 x 10 centimetres with the description of the viewpoint stamped in ink on the back. The negative shall have the date on it and remain the property of the Consultant and no prints from these negatives may be supplied to others unless previously authorized in writing by the Consultant.

1.18 Setting Out

- 1.18.1 The Contractor shall be responsible for accurately setting out the Works to the specified positions, dimension, levels and Building Lines and also checking the site surveys for dimensional and level accuracy and reporting any discrepancies before building work commences.
- 1.18.2 The Contractor shall provide the Consultant with all facilities, equipment and labour to enable him to check the setting out and levels of the Works at all times. The checking of any setting out point, line or level by the Consultant shall not in any way relieve the Contractor of his responsibility
- 1.18.3 All setting out points, benchmarks, site rails, pegs and other survey points shall be clearly marked and protected from damage or disturbance during the execution of the Works

1.19 Billboards

1.19.1 The Contractor shall provide and maintain two billboards for the Site each consisting of a plastic board panel of size not more than 2.4m x1.2m (2.88m²) supported 2.5m above the ground with steel angle framing or similar material and fixed in concrete foundations.

1.19.2 Each board shall have the following written in both Dhivehi and English (letter height not to exceed 100mm) by a skilled sign writer:

The name of Project

The name of Employer

The name and address of Consultant

The name and address of Contractor

1.19.3 A scaled layout shall be prepared and submitted for the Consultant's approval before fabrication.

1.19.4 No advertising material other than the above will be permitted.

1.19.5 The location and layout of Sub-Contractors or Manufacturer's billboards, if allowed, must be submitted for the Consultant's approval.

1.20 Loading in Excess of Design Load

1.20.1 No loading in excess of the design loading shall be placed on any portion of the structure without the written permission of the Consultant

1.20.2 If such permission is granted, all beams or other members of the structure which are subjected to loading other than the designed loading shall be strengthened and supported to the satisfaction of the Consultant, and the Contractor shall be responsible for any resulting additional costs

1.20.3 The Contractor shall be responsible for making good to the satisfaction of the Consultant any damage to the permanent structure that may be caused by such excess loading.

1.21 Building Permit

1.21.1 The Contractor shall allow for obtaining the building permit and for paying all fees in connection therewith.

1.22 Permanent Drainage, Electricity and Water connection

1.22.1 The Contractor shall allow for arranging and obtaining the permanent drainage, water and electricity connections to the proposed development and he shall be responsible for making all payments in connection therewith.

1.23 Handing Over

1.23.1 Prior to handing over the proposed development the Contractor shall gain the approvals and respective Completion Certificates from all the local government authorities and the like that the work has been completed in accordance with their requirements. Any payment in connection therewith shall be paid by the Contractor.

2. SITE WORKS

2.1 Demolition

- 2.1.1 Demolition includes the complete demolition including grubbing up of foundations and the proper termination of all services as required by the Drawings including the removal and disposal of all demolished materials. The demolition work shall be executed in a systematic manner.
- 2.1.2 Demolition operations and the removal of debris shall be carried out to ensure minimum interference with roads, streets, footpaths and other adjacent occupied or used facilities.
- 2.1.3 Damage caused to adjacent facilities by demolition operations shall be repaired by the Contractor at his own expense. The Contractor shall arrange and pay for the disconnecting, removing and capping of utility services, notify the affected utility agency in advance and obtain written approval before commencing work.
- 2.1.4 Before commencement of work, submit a method statement to the Consultant as to the proposed method and sequence of demolition of the building and a safety plan which shall cover the risk assessment and safety measures for such method statement. The Consultant reserves the right to prohibit any method of execution of the Works which he regards as unsafe.
- 2.1.5 Drawing information, particularly for unconventional layouts and special structures, will be made available to the Contractor if possible. The Contractor shall state in his method statement if it is based on such drawings. In the absence of drawings, the Consultant may require a detailed structural survey to be carried out and endorsed by a Registered Structural Engineer (or equivalent) to define the existing structure and the appropriate method and sequence of demolition.
- 2.1.6 No work on site shall be allowed to commence until the proposed method statement has been accepted and all precautionary measures, hoardings, covered walkways, and other requirements are in place.

2.2 Site Clearance

The Site shall be cleared of all vegetation, rock, boulders, etc. and surface soil shall be removed as directed by the Consultant. The trees which are to be retained shall be protected from damage

Spreading, levelling and consolidating on site where required, shall be made with suitable surplus excavated material obtained from the Site. Other soils used for filling shall be approved by the Consultant

The Contractor shall dispose all unsuitable and surplus excavated material

The Contractor shall tidy up and leave the Site in a clean and sanitary condition at all times during the execution of the Works.

2.2 Excavation

- 2.2.1 Excavation shall be performed to the required depth as shown in the Drawings.
- 2.2.2 A survey of the existing site shall be made and the results of same submitted to the Consultant before commencement of the work
- 2.2.3 Excavation area shall be protected from any water flowing in. Sides of excavations shall be shored or inclined to retain excavation unless otherwise specified
- 2.2.4 Excavation near adjoining structures shall be executed with care so as not to damage those structures.
- 2.2.5 The Contractor shall take all necessary precautions during the excavation for the Works particularly those excavation which are adjoining existing buildings and shall protect such buildings from the damage or collapse by means of temporary or permanent shoring, strutting, sheet piling or underpinning or excavation in short lengths and/or other methods as he deems fit and also he shall properly support all foundations, trenches, walls, floors, etc. affecting the safety of the adjoining existing buildings.
- 2.2.6 The Contractor shall alter, adopt and maintain all such works described above for the whole period of the Contract and shall finally clear away and make good all damages done.
- 2.2.7 The construction and efficiency of the shoring, underpinning, strutting and the like for the purpose for which it is erected shall be the responsibility of the Contractor, should any subsidence or any other damage occur due to the inefficiency of the shoring, underpinning, strutting and the like or any other support provided, the damage shall be made good by the Contractor at his own expense and responsibility.
- 2.2.8 The shoring, strutting, piling and the like, shall be executed in such a manner as to cause as little inconvenience as possible to adjoining owners or the public and the Contractor shall be responsible for negotiating with the adjoining owners the means to safeguard their property and for the use of any portion of their land for the purpose of executing the excavations and no claims submitted on this ground will be entertained.
- 2.2.9 The Contractor shall be held solely responsible for the safety of the adjoining existing buildings, the sufficiency of all temporary or permanent shoring, underpinning, piling, and the like.
- 2.2.10 The Contractor shall keep the Consultant informed as to manner in which he intends to proceed with the execution of the excavations and obtain his approval. Such approval if given shall not absolve the Contractor of his responsibility.
- 2.2.11 Excavation shall extend a sufficient distance from walls, footings, etc. to allow space for placing and removing shoring and formwork, for performing all work in the excavations and for the inspection of same.

- 2.2.12 Excavated material shall be deposited within specified areas as directed unless otherwise specified.
- 2.2.13 The Contractor is deemed to have inspected the site and to leave ascertained for himself as to the nature of the soil, etc. and also the areas where to collect and stack the materials for which necessary site clearance shall have to be made at his own cost.
- 2.2.14 Stacking or excavated materials shall be done at places approved by the Consultant and he shall have recorded the original ground levels of such places jointly with the Contractor before commencement of stacking operation.
- 2.2.15 Extra excavation and allied lead/lift required specifically for providing working space to workmen or shuttering to walls of basement etc. shall be measured for payment, no extra claim being allowed for such work incidental to development and executions of allied jobs. Only authorized excavation approved by the Consultant shall be paid for
- 2.2.16 Sufficient clear working space shall be left all around excavated area. The disposal of waste/unserviceable materials may be in filling and/or in embankment according to nature of place of disposal. The appropriate specifications for filling and/or embankment shall apply
- 2.2.17 All foundation trenches shall be excavated to the full widths and depths shown on the drawings or to such greater or smaller depths as may be found necessary in the opinion of the Consultant and so instructed by his representative.
- 2.2.18 Should any excavation be taken down below the specified levels, the Contractor shall fill in such excavation at his own cost with cement concrete specified for foundations, well rammed in position until it is brought up to the level.
- 2.2.19 The Contractor shall notify to the Consultant when the excavation is completed and no concrete or masonry shall be laid until the Consultant has inspected of the soil for each individual footing.
- 2.2.20 All foundation pits shall be refilled to the original surface of the ground with approved materials, which shall be well consolidated as instructed by the Consultant.
- 2.2.21 The Contractor shall erect temporary barricades around the excavations and if necessary make provisions of red lamps.
- 2.2.22 The Contractor shall remove/maintain/restore all service lines like telephone, water supply, electricity etc. without any extra charges.

2.3 De-watering

- 2.3.1 Where the excavation level is below the natural water table and it is necessary to pump continuously from the excavation or to install a specialist type of dewatering equipment around the perimeter of the site or excavation, the Contractor will be responsible for ensuring the safety and stability of all adjoining structures and services or utilities above or below ground level.
- 2.3.2 It will also be the responsibility of the Contractor that the equipment installed shall ensure that the excavation and subsequent construction is carried out in dry conditions.
- 2.3.3 Continuous or permanent de-watering of the excavation or Site may not be undertaken without the written approval of the Consultant and the methods to be employed shall also comply with Codes of Practice and Local Authority requirements.
- 2.3.4 The water pumped from the excavations or well points shall be pumped to disposal points or sumps approved by the Consultant and the Local Ward Office and if so required be passed through settling tanks before disposal.

- 2.3.5 Unless prior approval has been obtained no water must be disposed of in the Municipality's sewer systems.

2.4 Backfill

- 2.4.1 All earth used for filling shall unless otherwise stated, be selected hard dry material from the excavation. The maximum dry density of the fill material shall be not less than 1600 kg/m³.
- 2.4.2 The backfill of excavations shall be placed in horizontal layers not exceeding 300mm in thickness. Each layer shall be compacted by hand or other mechanical means to the required density before the next layer is added.
- 2.4.3 Care shall be taken when filling or back-filling to avoid any wedging action or eccentric action upon or against the structure of the work.
- 2.4.4 Before placing of fill, the surface of the sub-grade shall be compacted at optimum water content to the same percentage of maximum dry density required of subsequent lay.
- 2.4.5 The Consultant will inspect all compacting devices that the Contractor proposes and shall have the right to reject any device which he feels is unsuitable for the job.
- 2.4.6 Heavy equipment for spreading and compacting fill and backfill shall not be operated closer to walls than a distance to the difference in height between the top of the footings and the layer being compacted.
- 2.4.7 When back-filling behind retaining walls, basement walls and the like the said structures shall be kept propped during the complete operation. The hydraulic compaction of fill shall not be permitted and the back filling shall be carried out in layers not exceeding 150mm thick.
- 2.4.8 Each layer shall be compacted to 90% of the modified compaction. No back filling shall be carried out until the wall concrete has achieved its full works cube strength and care shall be exercised so as not to damage the external tanking membrane and its protection.

3. CONCRETE WORKS

3.1 General

- 3.1.1 Materials used in the Works shall be new, of the qualities and kinds specified herein and equal to approved samples. Delivery shall be made sufficiently in advance to enable further samples to be taken and tested if required. No materials shall be used until approved and materials not approved shall be immediately removed from the Works.
- 3.1.2 Materials shall be transported, handled and stored on the site or elsewhere in such a manner to prevent damage, deterioration or contamination.

3.2 Cement

- 3.2.1 Cement shall be Ordinary Portland cement of an approved brand.
- 3.2.2 Cement shall conform to BS 12.

Cement shall be of recent manufacturer and used within 6 months of manufactured date.

The Contractor shall with each fresh consignment of cement delivered to the site furnish the Consultant with a copy of the Manufacturer's statement of compliance with the above Standard Specifications together with the date of manufacture, certified by an independent agency in the country of origin and its date of delivery to Site.

Check tests will be required by the Consultant. These tests shall be carried out at the Contractor's expense.

Any cement failing to meet the required standards will be rejected and replaced at the Contractor's expense.

Any cement not conforming to BS 12 shall not be used unless otherwise approved by the Consultant.

3.3 Aggregate

- 3.3.1 Fine aggregate shall be river sand conforming to BS 882.
- 3.3.2 Coarse aggregate shall be crushed stone excluding limestone or derivatives of limestone conforming to BS 812.
- 3.3.3 Aggregate shall not contain injurious amount of rubbish, dirt, organic impurities and other foreign matters.
- 3.3.4 Strength of aggregate shall be more than that of hardened concrete paste.
- 3.3.5 Shape of coarse aggregate shall not be flat or slender.
- 3.3.6 Aggregate to be used in concrete shall possess the qualities indicated in the following tables.

Quality of Aggregates

| Aggregate type | Open dry specific gravity | Percentage of water absorption (%) | Percentage of solid volume for the evaluation of particle shape (%) | Clay lump (%) | Loss in washing test (%) | Organic impurity (%) | Water soluble chloride (%) |
|------------------|---------------------------|------------------------------------|---|---------------|--------------------------|----------------------|----------------------------|
| Coarse aggregate | <= 2.5 | <= 3.0 | => 55 | <= 0.25 | <= 1.5 | 0 | <= 0.25 |
| Fine aggregate | >=2.5 | <= 3.5 | - | <= 1.0 | <= 3.0 | 0 | <= 0.01 |

* Colour of test solution not to be darker than standard solution

Grading requirements for aggregates

Percentage passing each sieve by weight (%)

| Agg. | Max. size (mm) | Nominal sieve size (mm) | | | | | | | | | | | |
|--------|----------------|-------------------------|-----|----------|---------|----|----------|---------|---------|---------|---------|---------|--------|
| | | 40 | 30 | 25 | 20 | 15 | 10 | 5 | 2.5 | 1.2 | 0.6 | 0.3 | 0.15 |
| Coarse | 25 | 100 | 100 | 90 - | 60 - | | 20 - | 0 - | 0 - | | | | |
| | 20 | | | 100 - | 90 - | | 20 - | 0 - | 0 - | | | | |
| Fine | | | | | | | 100 - | 90 - | 80 - | 50 - | 25 - | 10 - | 2 - |
| | | | | | | | | 100 | 100 | 90 | 65 | 35 | 10 |

- .3.7 Manufactured sand and blast furnace slag to be use in concrete shall not be used unless otherwise specified or approved by the Consultant.
- 3.3.8 In case of using fine aggregate of 0.01% or more water soluble chloride content, the necessary measures for corrosion inhibiting of reinforcement shall be instructed by the Consultant.
- 3.3.9 The maximum size of coarse aggregate shall be 25 mm.
- 3.3.10 Sources of aggregate shall be to the approval of the Consultant and samples of aggregate from the proposed source shall be submitted to the Consultant at least 28 days before its intended use.

3.4 Water

- 3.4.1 Water shall not contain injurious amount of impurities that may adversely affect concrete and reinforcement.
- 3.4.2 Ground water shall not be used for concrete works.
- 3.4.3 Water shall be obtained from a public supply where possible, and shall be taken from any other sources only if approved by the Consultant.
- 3.4.4 Only water of approved quality shall be used for washing out formwork, curing concrete and similar surfaces.

3.5 Handling and Storage of Material

3.5.1 Cement

- 3.5.1.1 Cement shall be stored in a manner to prevent weathering.
- 3.5.1.2 Bagged cement shall be piled no more than 10 bags so as to permit easy inspection

- 3.5.2 Cement caked even to the slightest extent shall not be used. Such cement and rejected cement shall be immediately separated from other bags of cement so that they shall not be mistaken for others.

3.5.3 Aggregate

- 3.5.3.1 Aggregate shall be stored in a manner effectively separating coarse and fine aggregate according to type and shall be prevented from inclusion of dirt, rubbish and other undesirable foreign matters.
- 3.5.3.2 Coarse aggregate shall be unloaded and piled in a manner not to cause segregation of small and large particles. Aggregate to be stored in piles shall be in mounds of moderate height and at a location where good drainage is provided.

3.6 Mix Proportion and Strength

- 3.6.1 Mix ratio for reinforced concrete shall be in the proportion 1:2:3 (cement: fine aggregate: coarse aggregate) by dry volume.
- 3.6.2 Mix ratio for lean concrete shall be in the proportion 1:2:6 (cement: fine aggregate: coarse aggregate) by dry volume.
- 3.6.3 Water-cement ratio for concrete shall be 0.4% to 0.45%
- 3.6.4 The specified design strength of reinforced concrete shall be 25 N/mm²
- 3.6.5 The required slump of concrete shall be 100 mm.

- 3.6.6 Design mix proportion shall be to obtain required workability, consistency and durability.

3.7 Production of Concrete

3.7.1 Field-mixed Concrete Plant

- 3.7.1.1 The Contractor shall select the necessary facilities for storage, batching, mixing and transporting of each of the materials and submit them for approval of the Consultant prior to start work.

3.7.2 Measuring

- 3.7.2.1 All materials shall be measure by volume for each batch and water may be measured volumetrically.
- 3.7.2.2 Cement shall be measured by number of bags unless automatic cement weight measure is in use.

3.7.3 Mixing Control

- 3.7.3.1 Concrete mixture shall be constantly controlled to obtain required workability and mixed strength. Mixing time for each batch shall be not more than 3 minutes.

3.7.4 Quality Control

- 3.7.4.1 The Contractor shall conduct tests for quality control toward insuring that concrete of the required quality is constantly produced.
- 3.7.4.2 The Contractor shall have all quality control tests report ready for submission as required by the Consultant.

3.7.5 Quality Inspection of Concrete at the Point of Placement

- 3.7.5.1 The Contractor shall conduct tests on concrete at the point of placement. When test results meet the tolerances given below, the concrete shall be qualified to have passed the tests.
- The tolerance between actual slump and required slump of the concrete shall be ± 2.0 mm
- 3.7.5.2 For the estimation of compressive strength of concrete in compressive strength tests, when the average value of compressive strength of concrete obtained in a test is not less than the specified design strength, it shall be qualified to have passed the test. In case of failure to the above requirements, the Contractor shall take necessary measures such as to perform appropriate test as instructed by the Consultant.

3.8 Transporting and Placing

3.8.1 General

- 3.8.1.1 The Contractor shall establish manner and schedule for transporting and placing of concrete and obtain approval of the Consultant.
- 3.8.1.2 Concrete shall be transported in a manner to minimize segregation, spill, age and other changes in quality thereof.
- 3.8.1.3 Concrete shall be placed and consolidated in a manner to insure uniformity and optimum density.
- 3.8.1.4 In case of rain or other conditions that may affect the quality of concrete during concreting, the Contractor shall take necessary measures as instructed by the Consultant.

3.8.2 Time Limit

- 3.8.2.1 The time limit from start of mixing to completion of placing of a batch as a rule shall be 30 minutes.

3.8.3 Preparation prior to Placing.

- 3.8.3.1 The place where concrete is to be deposited shall be cleaned and sheathing shall be sprinkled with water. Subsequently, water accumulated in the form shall be removed.

3.8.4 Construction Joint

- 3.8.4.1 Joint surfaces shall be cleaned, made free of laitance and other foreign matters, and wetted prior to concreting. Joint surface shall be roughened if directed by the Consultant.
- 3.8.4.2 The locations of shapes of construction joints shall be consulted and approved by the Consultant.

3.8.5 Concrete Placing

- 3.8.5.1 Concrete placing shall be proceeded to keep the surface of placed concrete as horizontal as possible.
- 3.8.5.2 Concrete shall be continuously poured to compact around reinforcing bars and corners of formwork.
- 3.8.5.3 The maximum time interval between placements of continuous concreting shall not exceed 0.5 hours. However, when special measures are taken this time limit may be changed according to instruction or approval of the Consultant.

3.8.6 Consolidation

- 3.8.6.1 Vibrating of concrete and tapping of formwork shall be performed to wall, column and other places difficult for concrete to proceed. Proper number of workers for placing and compacting concrete shall be arranged.
- 3.8.6.2 Vibrator shall be operated for concrete called for water tightness, difficult portion for concrete to proceed and other cases directed by the Consultant. However, vibrator shall not be touched reinforcing bars and shall not be operated more than 30 seconds at same spot.

- 3.8.6.3 Concrete shall be placed 300 - 600 mm thickness at once in case vibrator is performing. In case flexible-insert-vibrator is called for, concrete shall not be placed thicker than the length of the insert or vibrator at one pouring.
- 3.8.7 Placing Speed
- 3.8.7.1 Concrete shall be placed at the speed suited for the workability of the concrete and condition of the place of placement, which insures proper consolidation of concrete.
- 3.9 Concrete Curing**
- 3.9.1 Curing Method
- 3.9.1.1 After concrete has been placed, the concrete surface shall be kept moist by sprayed with water or by other appropriate methods, and shall be protected from direct sunlight and rapid drying. The top surface of slabs shall be kept flooded with water at all times after concreting for the duration of curing period. This curing period shall be for not less than 14 days.
- 3.9.1.2 As a rule, no foot traffic or loads shall be permitted on concrete for at least 24 hours after placement.
- 3.10 Test**
- 3.10.1 General
- 3.10.1.1 The contractor shall be required to conduct all tests according to BS method and procedure.
- 3.10.1.2 Test, as a rule, shall be conducted at the locations directed or at the testing institutions approved by the Consultant.
- 3.10.1.3 The Consultant shall conduct test, as a rule.
- 3.10.1.4 In case of failure in test, measure shall be taken as instructed by the Consultant.
- 3.10.1.5 The Contractor shall keep test records during the work and for 2 years after completion of the contracted work.
- 3.10.2 Material
- 3.10.2.1 Cement Test
- (1) Setting test.
- (2) Soundness test.
- (3) Compressive strength test.
- Note: Item (1) shall be conducted once in every manufacturer.
Item (2) & (3) shall be conducted once in every 2,000 bags.
- 3.10.2.2 Aggregate test:
- (1) Grading and fineness modules.
- 3.11 Concrete**
- 3.11.1 Fresh concrete
- Slump, air content, shall be conducted daily, and more often at request of the Consultant.

3.11.2 Compressive strength test of concrete

Test for estimation on strength of concrete in structure:

- 3.11.2.1 In order to assume estimated strength of concrete in structure, compressive strength test shall be conducted for prepared test pieces on the 7th day and 28th day and those test pieces shall be made for sampling at placing of concreting.
- 3.11.2.2 Strength test shall be conducted for each of the following conditions: each days pour, each class of concrete, each change of supplies or source and each 100 cubic meter of concrete or fraction thereof. The number of test pieces to be used in a test shall be not less than 3 for each test of the 7th day and the 28th day unless otherwise instructed by the Consultant.
- 3.11.2.3 Test pieces shall be made in accordance with British Standards, and sampling shall be taken as near as possible at the point of placement.
- 3.11.2.4 Test pieces shall be stored without being disturbed and shall be covered during the first 24 hours, and carefully transported specimens to the testing laboratory. Test pieces shall be cured in water after de-moulding. The temperature of test pieces shall be kept as close as possible to the temperature of the concrete in structure until the time of testing.
- 3.11.2.5 The test results shall be expressed in the average value by calculating the average compressive strength of all test pieces. The average value must be equal to or greater than the specified strength.

3.12 Defective Concrete and Finishes

- 3.12.1 Honeycombed surfaces shall be made good or on the instruction of the Consultant be cut out by the Contractor and make good at his own expense.
- 3.12.2 Concealed concrete faces shall left as from the formwork except honeycombed surfaces shall be made good. Faces of concrete to be rendered shall be roughened by approved means to form a key. Faces of concrete that are to have finished other than those specified shall be prepared in an approved manner as instructed by the Consultant

4. CONCRETE FORMWORK

4.1 Structure and Material

4.1.1 Structure

- 4.1.1.1 Formwork shall be performed to obtain accurate concrete in accordance with the designated drawings.
- 4.1.1.2 Formwork shall be firmed and secured to bear the force of concreting and tightened to avoid cement paste seeping.

4.1.2 Materials

- 4.1.2.1 Sheathing for formwork shall be waterproof plywood of not less than 12 mm thick. Joint of sheathing shall be butt joint and firmly assembled. In case of

using wood board for sheathing, boards shall be 15 mm thick and applied planer. Joint shall be tongued and grooved unless otherwise approved by the Consultant.

4.1.2.2 Form liners shall be sound and suitable materials to accurately and safely cast the in-situ concrete structure as shown on the Drawings.

4.1.2.3 Timber form boards for sheathing where used for fair-faced concrete shall be of such new materials as not to cause any defects to the surface of the concrete. Special care shall be taken in fabrication, storage and protection of these boards.

4.1.3 Other Material

4.1.3.1 Fastening hardware to be used shall be those with allowable tensile strength guaranteed by manufacturer through strength tests.

4.1.3.2 Form oil shall not have injurious effects on quality of concrete nor to bonding of surface finishing materials and shall be subject to approval of the Consultant.

4.2 Performance

4.2.1 Design of formwork

4.2.1.1 Formwork shall be designed to withstand construction loads during concreting, lateral pressure of fresh concrete, shock and vibrators due to concrete placing.

4.2.1.2 Formwork shall be free of injurious leakage of water, easy to remove, and shall not damage concrete at removal.

4.2.1.3 Supports shall be provided with the adequate horizontal and diagonal bracing and/or stays to prevent collapsing, heaving and twisting of formwork due to horizontal loads working during concrete placing.

4.2.2 Tolerance

The dimensional tolerances in location and cross section of concrete member used for designing and construction of formwork shall conform to the following table.

Standard Values of Dimensional tolerances

| Item | Tolerance (mm) |
|---|----------------|
| Tolerance in distance from datum line of each floor to respective members | + 10 |
| Tolerance in cross section of columns, beams and walls | - 5 , + 10 |
| Tolerance in thickness of floor and roof slabs | 0, +10 |

4.2.3 Fabrication and Erection

- 4.2.3.1 Erection of formwork, and transportation and storage of materials thereof shall be started only after previously placed concrete has reached an age which acceptance of these loads will not have any adverse effect on the concrete.
- 4.2.3.2 Sheathing shall be fabricated and installed accurately to match the locations, shapes and dimensions of members called for in the Drawings.
- 4.2.3.3 Sheathing shall be installed tightly so as not to permit cement paste or mortar to escape from joints.
- 4.2.3.4 Pipes, boxes and other embedded hardware shall be properly secured to sheathing or others so that they will not move during concrete placing.
- 4.2.3.5 Supports shall be erected plumb. Supports at any two vertically consecutive floors shall be erected as near as possible to identical locations on a common plane.
- 4.2.3.6 Shoring shall be erected paying special attention to safety.
- 4.2.3.7 If sheathing is reused, the surface in contact with the concrete shall be thoroughly cleaned off and sufficiently repaired before reuse. In case of using for fair-faced concrete, the same sheathings shall be used twice after approval of the Consultant.

4.2.4 Inspection

- 4.2.4.1 Formwork shall be inspected by the Consultant prior to placing of concrete.

4.2.5 Striking of forms

- 4.2.5.1 The minimum period for keeping the forms in position and for watering after laying the concrete shall be as stated below, except otherwise specified in drawings. Forms shall be removed in such a manner as to ensure the complete safety of the structure, so that there is no shock or vibration as would damage the reinforced concrete.
- 4.2.5.2 The responsibility for the safety of the concrete shall rest entirely with the Contractor and the Contractor shall be held liable for any damage done and shall have to make good the same at his own expenses.
- 4.2.5.3 The Contractor shall inform the Consultant when he intends to remove shuttering and shall obtain his consent, but the consent of the Consultant shall not relieve the Contractor of his responsibility.
- 4.2.5.4 The minimum time for formwork to remain in place shall be as per the following table.

| | |
|--|----------|
| Vertical sides of beams, slabs and columns | 24 hours |
| Soffits of slab | 10 days |
| Soffits of beams | 21 days |
| Cantilevers | 28 days |

4.2.6 Relocation of Support

4.2.6.1 Supports under concrete shall be not relocated

4.2.7 Removal of formwork

4.2.7.1 Formwork shall be removed gently, after its removal has been approved by the Consultant.

4.2.7.2 Inspection by the Consultant shall be obtained immediately after the removal of sheathing and defects shall be immediately remedied according to instruction of the Consultant.

4.2.7.3 After shoring has been removed, members shall be carefully observed for cracking and deflection, when found, they shall be reported immediately to the Consultant.

5. STEEL REINFORCEMENT

5.1 Material

- 5.1.1 Reinforcing steel shall be of the dimensions given in the Drawings.
- 5.1.2 Reinforcing bars shall comply with the requirement of B.S.4449. and welded wire fabric, square bar fabric and expanded metal shall comply with appropriate part of B.S.4483.
- 5.1.3 Dia 6mm reinforcing steel shall be round mild steel bars, and 12mm, 16mm, 20mm and 25mm shall be deformed high strength bars.
- 5.1.4 Any other non-specified reinforcing steel shall be used only with the approval of the Consultant.
- 5.1.5 All reinforcing steel and binding wire shall be stored under cover and shall be at least 250mm above the ground.

5.2 Cleaning

- 5.2.1 Reinforcing bars shall be cleaned before use so that it is free from rust, oil, dirt or other coatings that reduce bond.

5.3 Bending and Laps

- 5.3.1 The reinforcement shall be bent cold in an approved bar bending machine.
- 5.3.2 Preferably bars of full length shall be used. Lapping of bars where necessary shall conform to BS1487 'Bending Dimensions of Bars of Concrete reinforcement.'

5.4 Reinforcement Cover

- 5.4.1 Concrete cover for reinforcement shall be as follows:

| | | |
|--|-------|----|
| FOR ANY STEEL IN UNDER GROUND CONCRETE | 50 | MM |
| CLEAR COVER IN SLABS | 25-30 | MM |
| CLEAR COVER IN BEAMS SOFFIT | 30-35 | MM |
| CLEAR COVER IN SIDES OF BEAMS | 30 | MM |
| CLEAR COVER IN COLUMNS | 40 | MM |

5.5 Placing

- 5.5.1 Reinforcement intended for contact when passing each other shall be securely tied together with binding wire.
- 5.5.2 Binders and stirrups shall tightly embrace the longitudinal reinforcement to which they shall be security bound or spot welded.
- 5.5.3 Binding wire shall be turned in from the formwork and shall not project beyond reinforcing bars.

All reinforcement shall be inspected by the Consultant and approved before concrete is placed in the forms.

6. WATER PROOFING

6.1 Description of work

- 6.1.1 Extent of water proofing work is shown on drawings.
- 6.1.2 Install slurry type waterproofing to top surfaces of balcony slabs and external surfaces of underground concrete work.
- 6.1.3 Install crystalline type water proofing to underground water tanks and roof slabs in strict accordance with the approved manufacture's printed instructions.

6.2 Materials

- 6.2.1 Crystalline Type: Material used shall be a cementitious coating containing catalytic chemicals which migrate in to the concrete using moisture present in the concrete as the migrating medium, and which cause the moisture and the un-hydrated cement in the concrete to react causing the growth of non-soluble crystals of dendritic fibers in the void and capillary tracks of the concrete that allow passage of water, there by rendering the concrete itself water proof.
- 6.2.2 Acceptable products: Xypex concentrate, modified, ultra plug and quick set as manufactured Xypex chemicals (Canada) Limited (or equivalent).

6.3 Storage of materials

- 6.3.1 General: All materials shall be stored in original undamaged containers with manufactures seals and labels intact. Material shall be stored off the ground in a dry enclosed area.

6.4 Surface preparation

- 6.4.1 General: All surfaces shall be examined for form tie holes and defects such as honeycombing, rock pockets, cracks, etc. These areas shall be repaired in accordance with these specifications and the manufactures printed instructions.
- 6.4.2 Concrete finish: concrete surfaces shall have an open capillary system to provide tooth and suction shall be clean; free from scale, excess form oil, laitance, curing compounds and other foreign matter.
- 6.4.3 Smooth surfaces or surfaces covered with excess form oil or other contaminants shall be washed lightly sandblasted, water blasted, or acid -etched with muriatic acid, as required to provide a clean absorbent surfaces.
- 6.4.4 Horizontal surfaces shall not be troweled or power - troweled, and shall be left with a rough float finish or a broom finish. Vertical surfaces may have a sacked finish. Comply with manufactures specifications for requirements pertaining to minimum 'age' of concrete deck surface scheduled to receive water proofing.
- 6.4.5 Surface moisture: Water proofing shall be applied to 'green' concrete as soon as possible after forms have been stripped or to older pours which have been thoroughly moistened with clean water prior to application. Free water shall be removed prior to application.

Mixing of crystalline water proofing compound: comply with manufactures specification for 2-coat installation.

6.5 Application

- 6.5.1 General: Apply all materials under the direction of the manufacturer's representative.
- 6.5.2 Construction joints and surface defects: Comply with waterproofing material manufacturer's printed directions in the preparation, and treatment of construction joints and surface defects.
- 6.5.3 Surface application: After all repair, patching and sealing strip placement has been prepared in accordance with manufacturer's recommendations and approved by manufacturer's representative, treat concrete surface with first coat slurry mix of crystalline waterproofing compound.
- 6.5.4 Brushing: Use a short bristle or broom to work the slurry well into the concrete, filling all hairline cracks and surface pores.
- 6.5.5 Second coat: Apply second coat while first coat is still 'green' but after it has reached an initial set, all as recommended by the water proofing material manufacturer.

6.6 Curing

- 6.6.1 General: Curing shall begin as soon as the waterproofing materials have set up sufficiently so as not to be damaged by a fine spray. Treated surface shall be sprayed three times a day for a three-day period. Allow material to set 12 days before filling the structure with liquid
- 6.6.2 Protect treated surfaces from damage due to wind, sun, rain and temperatures below 35 degrees F. For a period of 48 hours after application, arrange protections to permit proper curing conditions for waterproofing material.
- 6.6.3 Clean up: Remove all surplus materials from the premises and leave all areas broom-clean. In the case of temporary protections remove all such items carefully to avoid damage to treated surfaces. Assemble all such materials and remove from premises followed by broom cleaning as noted.

7. EMBEDDED DAMPPROOF MEMBRANE

7.1 General

- 7.1.1 This section deals with laying of flexible sheet as damp proof membranes or has chemical or vapour barriers embedded in the fabric of the building. It does not deal with the weather-proof roof sheeting, or with vapour barriers.

7.2 Products

- 7.2.1 Polythene sheets for under slab DPM: gauge 500, manufacturer and reference to approval.
- 7.2.2 Adhesive tape: A type recommended by the sheet manufacturer.

7.3 Workmanship

- 7.3.1 Manufacturers Recommendations: to be strictly followed for all products and materials. Apply sheets to clean, dry surfaces with all joints sealed to give a completely water proof continues membrane.
- 7.3.2 Polythene Sheet Under-Slab Dpm: lay a level bed of fine sand, not less than 13mm thick or as specified to receive membrane.
- 7.3.3 Polythene Sheet Dpm: ensure that sheets are clean and dry. Lay single layer loose on base, lap edges 150mm and seal with mastic or adhesive tape.
- 7.3.4 Pipe Etc: where pipe etc. pass through sheeting make junction completely watertight by forming collars fully bonded / sealed to both pipes and sheeting.
- 7.3.5 Project: finished sheeting adequately and prevent puncturing during following work sheet to be covered by permanent over laying construction as soon as possible.

8. STRUCTURAL STEEL

8.1 Scope

- 8.1.1 This section shall apply to the work involved with structural steels. All incidental items of structural steel shall be stated in the particular specification.

8.2 Materials

8.2.1 Steel

- 8.2.1.1 Shape of steel shall be precise and straight and free of injurious scratches and rust.
- 8.2.1.2 All steel sections shall be galvanized sections of strength class 43 A.
- 8.2.1.3 Dimensions of steel section and tolerance of dimension shall conform to standard dimension of steel regulated in ASTM or BS standard.

8.2.2 Bolt

- 8.2.2.1 Shape of bolt, nut, and washer shall be in accordance with requirement of BS 4190 & BS 3692.
- 8.2.2.2 Quality of bolt shall be SC 43 A.

8.2.3 Welding Rod

- 8.2.3.1 Arc welding rod shall conform to materials to be welded, and position.

8.3 Fabrication

- 8.3.1 Main fabrication shall be done in workshop unless otherwise specified or approved by the Consultant.
- 8.3.2 Full scale drawing of each section shall be drawn prior to fabrication and checked by the Consultant.
- 8.3.3 Section of each material shall be cut perpendicular to axis unless otherwise specified in the drawing.
- 8.3.4 Saw and angle cutter shall be used for cutting, and cut section shall be free of any noticeable defect.
- 8.3.5 Deformation caused by cutting shall be corrected.
- 8.3.6 Normal temperature or hot drawn process shall do bending process. Steel shall be red heat in hot drawn process.
- 8.3.7 Those directed in the drawing shall be chiselled finish and completely attached. Materials shall be checked for bend, distortion, warp, etc. before fabrication.

8.4 Bolt

8.4.1 Bolt Hole

8.4.1.1 Spacing of boltholes shall be as directed in the following table.

| Diameter of Bolt | Standard Pitch | Minimum Pitch | End Distance | Edge Distance |
|-------------------------|-----------------------|----------------------|---------------------|----------------------|
| 12 | 50 | 30 | 30 | 25 |
| 16 | 50 | 40 | 40 | 30 |

- 8.4.1.2 Minimum pitch and end distance for lightweight steel shape shall be more than 3 times and 2.5 times a Bolt diameter respectively.
- 8.4.1.3 Diameter of hole shall not be over 0.5 mm larger than bolt diameter. However, for anchor bolt 5mm clearance shall be allowed between bolt diameter and diameter of hole unless otherwise specified.
- 8.4.1.4 Bolthole shall either be drilled open or reamed after sub punching. Punching can only be permitted for a material thickness less than 13 mm.
- 8.4.1.5 Rolled edge around a hole shall be removed.
- 8.4.1.6 Position of a bolthole shall be precise so that the center of all holes aligns.
- 8.4.2 Protection against loosening of Nuts
 - 8.4.2.1 Nuts shall be protected against loosening by concrete covering, double nuts or other proper means.
- 8.5 Welding**
 - 8.5.1 Welding
 - 8.5.1.1 Welder shall have an authorized qualification in Maldives and approved by the Consultant.
 - 8.5.1.2 Other tests shall be conducted to confirm welder's skill in accordance with type of work.
 - 8.5.1.3 Tack welding shall be carried out by the welder approved by the Consultant.
 - 8.5.2 Welding Machine
 - 8.5.2.1 Arc welding machine shall be alternate or direct current type, which provides sufficient and adequate current.
 - 8.5.3 Preparation
 - 8.5.3.1 Welding shall be done as much downward as possible using a jig such as Rotary frame.
 - 8.5.3.2 Welding rod shall be always kept in a dry area and if necessary, dried by drying equipment.
 - 8.5.3.3 Welding surface shall be free of water, scale or others injurious to welding work. Slag appeared on the created surface in the middle of welding shall be cleaned before starting again.
 - 8.5.4 Fabrication
 - 8.5.4.1 Welding edge shall be smoothed by automatic gas cutting or other proper finishes.
 - 8.5.8 Finishes
 - 8.5.8.1 Surface of welds shall be as smooth as possible and size and length of welds shall not be less than designed dimensions.
 - 8.5.8.2 Reinforcement of weld shall not exceed $0.1s + 1 \text{ mm}$ (s: Designated size) in fillet welds.
 - 8.5.8.3 Welded parts shall be free of undercut, overlap, crack, blow hole, lack of welds, and lack of weld settlement, rolled up slag or other defects.
 - 8.5.8.4 Crater at the end of bead shall be carefully heaped up and slag, sputter, etc. shall be completely removed after welds.

8.5.9 Safety

- 8.5.9.1 Safe scaffoldings shall be provided for the field welds work.
- 8.5.9.2 Welding facilities shall be such that there shall be no electric leakage of electric shock. There also shall be sufficient protection for fire.
- 8.5.9.3 Electric shock protection device shall be used and also care shall be taken not to get suffocated or intoxicated by gas when welding in small area.

8.5.10 Inspection

- 8.5.10.1 Welding parts shall be inspected before, during and after welding in accordance with work schedule.

8.6 Erection and Field Painting

8.7.1 Erection

- 8.7.1.1 Erection procedure shall be prepared by the contractor and be approved by the Consultant prior to the erection.
- 8.7.1.2 Material shall be stored on flat surface in order not to get distortion, twist or other defects. Correction shall be made to those distortions or twisted before erection.
- 8.7.1.3 Horizontal reinforcement and bracing shall be placed and bolts are temporary tightened as trusses are put up.
- 8.7.1.4 Connection of materials by bolts, etc. shall be made after distortion on plumb is thoroughly corrected.
- 8.7.1.5 Temporary bracing or other reinforcement shall be placed to resist wind pressure or other loads erection.
- 8.7.1.6 When heavy objects are placed on a horizontal element in the course of erection, they shall be reinforced with prior approval of the Consultant.
- 8.7.1.7 Care shall be taken on all facilities so that there is no accident.

8.7.2 Field Painting

All steel work shall delivered to site unprimed shall be cleaned of impurities, scrapped and wire brushed to remove rust and painted with one coat of priming paint applied by brush.

Steelwork delivered to Site primed shall be cleaned of impurities and damage to the priming paint and made good with priming paint.

Galvanized steelwork to be painted shall be cleaned of impurities. Where rusting has occurred the rust shall be removed by wire brushing and made good with an approved rust inhibitor. The surfaces shall be coated with a mordant solution, washed with clean water and painted with two coats of priming paint applied by brush.

Steelwork, which is to be concealed shall be prepared and primed as above and shall be painted with two priming coats and one finishing coat of paint applied by brush.

8.8 Anchor Bolt

8.8.1 The other methods for movable burying shall be as directed by the Consultant.

9. MASONRY

9.1 Materials

- 9.1.1 Material used for masonry and plastering work shall conform to Section 3 - CONCRETE WORKS.
- 9.1.2 Masonry work shall be done with cement bricks or blocks of approved quality unless specified otherwise.
- 9.1.3 The blocks shall be free from excessive amounts of salt or other impurities and shall be inspected and approved by the Consultant.

9.2 General

9.2.1 Execution Drawing

- 9.2.1.1 Work shall be complied with this specification unless otherwise stated on particular Specification or Drawings. Any work not specified shall be discussed and directed by the Consultant. Execution drawing of block or brick alignment (inclusive of indication for hanging bolt, wood plug and conduit pipe), detail reinforcement, window opening, and other requirement shall be prepared and submitted for the Consultant.

9.2.2 Stake-Board

- 9.2.2.1 Stake-board shall be provided at each 5m in length and shall be inspected by the Consultant for the accuracy, firmness and secureness. However, suitable ruler, plumb bob and leveller shall be provided for minor performance of cement block and bricks.

9.2.3 Transportation and storing

- 9.2.3.1 Care shall be taken for damage during transportation of materials and any defect of natural finished concrete blocks or bricks shall be rejected.
- 9.2.3.2 Different size of material shall be stored separately and projected from dirt and other impurities.

9.2.4 Curing

- 9.2.4.1 Any shock or load shall not be applied until concrete mortar or other fills hardened. Corner, projection and top of cement block or brick work shall be protected from rain, dryness, cold, damage and stain by covering.
- 9.2.4.2 Void between blocks or bricks shall not be intruded by rainwater.

9.3 Blockwork

9.3.1 Material

9.3.1.1 Blocks shall be of standard quality low permeability blocks with no defects and sample shall be submitted for approval of the Consultant.

Blocks shall be **Solid cement blocks 125 mm thick for external walls and hollow cement blocks 100 mm thick for internal walls**. The average compression strength should be not less than 2.8N/mm^2 and shall comply with physical requirements of ISO 6073: 1981

9.3.2 Horizontal reinforcement for concrete block wall;

9.3.2.1 Horizontal reinforcement shall be provided at end of wall adjoining to concrete column. Reinforcing bar shall be anchored into end block and column.

9.3.2.2 Horizontal reinforcing bar for block wall shall be 6 dia. @ 1000 mm.

9.3.3 Placing Blocks & Bricks

9.3.3.1 Cement blocks shall be saturated with water and joint shall be cleaned.

9.3.3.2 Bonding mortar shall be used immediately after mix, and mixed mortar left for more than one hour shall be rejected.

9.3.3.3 Vertical and horizontal joint of blocks shall be filled completely and suitable with mortar on line shall not be moved or rearranged. Joint and surface of block of exposed finished block wall shall be cleaned immediately after joint is filled.

9.3.3.4 In case concrete block wall is attached to structural concrete, block wall shall be placed before concreting structure.

9.3.3.5 Mortar for joint shall be touched with steel trowel before hardened and exposed joint shall be finished with uniform width and planned without roughness or cavity.

9.3.3.6 Height for placing block per day shall be maximum 1.2 m unless otherwise specified.

9.3.3.7 Blocks shall be placed with cavity side under.

9.3.4 Joints

9.3.4.1 The thickness of joints shall not exceed 10 mm and the joints shall be rated (13 mm dup.) when the mortar is still floor, so as to provide for proper bond for the plaster. Any mortar which falls on the floor from this joints or removed due to raking of joints shall not be reused.

9.3.5 Lintel

9.3.5.1 Lintel shall be reinforced concrete as approved or directed by the Consultant.

9.3.5.2 Main reinforcing bar shall be anchored more than 40D (40 x diameter of the bar) at both end.

9.3.5.3 In case lintel is prefabricated, shop drawing shall be submitted for approval of the Consultant.

9.3.6 Frame of Opening

- 9.3.6.1 In case frame is temporarily installed before placing of blocks, frame shall be firmly placed and joiner shall be bonded with mortar as placing each block at side and top of frame.
- 9.3.6.2 In case frame is installed after placing of blocks, joiner shall be bonded with additional mortar at space or every two blocks or more.
- 9.3.6.3 Back of frame shall be filled and compacted with mortar by providing shuttering board.
- 9.3.6.4 Wood plug and anchor bolt shall be covered with mortar or concrete.
- 9.3.7 Piping
 - 9.3.7.1 Principally, piping shall not be placed in block wall unless piping block is in use.
 - 9.3.7.2 In case electric conduit pipe is placed in cavity of concrete blocks, care shall be taken not to obstruct reinforcing bar, and cavity shall be completely filled.
 - 9.3.7.3 In case chipping and piping on face of blocks is unavoidable, performance shall confirm to instruction of the Consultant.
 - 9.3.7.4 Joiner and supporter for exposed piping shall be buried at joint which back is filled or otherwise approved by the Consultant.

10. PLASTERING

10.1 General

10.1.1 All masonry walls shall have smooth finished cement plaster on both sides with a surface setting coat of neat cement applied within an hour of the completion of rendering.

10.1.2 Cement rendering to floor shall be same as above.

10.2 Materials and Storage

10.2.1 Plaster materials which are affected by moisture such as plaster and cement shall be stored properly.

10.2.2 Materials used for plastering shall conform to those of Section 3 - Concrete Works. Grading of sand, however, shall be as in table below

| Grading of sand | Mortar plastering | Plastering |
|------------------------------|--------------------------|--------------------------------|
| 5mm sifting thorough 100% | for first coat | for first coat and dubbing out |
| 0.15mm sifting less than 10% | for finish coat | |
| 2.5mm sifting through 100% | for finish coat | for second coat |
| 0.15mm sifting less than 10% | | |

10.2.3 White cement or filler or similar shall confirm to the requirements of Portland cement, BS.12.

10.2.4 The use of mixtures shall be approved by the Consultant's representative. The amount of admixture shall be such that it affects mortar strength very little.

10.3 Mixing ratio

10.3.1 Mixing volume ratio of mortar shall be as in table below:

| Base | area of application | first coat cement:sand | Dabbing out cement:sand | Finish coat cement:sand |
|----------------|----------------------------|-------------------------------|--------------------------------|--------------------------------|
| Masonry blocks | Floor | - | - | 1:4 |
| | Interior wall | 1:4 | 1:4 | 1:4 |
| | Exterior wall | 1:4 | 1:4 | 1:4 |

10.4 Thickness of Coating

Standard thickness of coating (mm)

| Base | Area of application | First coat | Dubbing out | Second coat | Finish coat | Total |
|---------------|----------------------------|-------------------|--------------------|--------------------|--------------------|--------------|
| Masonry block | Floor | - | - | - | as per dwg | as per dwg |
| | Interior wall | 8 | - | 8 | 4 | 15 |
| | Exterior wall | 8 | - | 8 | 4 | 15 |

Thickness of coating shall be standard thickness of coating unless otherwise indicated on the Drawings.

10.5 Finish

10.5.1 Type of finish and work schedule

| Type | Work Schedule | Notes |
|------------------------|---|--|
| 1.Smooth Trowel finish | 1. Shall be applied flat by metal trowel 2. Shall be finished by pressing with the trowel. | Before applying second coat, corner and edge shall be screed well. |
| 2. Wooden float finish | Shall be applied by wooden float | |

10.6 General Preparation

- 10.6.1 Remove efflorescence, laitance, dirt and other loose material by thoroughly dry brushing.
- 10.6.2 Remove all traces of paint, grease, dirt and other materials incompatible with coating by scrubbing with water containing detergent and washing off with plenty applying coatings unless specified otherwise.
- 10.6.3 In-situ Concrete Surfaces: Scrub with water containing detergents to ensure complete removal of mould oil, surface retarders and other materials in compatible with coating . Rinse with clean water and allow to dry unless specified otherwise.
- 10.6.4 Organic Growths: Treat with fungicide to manufacturer's recommendations and bush off.
- 10.6.5 Hacking for Key: roughen specified surfaces thoroughly and evenly by removing the entire surface to a depth of 3mm by scabbling, bush hammering or abrasive blasting, clean surfaces by washing and brushing.
- 10.6.6 Smooth Concrete Surfaces: where no keying or mix or bonding agent is specified, wet smooth concrete surfaces immediately before plastering.

10.7 External Plastering

- 10.7.1 Dissimilar Solid Backgrounds for Plastering: where plaster is to be continued without break across joints between dissimilar solid backgrounds which are rigidly bonded together, cover the joints with a 200mm wide mesh strip (back grounds in the same plane) or with the corner mesh (internal angle) fixed at not more than 600mm centers along both edges , unless specified or otherwise.
- 10.7.2 Dissimilar Solid Backgrounds for Plaster: where plaster is to be continued without break and without change of plane across the face of a 300mm and rigidly bonded to the background.
 - 10.7.2.1 Cover the face of the column /beam/ lintel with building paper extending 25 mm on the adjacent background.
 - 10.7.2.2 Over lay with expanded metal lathing extending 50mm beyond the edges of the paper and securely fixed with masonry nails at not less than 100mm centres along both edges.

Alternatively, an approved paper and mesh lathing may be used.

- 10.7.3 Dissimilar Solid Backgrounds for Rendering: where rendering is to be continued without break across joints between dissimilar solid backgrounds which are in the same plan and rigidly bounded together, cover joints with a 150mm wide strip of building paper overlaid with 300mm wide metal lathing fixed at not more than 600mm centers along both edges unless specified otherwise.
- 10.7.4 Service Chases: cover with steel mesh strip fixed at not more than 600mm centers along both edges.
- 10.7.5 Conduits bedded in under coat to be covered with 90mm wide jute scrim budded in finishing coat mix, pressed flat and trowelled in. Do not lap ends of scrim.

10.8 Internal Plastering

- 10.8.1 Accuracy of plaster 15mm thick or more: maximum permissible gap between an 1800mm straight edge and any point on the surface to be 3mm.
- 10.8.2 Dubbing Out: if necessary to correct inaccuracies, dub out in thickness of not more than 10mm in same mix as first coat. Allow each coat to set before the first is applied . Cross scratch surface of each dubbing out coat immediately after set.
- 10.8.3 Metal Mesh Lathing: Work undercoat well in to interstices to obtain maximum key.
- 10.8.4 Under Coats: generally to be not less than 8mm with thickness greater than 16mm applied as two equal coats. Rule to an even surface and cross scratch - end coat to provide a key for the next hand applied coat.
- 10.8.5 Cement Based Under Coats: all to dry out thoroughly but not rapidly, to ensure that drying shrinkage is substantially complete before applying next coat.
- 10.8.6 Dissimilar Backgrounds: where scrim or lathing or beads are not specified, cut through plaster with a fine blade in a neat, straight line at junctions of :
 - 10.8.6.1 Plastered rigid sheet and plastered solid backgrounds.
 - 10.8.6.2 Dissimilar solid backgrounds.
- 10.8.7 Smooth Finish: trowel or float to product a tight matt, smooth surface with no hollows abrupt change of level or trowel marks. Do not use water brush and avoid excessive trowelling and over polishing.

10.9 External Rendering

- 10.9.1 Dubbing Out: if necessary to correct inaccuracies, dub out in thicknesses of not more than 10mm in same mix as first coat. Allow each coat to dry before the next is applied. Cross scratch surface of each dubbing out coat immediately after set.
- 10.9.2 Under Coats for hand applied finishes:
 - 10.9.2.1 Apply first undercoat or dubbing out coat by throwing from a trowel.
 - 10.9.2.2 Coats to be no less than 8mm thick, with thickness greater than 16mm applied as two equal coats. On weak backgrounds first under coat to be not less than 10mm thick.
 - 10.9.2.3 Brush down each under coat to remove dust and loose particles and wet thoroughly before application of next coat.
 - 10.9.2.4 Cross scratch under coat without penetrating the coat, to provide key for following coat(s).

Drying: Keep each coat damp for the first three days by covering with polythene sheet and/or spraying with water. Thereafter prevent from drying out too rapidly. Work in shade whenever possible.

Allow each coat to dry out thoroughly to ensure that drying shrinkage is substantially complete before applying next coat.

Playing Floated Finish: Finish with wood or other suitably faced float to give an even texture.

Do not draw excessive laitance to surfaces.

10.10 Metal Mesh Lathing / Reinforcement For Plastered/Coatings.

10.10.1 Lathing to be provided as reinforcement for plastering in columns, walls or specified in drawings products.

10.10.2 Products:

10.10.2.1 Plain Expanded Metal Lathing: To B.S 1369 with a minimum weight of 1.9 kg/mm². Manufacturer to approval of the Consultant.

10.10.2.2 Wire Ties: Unless other specified, annealed iron, galvanized to B.S 443.

10.10.2.3 Clout Nails: galvanized steel or stainless steel nails to B.S 1202: Part 1, table 3.

10.10.2.4 Staples: Galvanized steel wire staples to B.S 1494: Part 2.

10.10.3 Workmanship

10.10.3.1 Framing: fix securely and accurately to help ensure that coatings on lathing , when finished, are true to line and level , within specified tolerances and free from cracks, rippling, hollows, ridges and sudden changes of levels.

10.10.3.2 Runners/Bearers spanning between concrete beams/ribs: fix with 3mm wire ties twisted around 38 mm X 10 gauge screws driven well into fixing blocks or plugs in sides of beams/ribs.

10.10.3.3 Wire Ties: twisted ends tightly together, cut off surplus and bend ends of wire away from face of coating.

10.10.3.4 Plain Expanded Metal Lathing:

(a) Stretch lathing and fix securely in accordance with manufacturers recommendations to give a taut, firm base for plaster/ rendering.

(b) Fix with the long way of the mesh at right angles to supports and with all strands sloping in the same direction.

(b) Lap side edges not less than 25mm. Lap ends 50mm at supports and 75mm between supports. Laps must not occur within 100mm of angles or bends.

11. CARPENTRY AND JOINERY

11.1 Materials

- 11.1.1 Timber shall be in accordance with the requirements of BS 1186 'Quantity of Timber and Workmanship in Joinery', Part 1, 'Quality of Timber'.
- 11.1.2 Timber and timber products shall be subject to the inspection and approval of the Consultant.
- 11.1.3 Timber shall be seasoned to stable moisture content compatible with the finished use, straight and true and free from wind, warp and distortion and in lengths suitable for the members required.
- 11.1.4 All timber shall be in long lengths and laps, scars or splices shall be over a bearing surface. Where obtainable, finishing timber exposed to view shall be in single lengths.

11.2 Preservation of Timber

- 11.2.1 All timber shall be treated for insect attack and is to be of the correct moisture content and free from surface moisture content and dirt.
- 11.2.2 All rafters, purlins, framing scribe pieces, wall plates, and trusses etc. shall be treated for insect attack with approved timber preservative. No extra payment shall be made for such coating and will be considered inclusive in the rate of the respective item in the BOQ.
- 11.2.3 Treatment shall be carried out after all cutting and shaping is completed.

11.3 Hardware

- 11.3.1 Hardware shall be standard quality and samples shall be submitted to the Consultant for approval.
- 11.3.2 All hinges shall be stainless steel or brass and shall be approved by the Consultant.
- 11.3.3 The dimensions and quality of hardware shall meet the requirements and shall not be rested, deformed or defective.

11.4 Dimensions and Finish

- 11.4.1 All dimensions of timber given are finished dimensions.
- 11.4.2 All elements and others of structural nature, which are exposed, must be machine planed to a smooth finish.
- 11.4.3 All unexposed timber shall be machine planed to a rough finish.
- 11.4.4 All joinery work shall be dressed on all four sides and hand dressed where necessary and sanded to all exposed surfaces. All arises in any way accessible shall be sanded and smoothed off.

11.5 Workmanship

- 11.5.1 All connections whether nailed, screwed glued, mortised or dove-tailed shall be accurately made and properly executed to provide sound, satisfactory connections for the class of work required.
- 11.5.2 Timbers containing defects or distortions shall not be used.

- 11.5.3 All joinery shall be manufactured by skilled tradesman with accurate tolerances and set out and with tools, jigs, machines and equipment appropriate for the work.
- 11.5.4 Assembly of the joinery units and joinery frames, etc. shall be by means of glued connections appropriate to the work - mortise and tennon, housing and doweling, etc. where practicable including the use of glued blocks wherever required. Nailing, screwing shall only be used with prior approval of the Consultant; corrugated fasteners shall not be used for effecting connections.

12. ALUMINIUM DOORS AND WINDOWS

12.1 Aluminium Doors and Windows

- 12.1.1 All windows and doors are to be constructed by approved specialist suppliers of medium section to the particular requirements noted on the drawings as to weight and profile. All sections shall generally conform to relevant British Standard Specifications.
- 12.1.2 All frames should be made to fit the actual openings with a 3 mm clearance all around. Discrepancies in overall width or height exceeding 3mm will not be allowed and the frames will be rejected in such cases. Any small discrepancies shall have the gaps suitably backed and filled with gun-applied water repellent mastic sealant
- 12.1.3 All sealants used in the assembly of, and in the fixing of cladding and window framing, shall be non-setting to allow thermal movement without detriment to those joint sealants used for peripheral caulking and shall be one part silicone sealant and shall conform to BS 4245. All spliced joints between mullions should be sealed with an approved silicone product, compatible with other sealants and packings used.
- 12.1.4 The auxiliary components in sashes as locks, pivots, sliding gear etc. shall comprise of stainless steel or resisting materials.
- 12.1.5 The tolerances are to be as follows:
- a) Inside width of frame 3mm Maximum
 - b) Inside height of frame 3mm Maximum
 - c) Depth of frame 2mm Maximum
 - d) Opposite side, Inside distance 2mm Maximum
- 12.1.6 The performance - associated requirements are
- 1) Strength (resistance to wind pressure and other forces applied in use)
 - 2) Air tightness or ability to cut out drafts.
 - 3) Water - tightness against rain or dew.
 - 4) Sound arresting effect to (shut off noise from outside as well as inside).
- 12.1.7 All surfaces shall have an anodized protective surface layer of minimum 60 Micron thickness.
- 12.1.8 Glazing shall be done as specified by the Consultant. Glass shall be tinted, or as specified in the drawings. Thickness shall be according to the size of panels as given hereunder.

| | |
|---|------------------------------------|
| Not exceeding 1 sq. ft. | 2mm |
| Exceeding 1 sq. ft. but not exceeding 2 sq. ft. | 3mm |
| Exceeding 2 sq. ft. but not exceeding 4 sq. ft. | 4mm |
| Exceeding 4 sq. ft. but not exceeding 6 sq. ft. | 5mm |
| Exceeding 6 sq. ft. but not exceeding 12sq. ft. | 6mm |
| Exceeding 12sq. ft. | > 8mm or as approved by consultant |

- 12.1.9 Prior to import and / or purchase of the Aluminium Doors and Windows, the relevant specification of the manufacturer, along with samples has to be submitted to the Consultant for approval. This clause shall not be contravened on any account.
- 12.1.10 The fitting shall be done with utmost care not to spoil the finishes given by the manufactures, and any cleaning done shall be done with cleaners etc. as specified by the Manufactures.
- 11.1.11 The Contractor shall provide all items, articles, materials, operations, mentioned, or scheduled on the drawings, including all the labour materials, including fixing devices, equipment and incidentals necessary as required for their completion.
- 12.1.12 The Contractor shall submit shop drawings and/or samples of each type of doors, windows, railings and other items of metal work to the Consultant for approval. The shop drawings shall show full size sections of doors and windows etc. thickness of metal, details of construction hardware as well as connection of windows, doors and other metal work to adjacent work.
- 12.1.13 Aluminium doors and shutters shall be manufactured by an approved manufacturer and shall be of sections, sizes combination and details shown on the drawings. The frame member shall be one piece, corners shall be electrically welded, ground smooth and true and glazing bare shall be threaded or interlocked as approved by the Consultant.
- 12.1.14 Glazing for doors and windows shall be of specified thickness and of approved quality and shall conform to specification of glazing. Fixing for glazing shall be done with aluminium Snap-On beading as per detail drawing and instructions. Necessary continuous rubber gaskets of approved make shall be provided.
- 12.1.15 Colour for doors and windows shall be approved by the Consultant.

12.2 Aluminium louvers

- 12.2.1 Product data shall be submitted for approval; this shall include specified model and AMCA ratings or equivalent.
- 12.2.2 Contractor shall submit all shop drawings indicating materials, construction, dimensions, accessories, and installation details.
- 12.2.3 Contractor shall submit samples of the product for approval.
- 12.2.5 Louvers shall comply with AAMA specification 2605 "Voluntary Specification for High Performance Organic Coatings on Architectural extrusions and panels", ASTM B244 -68, AAC22A41 or equivalent.
- 12.2.6 Louvers shall be well suited for the design environment (temperature, humidity, and ventilation); i.e., it shall be within manufacturer's recommended design environment limits for optimum results.
- 12.2.7 All louvers shall be installed according to manufacturer's instructions.
- 12.2.8 All units shall be installed plumb, well fitted and securely attached to supporting frames.
- 12.2.9 Delivery of materials to site in shall be in manufacturers' original, unopened containers and packaging with labels clearly indicating manufacturer, material and location of installation.

12.2.10 Materials shall be stored in a dry area indoors and protected from damage in accordance with manufacturer's specifications.

12.2.11 Materials and finishes shall be protected during handling & installation to prevent damage.

12.3 Top hung windows, ventilators and side hung doors

12.3.1 All windows and doors should be weather stripped. The weather protection should be achieved by a positive compressive action against the section and should not depend on external contact. At every contact between two profiles two weather stripping sections should be provided to complete weather protection.

12.3.2 The bottom section for hinges must be capable of being adjusted vertically if necessary. The gap between section and the floor should be covered with a pair of special splay-tube sections.

12.3.3 The shutter sections for both windows as well as doors shall be hollow section type and shall be overall size 57 x 45 mm and the door sections shall be overall size 81 x 45 mm (including flanges).

12.3.4 The shutters of the windows and doors should be assembled with stainless steel pins and nylon washers. Handles shall be anodised aluminium finished to match the aluminium sections and mounted with self-lubricating nylon washers.

12.3.5 A mortise cylinder rim automatic deadlock of high quality with double pin tumbler shall be used.

12.3.6 Windows shall have anodised aluminium handles, colour as framing and a latching mechanism securing the shutter to the frame both at the top and bottom.

12.3.7 Required fittings;

12.3.7.1 Single action door closer concealed in the head bar of the outer frame and mounted on an adjacent pivot at the threshold and deadlock fitted.

12.3.7.2 The left hand leaf of double doors with flush bolts at head and sill with deadlock fitted to the right hand leaf.

12.3.7.3 Escape doors to have panic bolts assembly with vertical elements concealed in the sill and door closer as in 12.3.7.1.

12.4 Installation

12.4.1 Aluminium work shall be installed adjusted and glazed by experienced workmen all in accordance with the manufacturer's installation instructions and in full conformity with the approved shop drawings, samples and other submitted data. Under no circumstances shall materials be installed on surfaces that contain condensation, dirt, grease or other foreign encountered materials that would hinder or prevent proper installation and functioning for the use intended.

12.4.2 Aluminium work shall be carefully and accurately assembled with proper and approved provision for contraction and expansion and set in correct locations as per approved detailed shop drawings, all level, square, plumb and aligned with other work. All joints between framing and structural building shall be sealed in order to be watertight and weather-proof and to satisfy all other requirements of the Consultant.

12.4.3 Frames shall be designed and manufactured with a maximum 2.5mm tolerance around the opening in the structure. These joints are to be finished by applying an approved sealant into a polystyrene foam backing strip.

12.4.4 All aluminium works are to be fully protected for the duration of the contract from damage by other trades. The Consultant shall approve the method of protection.

- 12.4.5 If for any reason final finishes become scratched, abraded or damaged during transport, delivery, storage or erection, it shall be the Contractor's responsibility to remove or repair those defective areas or components as directed and to the complete satisfaction of the Consultant.
- 12.4.6 Repair work shall be identical to the manufacturer's applied finish with regard to gloss, finish and visual appearance. Field touch up of painted aluminium is permitted only with the written permission of the Consultant. Where touch up is not an authorised means of repair the damaged materials must be replaced by new.
- 12.4.7 Upon completion of work all protective coverings from all exposed surfaces shall be removed. All surfaces shall be cleaned using soap or detergents as recommended by the aluminium manufacturers to remove sealants, discolouration and any other foreign material. Defection of any type determined by the Consultant shall be repaired at the Contractor's expense.
- 12.4.8 Extreme care shall be taken when cleaning the exterior portion to protect all other adjacent works.

12.5 Sealing joints

- 12.5.1 The Contractor shall ensure that joints are dry and remove all loose material, dust and grease.
- 12.5.2 Joints shall be prepared in accordance with sealant manufacturer's recommendations using recommended solvents and primers where necessary.
- 12.5.3 Adjoining surfaces which would be impossible to clean if smeared with sealant shall be masked.
- 12.5.4 Backing strips shall be inserted in all joints to be pointed with sealant. When using backing strips, the Contractor shall not leave gaps and shall not reduce depth of joint for sealant to less than the minimum recommended by the manufacturer.
- 12.5.5 Cavities shall be filled and jointed with sealant in accordance with the manufacturer's recommendations. Sealant shall be tooled to form a smooth flat bead.
- 12.5.6 Excess sealant shall be removed from adjoining surfaces using cleaning materials recommended by the sealant manufacturer, and shall be left clean.

12.6 Glass installation

- 12.6.1 Workmanship shall generally be in accordance with CP 152 and respective British Standards.
- 12.6.2 The glass is to be delivered to the site with adequate protection to prevent damage and where possible it is to be fixed in position immediately after delivery. When fixed the Contractor is to take all necessary precautions to prevent damage during succeeding building operations and will be entirely responsible for the replacement of any broken or damaged glass at his own cost.
- 12.6.3 The Contractor is to be solely responsible for determining the exact sizes of glass required, including a tolerance of 2mm to each edge and he is recommended to check the necessary dimensions on site.
- 12.6.4 No glazing is to be carried out until rebates have been painted with primer. Glazing beads as applicable are also to be primed before fixing.
- 12.6.5 All mastic is to be neatly struck off to agree exactly with site lines inside and out.
- 12.6.6 Rates are to include for all necessary springs, clips, setting blocks, location blocks and distance pieces and for taking off and later re-fixing loose beads
- 12.6.7 Glass apertures in timber doors are to be bedded in chamois leather glazing strip, black ribbon velvet or P.V.C. glazing strip to the approval of the Consultant.

13. METAL WALL PANELS

13.1 References

13.1.1 General: Standards listed by reference, including revisions by issuing authority, form a part of this specification section to the extent indicated. Standards listed are identified by issuing authority, authority abbreviation, designation number, title or other designation established by issuing authority. Standards subsequently referenced herein are referred to by issuing authority abbreviation and standard designation.

A. ASTM International:

1. ASTM D1781 Standard Test Method for Climbing Drum Peel for Adhesives.
2. ASTM D1929 Standard Test Method for Determining Ignition Temperature of Plastics.
3. ASTM E84 Standard Test Method for Surface Burning Characteristics of Building Materials.
4. ASTM E108 (Modified) Standard Test Methods for Fire Tests of Roof Coverings.
5. ASTM E119 Standard Test Methods for Fire Tests of Building Construction and Materials.
6. ASTM E283 Standard Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen.
7. ASTM E330 Standard Test Method for Structural Performance of Exterior Windows, Curtain Walls, and Doors By Uniform Static Air Pressure Difference.
8. ASTM E331 Standard Test Method for Water Penetration of Exterior Windows, Curtain Wall, and Doors By Uniform Static Air Pressure Difference.

B. American Architectural Manufacturers Association (AAMA):

1. AAMA 2605 Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels.

B. International Organization for Standardization (ISO):

1. ISO 9001-2000 Quality Management Systems - Requirements.

D. National Fire Protection Association (NFPA)

1. NFPA 285 Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components

13.2 System Description

13.2.1 Performance Requirements: Provide composite metal panels that have been manufactured, fabricated and installed to withstand loads from deflection and thermal movement and to maintain performance criteria stated by manufacturer without defects, damage or failure.

A. Water and Air Leakage: Provide systems that have been tested and certified to conform to the following criteria:

1. Air Leakage, ASTM E283: Not more than 0.06 cfm per ft² of wall area (0.003 (L/s m²) when tested at 1.57 psf (0.075 kPa).

2. Water Penetration: No water infiltration under static pressure when tested in accordance with ASTM E331 at a differential of 10% of inward acting design load, 6.24 psf (0.299 kPa) minimum, after 15 minutes.

a. Water penetration is defined as the appearance of uncontrolled water in the wall.

b. Wall design shall feature provisions to drain to the exterior face of the wall any leakage of water at joints and any condensation that may occur within the construction.

B. Fire Performance: Provide composite fire rated panels that have been evaluated and are in compliance with regulatory code agency requirements specified herein.

13.3 Submittals

13.3.1 General: Submit listed submittals in accordance with Conditions of the Contract.

13.3.2 Product Data: Submit product data, including manufacturer's SPEC-DATA sheet, for specified products.

A. Shop Drawings: Submit shop drawings showing layout, profiles and product components, including anchorage, accessories, finish colors and textures.

1. Include details showing thickness and dimensions of the various system parts, fastening and anchoring methods, locations of joints and gaskets, and location and configuration of joints necessary to accommodate thermal movement.

B. Samples: Submit selection and verification samples for finishes, colors and textures.

1. Selected Samples: Manufacturer's color charts or chips illustrating full range of colors, finishes and patterns available for composite metal panels with factory applied finishes.

2. Verification Samples:

2.1. Structural: 12 inch × 12 inch (305 × 305 mm) sample composite panels in thickness specified from an available stock color, including clips, anchors, supports, fasteners, closures and other panel accessories, for assembly approval. Include panel assembly samples not less than 24 inches × 24 inches (610 × 610 mm) showing 4-way joint.

2.2. Include separate sets of drawdown samples on aluminum substrate, not less than 3 inches × 5 inches (76 × 127 mm), of each color and finish selected for color approval. Larger samples of standard colors are available with production-applied coatings.

C. Quality Assurance Submittals: Submit the following:

1. Test Reports: Certified test reports showing compliance with specified performance characteristics and physical properties, or a third party listing documenting compliance to a comparable code section.

2. Certificates: Product certificates signed by manufacturer certifying materials comply with specified performance characteristics and physical requirements.

3. Manufacturer's Instructions: Manufacturer's installation instructions.

4. Manufacturer's Field Reports: Manufacturer's field reports.

D. Closeout Submittals: Submit the following:

1. Warranty: Warranty documents specified.

13.4 Quality Assurance

13.4.1 Qualifications:

1. Installer Qualifications: Installer experienced in performing work of this section who has specialized in the installation of work similar to that required for this project.

a. Certificate: When requested, submit certificate indicating qualification.

2. Manufacturer Qualifications: Company with a minimum of 5 years of continuous experience manufacturing panel material of the type specified:

a. Able to provide specified warranty on finish.

b. Able to provide a list of 5 other projects of similar size, including approximate date of installation and name of Architect for each.

c. Able to produce the composite material without outsourcing of the coating or laminating process.

d. Able to provide a certificate of registration to ISO 9001-2000.

3. Fabricator Qualifications: Company with at least 3 years of experience on similar sized metal panel projects and qualified by panel material manufacturer. Capable of providing field service representation during construction

13.4.2 Mock-Ups: Install at project site a job mock-up using acceptable products and manufacturer approved installation methods. Obtain Owner's and Architect's acceptance of finish color (drawdown samples to be used for color approval of nonstandard coil coated colors), texture and pattern and workmanship standard. Comply with Division 01 Quality Control, Mock-Up Requirements Section.

1. Mock-Up Size: to be proposed by contractor

2. Maintenance: Maintain mock-up during construction for workmanship comparison; remove and legally dispose of mock-up when no longer required.

3. Incorporation: Mock-up may be incorporated into final construction upon Owner's approval.

13.4.3 Pre-installation Meetings: Conduct pre-installation meeting to verify project requirements, substrate conditions, manufacturer's installation instructions and manufacturer's warranty requirements. Comply with Division 01 Project Management and Coordination, Project Meetings Section.

13.5 Delivery, Storage & Handling

13.5.1 General: Comply with Division 01 Product Requirements Sections.

13.5.2 Ordering: Comply with manufacturer's ordering instructions and lead time requirements to avoid construction delays.

13.5.3 Delivery: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.

1. Protection: Protect finish of panels by applying heavy-duty removable plastic film during production.

2. Delivery: Package composite wall panels for protection against transportation damage. Provide markings to identify components consistently with drawings.

3. Handling: Exercise care in unloading, storing and installing panels to prevent bending, warping, twisting and surface damage.

13.5.4 Storage and Protection: Store materials protected from exposure to harmful weather conditions and at temperatures recommended by manufacturer.

1. Storage: Store panels in well-ventilated space out of direct sunlight.

a. Protect panels from moisture and condensation with tarpaulins or other suitable weather tight covering installed to provide ventilation.

b. Slope panels to ensure positive drainage of any accumulated water.

c. Do not store panels in any enclosed space where ambient temperature can exceed 120 degrees F (49 degrees C).

2. Damage: Avoid contact with any other materials that might cause staining, denting or other surface damage.

13.6 Project Conditions

13.6.1 Field Measurements: Verify actual measurements/openings by field measurements before fabrication; show recorded measurements on shop drawings. Coordinate field measurements, fabrication schedule with construction progress to avoid construction delays.

13.7 Warranty

13.7.1 Project Warranty: Refer to Conditions of the Contract for project warranty provisions.

13.7.2 Manufacturer's Warranty: Submit, for Owner's acceptance, manufacturer's standard warranty document executed by authorized company official. Manufacturer's warranty is in addition to, and not a limitation of, other rights Owner may have under the Contract Documents.

1. Warranty Period:

- a. Panel Integrity: 10 years commencing on Date of Substantial Completion.
- b. Finish: 10 years commencing on Date of Substantial Completion.

PRODUCTS

13.8 Composite Fire resistive metal panels

13.8.1 Manufacturer: Mitsubishi Plastics Composites America, Inc.

13.9 Product Substitutions

13.9.1 Substitutions: No substitutions permitted.

13.10 Composite Metal Panel Materials

13.10.1 ALPOLIC/fr Composite Fire Resistive Metal Panels:

- 1. Panel Thickness: 4 mm.
- 2. Core: Thermoplastic core material with inorganic fillers that meets performance characteristics specified when fabricated into composite assembly.
- 3. Face Sheets: Aluminum alloy 3105 H14 and as follows:
 - a. Coil coated with a fluoropolymer paint finish that meets or exceeds values expressed in AAMA 2605 where relevant to coil coatings.
 - b. Spray coated with specified finish (quantities less than 7500 ft² (700 m²)).
- 4. Bond Integrity: Tested for resistance to delamination as follows:
 - a. Peel Strength (ASTM D1781): 22.5 in-lb/in (100 N-m/m) minimum.
 - b. No degradation in bond performance after 8 hours of submersion in boiling water and after 21 days of immersion in water at 70 degrees F (21 degrees C).
 - c. Thermally bonded to the core material in a continuous process under tension.
- 5. Fire Performance:
 - a. Flamespread, ASTM E84: <25.
 - b. Smoke Developed, ASTM E84: <450.
 - c. Surface Flammability, Modified ASTM E108: Pass.
 - d. Ignition Temperature:
 - 1) Flash, ASTM D1929: 716 degrees F (380 degrees C).
 - 2) Ignition: 752 degrees F (400 degrees C).
 - e. Flammability, Exterior, Non-load-bearing wall assemblies and panels, NFPA 285: Pass.
- 6. Product Transparency:
 - a. Provide a Product Transparency Declaration (PTD) for the Composite metal panels

13.10.2 Production Tolerances:

- 1. Width: +/- 2.0 mm.
- 2. Length: +/- 4.0 mm.

3. Thickness (4 mm Panel): +/- 0.008 inch (0.2 mm).
4. Thickness (6 mm Panel): +/- 0.012 inch (0.3 mm).
5. Bow: Maximum 0.5% length or width.
6. Squareness: Maximum 0.2 inch (5.1 mm).
7. Edges of sheets shall be square and trimmed with no displacement of aluminum sheets or protrusion of core material.

13.11 Accessories

- 13.11.1 General: Provide fabricator's standard accessories, including fasteners, clips, anchorage devices and attachments for specific applications indicated on contract documents.

13.12 Related Materials

- 13.12.1 General: Refer to other related sections in Related Sections paragraph specified herein for related materials, including coldform metal framing, flashing and trim, joint sealers, aluminum windows, glass and glazing and curtain walls.

13.13 Fabrication

- 13.13.1 General: Shop fabricate to sizes and joint configurations indicated on drawings.
1. Where final dimensions cannot be established by field measurements, provide allowance for field adjustment as recommended by the fabricator.
 2. Form panel lines, breaks and angles to be sharp and true, with surfaces that are free from warp or buckle.
 3. Fabricate with sharply cut edges and no displacement of aluminum sheet or protrusion of core.

13.14 Finishes

- 13.14.1 Factory Finish: Lumiflon-based fluoropolymer resin coating that meets or exceeds values expressed in AAMA 2605 where relevant to coil coatings.
1. Color: Prismatic Champagne ME010

13.15 Source Quality

- 13.15.1 Source Quality: Obtain composite panel products from a single manufacturer.

EXECUTION

13.16 Manufacturer's Instructions

- 13.16.1 Compliance: Comply with manufacturer's product data, including product technical bulletins, product catalog installation instructions and product carton instructions.

13.17 Examination

- 13.17.1 Site Verification of Conditions: Verify that conditions of substrates previously installed under other sections are acceptable for product installation.

13.18 Preparation

- 13.18.1 Surface Preparation: -

13.19 Installation

13.19.1 General:

1. Install panels plumb, level and true in compliance with fabricator's recommendations.
2. Anchor panels securely in place in accordance with fabricator's approved shop drawings.
3. Comply with fabricator's instructions for installation of concealed fasteners and with provisions of Section 07 90 00 for installation of joint sealers.
4. Installation Tolerances: Maximum deviation from horizontal and vertical alignment of installed panels: 0.25 inch in 20 feet (6.4 mm in 6.1 m), noncumulative.

13.19.2 Related Products Installation Requirements: Refer to other sections in Related Sections paragraph herein for installation of related products.

13.20 Field Quality Requirements

13.20.1 Field Quality Control: Comply with panel system fabricator's recommendations and guidelines for field forming of panels.

13.20.2 Fabricator's Field Services: Upon Owner's request, provide fabricator's field service consisting of product use recommendations and periodic site visit for inspection of product installation in accordance with fabricator's instructions.

1. Site Visits: As requested by owner

13.21 Adjusting

13.21.1 Adjusting:

1. Repair panels with minor damage such that repairs are not discernible at a distance of 10 feet (3 m).
2. Remove and replace panels damaged beyond repair.
3. Remove protective film immediately after installation of joint sealers and immediately prior to completion of composite metal panel work.
4. Remove from project site damaged panels, protective film and other debris attributable to work of this section.

13.22 Cleaning

13.22.1 Cleaning: Remove temporary coverings and protection of adjacent work areas. Repair or replace damaged installed products. Clean installed products in accordance with manufacturer's instructions prior to owner's acceptance. Remove construction debris from project site and legally dispose of debris.

13.23 Protection

13.23.1 Protection: Protect installed product's finish surfaces from damage during construction.

1. Institute protective measures as required to ensure that installed panels will not be damaged.

14. ROOFING

14.1 Scope

- 14.1.1 This Section deals with steel profiled sheeting used as external weather-proof cladding of roofs.

14.2 Roof Cladding

- 14.2.1 Sheet type: Spandek hiten roofing sheets manufactured by John Lysaght, No.18 Benoi Sector, Jurong, Singapore 2262 or equivalent.
- 14.2.2 Structural support: timber sections as per drawings.
- 14.2.3 Fastening: No. 12-14x45mm hexagonal head self-drilling and tapping screw seal.
- 14.2.4 End laps: 200mm and should be sealed with a recommend sealant for pitches below 7 degrees.
- 14.2.5 Side laps: as per manufacturer's recommendations.

14.3 Products

- 14.3.1 The profiled sheeting shall be in galvanized sheet steel with a factory per finished protective PVC film with colour to approval.

14.4 Workmanship

- 14.4.1 Accessories: Flashing, trims, filler pieces, spacers, tapes, sealant, etc. where not specified to be the types recommended by the sheet manufacturer.
- 14.4.2 Fastening: Select types and location of fastenings to meet the following requirements.
- 14.4.2.1 Wind suction loaded: Calculate in accordance with CP 3: Chapter5: Part2 , making due allowance for any internal pressure.
- Basic wind speed: 45 m/sec.
 - Topography factory S1 : 1.0
 - Ground roughness, building size and height Factory (S2) : as determined from CP3:Chapter5 : Part 2, Table 3.
 - Statistical factor (S3) : 1.0
- 14.4.3.2 Imposed loads other than wind and maintenance load, 1.5 KN/m² concentrated on a 300mm² which ever produces the greater stress. Maintenance point load: 0.9 KN concentrated on any 125mm².
- 14.4.3.3 Dead load: allow for self-weight of sheeting.
- 14.4.3.4 Roof pitch: as indicated on drawings.
- 14.4.3.5 Distance between not less than 900mm or as indicated on the drawings.

14.5 Fixing

- 14.5.1 Quality of Work: Handle and store to preserve surface using clean dry gloves. Do not slide sheets over rough surface or each other. Packs of all sheets must be kept dry in transit and stored clear of the ground under cover to prevent water and /or condensation being trapped between adjacent surfaces. If packs become wet, sheets should be separated, wiped with a clean cloth without delay and placed so that air circulation completes the drying process.
- 14.5.2 Structure: Check that structure is in a suitable state to receive sheets before commencing fixing. Contractor must confirm acceptance to consultant
- 14.5.3 Structure: Do not fix profiled sheeting until final coats of paints have been applied to outer surfaces of supporting structure.
- 14.5.4 Isolating Tape: Apply to those surfaces of supports which would otherwise be in contact with sheeting or accessories after fixing.
- 14.5.5 Cutting and drilling:
 - 14.5.5.1 Cuts sheets accurately with clean, true lines and no distortion with a power saw with abrasive cutting disc.
 - 14.5.5.2 Cut openings in sheet for out lets, vent pipes , flues etc. to the minimum size necessary . Reinforce edges of openings with structural members.
 - 14.5.5.3 Drill all holes. Position at regular intervals in straight lines. Holes for primary fastenings to be 1.5mm larger than the diameter of fastening unless self-drilling type is used.
 - 14.5.5.4 Remove burrs, drilling swarf, lubricant, dust and any other foreign matter before finally fixing sheets into position.
- 14.5.6 Direction of Laying: Lay sheets with exposed joints of side lap away from prevailing wind.
- 14.5.7 End Laps: to be fully supported.
- 14.5.8 Sealant:
 - 14.5.8.1 Install to manufactures recommendation.
 - 14.5.8.2 Position in straight, unbroken lines parallel to edges of sheets. Placed into corrugations. Do not allow to sag into position.
 - 14.5.8.3 Ensure continuity and effectiveness of seal, especially at corners of sheets.
 - 14.5.8.4 Do not over compress.

14.6 Fittings and Features

- 14.6.1 Profile Fillers: use where specified and wherever necessary to close off corrugation cavities from the outside and inside of the building. Position on the line of, or above, fastening and ensuring a tight fit and leaving no gaps. Where sealed laps are specified bed profile fillers in sealant on top and bottom surface, but do not obstruct channels for ventilation or condensation drainage.
- 14.6.2 Flashing Trims: All fittings for flashing / trim shall be as per manufacturers' recommendation and lapped at joints as follows:
 - 13.6.2.1 Vertical and sloping flashing / trims: end lap to be the same as for adjacent sheeting.
 - 13.6.2.2 Horizontal flashing / trims: end laps to be 150mm and sealed.

14.6.3 Gutter: Ensure that gutters are fully supported at each joint and at intermediate position not more than 900mm apart. Fix with spigot ends up the slope and make all the joints fully watertight. Position sheeting to leave a clear width across the gutter of not less than 230mm.

14.6.4 Insulation:

- 75mm thick Rock Wool insulation blanket with aluminium foil backing on both sides laid between purlins at 1000 centres, including wire mesh. Manufacturer and reference - to approval.

15. FINISHES

15.1 General

- 15.1.1 Glazed Ceramic Tile shall comply with British Standard specification No. 1281 and shall be approved sizes as shown on Drawings and the product of a reputable manufacturers approved by the Consultant.
- 15.1.2 Unglazed Ceramic Tile shall comply with the requirements of British Standard No.1286 and shall be of approved sizes as shown on the drawings and the product of a reputable manufacturer.

15.2 Manufacturers

- 15.2.1 All tiles, ceramic or homogenous, for the project shall be manufactured as mentioned on finishing schedule / details drawings. Required brands of tile shall be use only described locations and tile brands shall not change if only approved by consultant.
- 15.2.2 Following brands of tiles shall use for described locations as per finishing schedule / details drawings. All the tiles shall be submitted to Consultant for approval prior to use.
- Niro
 - Cotto
 - Lanka tile
 - White horse

15.3 Ceramic and Vitreous Tile Materials

15.3.1 Ceramic and Vitreous clay Wall Tiles:

- 15.3.1.1 All tiles for wall installation shall be have cushion edge, impervious, polished or semi-polished porcelain and highly glazed surface. Colours shall be as selected by the Consultant and shall include trimmers, corner pieces, bullnose and all other special shapes indicated or required. All this shall be free from flaws, cracks and crazing.

15.3.2 Floor Ceramic and Vitreous Tiles

- 15.3.2.1 All porcelain floor tiles should exhibit required texture as indicated or required (polished, semi-polished, no skid or heavy duty) and it should be laid with 3mm groove. Floor tiles shall be specially prepared for floor use but shall have all the qualities of ceramic tiles listed above for wall use.

15.4 Flooring

15.4.1 Vinyl flooring:

- 15.4.1.1 Marbleised, directional vinyl sheet and tile flooring with extra strong polyurethane reinforcement with a subtle blend of light through to dark tones. All vinyl flooring, homogenous or permanently static dissipative pressed, shall be utilised at specified locations as indicated in the drawing. It shall have the required thickness as indicated in the drawing and shall include coving, cover formers, end cap strip on coving top.

- 15.4.1.2 Following brands of vinyl flooring shall use for described locations as per finishing schedule / details drawings. All types of vinyl flooring shall be submitted to Consultant for approval prior to use.
- Tarkett (United States of America)
 - Objectflor Art and Design GmbH covering (Germany)
- 15.4.2 Carpeting:
- 15.4.2.1 Both loop and cut pile plain fiber carpets must meet the requirements of EN 1307 and should be 100% permanent colour polypropylene having a 5mm underlay with imported grippers. It shall include aluminium single side edging and must be soil and stain resistant.
- 15.4.2.2 Following brands of carpets shall use for described locations as per finishing schedule / details drawings. All types of carpets shall be submitted to Consultant for approval prior to use.
- danfloor (United Kingdom)
 - Forbo flooring systems (Switzerland)
- 15.4.3 Cement Flooring:
- 15.4.3.1 Thin section cement render (2-4 mm thick per coat) shall be used as cement rendering over bricks and/or blocks to achieve a modern rendered finish and shall possess high water resistance. Following brands of cement render shall use for described locations as per finishing schedule / details drawings. All types of cement render shall be submitted to Consultant for approval prior to use.
- SUPA COAT (Australia)
 - Hanson Portland-limestone Cement (Germany)
- 15.4.3.2 Provision of external cement paving of 450mmX450mmX50mm as well as 75mm interlocking paving as indicated in the drawing for external walkways and car port area respectively. Following brands of paving shall use for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.
- PRIORA MARSHALLS (United Kingdom)
- 15.5 Wall papers** Provision of acrylic/vinyl coated wall papers on plastered walls with 100mm high timber skirting. The plastered walls must be kept dry before placing wall papers to ensure proper adherence of wall paper to the wall and also aides for future removal. Following brands of wall papers shall use for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.
- Brewster Home Fashions (United States of America)
 - Mirage Wall coverings (United States of America)

15.6 Wood veneer Wood veneer shall comply with ISO 9001 (Quality Management) and ISO 14001 (Environment Management) and finish up to ceiling level with 100mm timber skirting. Its natural wood surface shall be protected by a proprietary wear-resistant film or coat. Following brands of wood veneers shall use for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.

- Proligna (Prodin-Prodema – Spain)
- Gunlocke (United States of America)

15.7 Ceiling

15.7.1 Suspended Ceilings:

- 15.7.1.1 Suspended aluminium ceilings shall be powder coated with a material, preferably epoxy, polyester or epoxy polyester with the approval of consultant.
- 15.7.1.2 Aluminium concealed clip-in grid ceiling system comprising a “spring T” or ‘A spring” that supports the ceiling tiles. It shall be fixed to and below a primary grid, usually a galvanized channel section as indicated and approved by the Consultant.
- 15.7.1.3 Provision of plain mineral fibre acoustical suspended ceilings with fibres mixed with wet process with a high quality vinyl emulsion paint surface coating.
- 15.7.1.4 Following brands of ceiling types shall use for described locations as per finishing schedule / details drawings. All finishing materials shall be submitted to Consultant for approval prior to use.
- Technical Metal Industrial Co.L.C.C (United Arab Emirates)
 - Hebei Optimum Construction Materials Co., Ltd (China)

15.7.2 Composite Board:

- 15.7.2.1 Zinc Aluminium Composite board with multi-layer Ti-Zinc treated surface protected by fluorocarboned resin paint FEVE. Following brands of crash rails shall be used for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.
- Alucobond (Germany)

15.8 Corner Guards

- 15.8.1 Surface mounted guards consisting of a continuous retainer with snap-on Acrovyn 4000 cover. Color matched end caps to be provided for both partial and full height applications and shall be approved by Consultant.
- 15.8.2 Following brands of corner guards shall be used for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.
- C/S Acrovyn

15.9 Crash Rails

- 15.9.1 Crash rails shall be 150mm wide and comprise of fireproof PVC plastic acrylic cover with aluminium alloy inner-support.

15.10 Partition Walls

- 15.10.1 Provision of Aluminium Composite board partition wall framed with aluminium extrusion, covered by powder coating. The infill panel shall be laminated glass consisting of two layer of normal glass sandwiched with the underlay polyvinyl butyral (PVB) film. This shall be provided at described locations as per finishing schedule / details drawings with excellent sound & thermal insulation as well as 100% water proof and resistant to stains.
- 15.10.2 Tempered glass partition walls at described locations as per finishing schedule / details drawings shall be 12mm thick and insulated properly.
- 15.10.3 All laminated phenolic board partition systems shall be impregnated with melamine resin and decorated on both sides. It must be resistant to damage from impacts or stains, including indelible inks and highly durable.
- 15.10.4 Following brands of partition walls shall be used for described locations as per finishing schedule / details drawings and shall be submitted to Consultant for approval prior to use.
- Reliance Metal Industries Sdn Bhd (Malaysia)
 - MDP Enterprises (India)
 - Hufcor (United States of America)
 - Ironwood Manufacturing (United States of America)

15.11 Mortar Materials

- 15.11.1 Standard brand of light gray or white Portland cement as specified in drawings/Finishing schedule/ BOQ, conforming to current British Standard specifications shall be used.
- 15.11.2 Sand: shall be clean, sharp, river sand, conforming to British Standard Specifications and graded fine to coarse within the following limits: 100% passing 8 sieve, 90% to 100% passing 16 sieve, 60% to 90% passing 30 sieve, 25% to 55% passing 50 sieve and 0% to 15% passing 100 sieve.

15.12 Cement Colour

- 15.12.1 Dry cement colour, chemically inert, non-fading, alkali fast, mineral pigment, as approved shall be used wherever refinished.

15.13 Waterproofing

15.13.1 Floors of toilet areas, corridors and planter boxes shall be treated with an appropriate water proofing coating, approved by the Consultant

15.14 Installation Requirements

15.14.1 As far as possible, tile lay out work should be in such a way that no tiles less than half size occurs.

15.14.2 Align joints in wall tile vertically and horizontally except where other patterns are shown or specified, Align joints in floor tiles at right angles to each other straight with walls to conform to the patterns selected.

15.14.3 Verify locations of accessories before installing tiles. Work shall be coordinated with plumbing and other trades before starting of tile work.

15.14.4 Installation of ceramic and vitreous tile shall be in accordance with manufacturer's instructions.

15.15 Floor Tile Installation

15.15.1 All ceramic and vitreous clay tile floors shall be in Portland cement setting beds. Concrete surfaces shall be cleaned and surface of concrete shall be wetted prior to placing of setting bed mortar. Tiles shall be immersed in water for minimum of 4 hours before laying.

15.15.2 Setting Bed Mortar Mix: shall consist of one (1) part Portland cement and two (2) parts dry sand, by volume, to which not more than 1/10 part of hydrated lime may be added.

15.15.3 When mixed with water, the mortar mix shall be of such consistency and workability as to produce maximum density. Determine consistency by stroking the mortar surface with a trowel. Where of correct consistency, the trowelled surface readily assumes a smoothed, slickened appearance.

15.15.4 Spread setting bed mortar and screed to provide smooth, dense beds with true planes pitched to drains. The thickness of bed shall be such that the floor tile will finish flush with adjacent finished flooring, but bedding shall have average thickness of 38mm.

15.15.5 After bed has set sufficiently to be worked over, trowel or brush a thin layer, 3mm in thickness, of neat Portland cement or special tile adhesive (approved by Consultant) paste over the surface of the back of tile.

15.15.6 Do not prepare larger setting bed than can be covered with tile before the mortar sets.

15.15.7 Press tile firmly into the bed tapping with wood blocks to obtain firm bedding of total tile area and a smooth top surface.

15.15.8 All tiles shall be properly aligned with straight joints in even widths. Joints width shall be determined by spacers on ceramic tiles. Tamping shall be completed within one (1) hour after placing tile. Adjust work out of line within this period.

15.15.9 Tiles shall be fitted closely around pipes running through walls and floors. Pitch floors to drains.

15.16 Wall Tile Installation

- 15.16.1 Base Plaster 13mm thick applied to masonry wall shall be one-part Portland cement, three-parts of river sand by volume. Where additional thickness build-up is required to conform to indicated lines, apply as separate coat at no cost to employer.
- 15.16.2 Setting bed of tiles shall be done with cement slurry or special tile Adhesive (approved by Consultant). The thickness of slurry bed shall be 3mm thick minimum for setting tiles and walls.
- 15.16.3 Installation of tiles shall be in accordance with standards and applicable requirements previously specified for floor tile.
- 15.16.4 Tiles shall be installed in perfect vertical plumb and as per the pattern and joints if shown on drawings

15.17 Grouting

- 15.17.1 Grouting shall not commence for at least 24 hours after placing of tiles.
- 15.17.2 Grout for floor and wall ceramic and vitreous tiles shall be waterproof, neat white Portland cement with dry cement colour added as directed by the Consultant. If white grout is selected, cement shall be white.
- 15.17.3 Grout mixed to a creamy consistency in accordance with manufacturer's directions shall be used for joint filling. Maximum width of joints shall be 3mm.
- 15.17.4 Force maximum grout into the joints with trowel. Before grout sets, strike or tool joints to base of cushion and fill all skips and gaps. Do not permit setting bed materials to show through grouted joints.
- 15.17.5 Cure grout joints by maintaining damp condition for three (3) days by sponging down, or other methods approved by the Consultant. Allow floors to set 48 hours before permitting ordinary foot traffic.

15.18 Defects in Tiles and Tile Laying

- 15.18.1 The surface of all tiled floors shall be perfectly in level and shall be executed by experienced workers in the field of tile laying.
- 15.18.2 A sample panel of laid tiles of each type shall be approved by the Consultant before commencement of tile laying.
- 15.18.3 Mismatches of colour, chipped or damaged tiles installed by the Contractor shall be rejected and shall have to be replaced by the Contractor at his own cost and risk.
- 15.18.4 Mismatches of colour in tiles installed by the Contractor shall be rejected and shall have to be replaced by the Contractor at his own cost and risk.

15.19 Guarantees

- 15.19.1 Manufacturer shall provide his standard guarantees for work under this section. However, such guarantees shall be in addition to not in lieu of all other liabilities which manufacturers and Contractor may have by other provisions of the Contract Documents.

16. PAINTING

16.1 Material

16.1.1 All paints shall be approved by the Consultant for colour, quality and type. All painting work shall be carried out in accordance with the paint manufacturer's specifications unless otherwise directed by the Consultant.

16.1.2 All paints and finishes used for the project shall be manufactured by or under license from the following manufacturer;

Nippon Paints (Japan)

Imperial Chemical Industries (UK)

Sigma Paints (Saudi Arabia)

Paints from manufacturers not listed above shall only be used with prior written approval of the Consultant

16.1.3 Paint shall be ready mixed and all paints, varnishes, enamels, lacquer stains, paste fillers and similar materials shall be delivered to the site in the original containers with the seals unbroken and labels intact. Each container shall give the manufacturer's name, type of paint, colour of paint and instructions for reducing. Thinning shall be done only in accordance with the manufacturer's directions.

16.1.4 Use of product by the same manufacturer shall be a general rule in each stage of work in this Specification.

16.1.5 Colour, luster, colour scheme, finish shall be decided by the Consultant after checking sample paint test.

16.1.6 The painting shall be performed by experienced and competent painter.

16.1.7 Where walls are specified to be painted, all columns, arches, grooves, rough surfaces, reveals, soffits and returns, etc. shall be included and no extra shall be payable.

16.2 Definition of Terminology

16.2.1 Surface Sealing

Surface to be painted shall be sealed to have uniform suction and prevent lye from oozing out.

16.2.2 Spot Puttying

All cracks and depressions shall be filled flush with putty.

16.2.3 Puttying

All surfaces to be painted shall be puttied uniformly flat surface.

16.2.4 Spot painting

Spot puttied area shall be touched up by paint

16.2.5 Touch-up

Any damaged area after the prime coat has been applied shall be touched up

16.2.6 Drying hour

The drying time of double-coated paint shall be measured at the temperature of 20°C and humidity of 70%.

16.2.7 Amount of paint

The amount shall be standard amount of paint itself not including thinner. It shall increase or decrease depending on shape and surface condition in the process of painting.

16.3 Paint Finish Symbols

| | |
|--------------|---|
| OP | Synthetic resin mix paint finish |
| VP | Solvent-polyvinyl chloride resin paint finish |
| EP | Polyvinyl acetate resin emulsion paint finish |
| AEP | Synthetic resin emulsion paint finish |
| CL | Clear lacquer finish |
| EXP | Epoxy resin paint finish |
| Stipple (OP) | Stippled finish (oil mix paint finish) |
| Stipple (EP) | Stippled finish (polyvinyl acetate resin emulsion paint finish) |

16.4 Painting in General

16.4.1 Preparation of Paint

- 17.4.1.1 Mixing: Paint content with pigment shall be thoroughly stirred to make a uniform consistency.
- 17.4.1.2 Thinning: Portable water shall be used for thinning of emulsion paint and water-soluble paint. Proper thinner, product of the same manufacturer as paint, as a rule, shall be used for other types of painting. Percentage of thinning and viscosity shall be conducted with direction of manufacturer or catalogue as they vary with the method of paint, temperature, type of material to be painted.
- 17.4.1.3 Allowable period of Use: Paint mixed with more than 2 types shall be used with direction of a manufacturer or catalogue as allowable period of use, mixing ratio and mixing method vary. The paint which has passed allowable period of use shall not be used.

16.4.2 Conditions of Painting

- 16.4.2.1 Work shall not be executed in the following situations
 - 16.4.2.1.1 When humidity is above 85%
 - 16.4.2.1.2 When raining or it is forecast
 - 16.4.2.1.3 When dusts are present
 - 16.4.2.1.4 When temperature of surface is high under hot weather and bubbles are likely to develop on the painted surface.
- 16.4.2.2 Conditions of Surface to be painted: Work shall not be executed or proper means shall be taken in the following situations.
 - 16.4.2.2.1 When surface is damp and wet
 - 16.4.2.2.2 When condensation is likely to develop on the surface.
 - 16.4.2.2.3 All nail holes on veneer, board, etc., shall be covered with proper rust-proof paint before the subsequent painting is applied in accordance with this specification.

16.4.3 Performance

Paint shall be evenly and uniformed applied on the surface. Areas of difficult application such as pointed part, internal angle, welded part, etc. shall be thoroughly painted and double coated as necessary to deep uniform coating thickness.

Painting shall be properly done by carefully selecting the painting method by the shape of surface and types of paint.

16.4.4 Protection

17.4.4.1 Dangerous material such as paint, thinner, etc., excluding emulsion paint and water-soluble paint shall be kept in accordance with regulations concerned.

16.5 Procedure of Painting

16.5.1 Exterior - Surface of Mortar, Plaster and Concrete

AEP- Weather shield Exterior paint

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|---|-------------------------------------|
| 1. Surface preparation | | Dry, clean and free from impurities | |
| 2. Surface sealing | 1 | Exterior Wall Sealer | As per manufacture's specifications |
| 3. Texture base | 2 | texture base putty mechanically sprayed uniformly | As per manufacture's specifications |
| 4. Surface finishing | | Flatten with masonry trowel uniformly surfaced | |
| 5. First coating | 1 | Weather shield paint | As per manufacture's specifications |
| 6. Finish coating | 2 | Weather shield paint | As per manufacture's specifications |

Notes:

Degree of dryness on the surface to be painted shall be kept under 6% in water content and below PH 9.5

Puttying and sanding process shall allowed to omit depending on the conditions of the surface.

Drying time of putty shall be long enough for sanding to proceed.

Amount of sealer for surface sealing shall be adjusted with direction of the Consultant as it varies with the surface conditions.

16.5.2 Exterior - Iron Products in General

OP - Synthetic resin mix paint

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------------|--------------|--|-------------------------------------|
| 1. Surface preparation | | Completely remove rust, moisture, oil and other impurities by sander, cleaner and surface. | |
| 2. First Coating 24 hours | 1 | Rust proof oil paint | As per manufacture's specifications |
| 3. Touch-up | | Touch-up rustproof oil paint | |
| 4. First Coating | 1 | Rustproof oil paint | As per manufacture's specifications |

| | | | |
|-------------------|---|---------------------------|-------------------------------------|
| 5. Second coating | 1 | Synthetic resin mix paint | As per manufacture's specifications |
| 6. Finish coating | 1 | Synthetic resin mix paint | As per manufacture's specifications |

Note:

Paint for touch-up painting shall be the same as used for first coat in process No. 2

16.5.3 Exterior - Wood

OP - Synthetic resin mix paint finish

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|-----------------------------------|-------------------------------------|
| 1. Surface preparation | | Clean and sand to plane surface | |
| 2. Knot treatment | 1-2 | Lacquer varnish | As per manufacture's specifications |
| 3. First coating | 1 | First coat paint of oil mix paint | As per manufacture's specifications |
| 4. Second Coating | 1 | Oil mix paint | As per manufacture's specifications |
| 5. Finish coating | 1 | Oil mix paint | As per manufacture's specifications |

Note:

Puttying and sanding shall be done after process No.2 when there are cracks, etc. on the surface putty shall be oil-putty, but drying time shall vary depending on conditions.

16.5.4 Interior - Mortar, board, etc.

Stipple (EP) - Polyvinyl acetate resin emulsion paint finish

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|--|-------------------------------------|
| 1. Surface preparation | | Dry, clean and free from impurities | |
| 2. Surface sealing | 1 | Sealer for emulsion paint | As per manufacture's specifications |
| 3. Puttying | | Putty for emulsion paint | |
| 4. Grinding | | Grind with proper grinding tool | |
| 5. Spot painting | | Second coating paint of polyvinyl acetate resin emulsion paint | |
| 6. Second Coating | 2 | Polyvinyl acetate resin emulsion paint | As per manufacture's specifications |
| 7. Finish Coating | 1 | Polyvinyl acetate resin emulsion paint for stipple-finish | As per manufacture's specifications |

Notes:

Degree of dryness on the surface to be painted shall be kept under 6% in water content and below PH 9.5

Puttying and sanding process shall allowed to omit depending on the conditions of the surface.

Drying time of putty shall be long enough for sanding to proceed.

Amount of sealer for surface sealing shall be adjusted with direction of the Consultant as it varies with the surface conditions.

16.5.5 Interior - Mortar, plaster, concrete, etc.

VP Solvent - Polyvinyl chloride resin paint finish

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|--|-------------------------------------|
| 1. Surface preparation | | Dry, clean and free from impurities | |
| 2. Surface sealing | 1 | Sealer for emulsion paint | As per manufacture's specifications |
| 3. Puttying | | Putty for polyvinyl chloride resin paint | |
| 4. Grinding | | Grind with proper grinding tool | |
| 5. Spot painting | | Solvent-polyvinyl chloride resin enamel emulsion paint | |
| 6. Second Coating | 1 | Solvent-polyvinyl chloride resin enamel emulsion paint | As per manufacture's specifications |
| 7. Finish Coating | 2 | Solvent-polyvinyl chloride resin enamel emulsion paint | As per manufacture's specifications |

Notes:

- (a) Degree of dryness on the surface to be painted shall be kept under 6% in water content and below PH 9.5
- (b) Puttying and sanding process shall allowed to omit depending on the conditions of the surface.
- (c) Drying time of putty shall be long enough for sanding to proceed.
- (d) Amount of sealer for surface sealing shall be adjusted with direction of the Consultant as it varies with the surface conditions.

16.5.6 Interior - Mortar, plaster, concrete, etc.

EP Polyvinyl acetate resin emulsion paint finish

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|--|-------------------------------------|
| 1. Surface preparation | | Dry, clean and free from impurities | |
| 2. Surface sealing | 1 | Sealer for emulsion paint | As per manufacture's specifications |
| 3. Puttying | | Putty for emulsion paint | |
| 4. Grinding | | Grind with proper grinding tool | |
| 5. Spot painting | | Polyvinyl acetate resin emulsion paint | |
| 6. Second Coating | 1 | Polyvinyl acetate resin emulsion paint | As per manufacture's specifications |
| 7. Finish Coating | 1 | Polyvinyl acetate resin emulsion paint | As per manufacture's specifications |

Notes:

- (a) Degree of dryness on the surface to be painted shall be kept under 6% in water content and below PH 9.5
- (b) Puttying and sanding process shall allowed to omit depending on the conditions of the surface.
- (c) Drying time of putty shall be long enough for sanding to proceed.
- (d) Amount of sealer for surface sealing shall be adjusted with direction of the Consultant as it varies with the surface conditions.

16.5.7 Interior - Iron products, steel.

OP - Synthetic resin mix paint

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|------------------------|--------------|---|-------------------------------------|
| 1. Surface preparation | | Completely remove rust, moisture, oil and other impurities by sander, cleaner and surface | |
| 2. First Coating | 1 | Synthetic resin rust-proof. Red lead-type, lead compound-type | As per manufacture's specifications |
| 3. Touch-up | | Touch-up rust proof paint | |
| 4. First Coating | 1 | Synthetic resin rust-proof paint. Red lead-type, Lead compound-type | As per manufacture's specifications |
| 5. Second Coating | 1 | Synthetic resin mix paint | As per manufacture's specifications |
| 6. Finish Coating | 1 | Synthetic resin mix paint | As per manufacture's specifications |

Notes:

- (a) Paint for touch-up painting shall be the same as used for first coat in process No.2
- (b) When oil rust-proof paint is used instead of synthetic resin rust proof, its specification shall conform to No. 5 and No.6.

16.5.8 Floor - Concrete and Mortar

EXP - Epoxy resin paint finish

| Coating Process | No. of Coats | Type of Paint | Drying hour |
|----------------------|--------------|-------------------------------------|-------------------------------------|
| 1. Surface treatment | | Dry, clean and free from impurities | |
| 2. First coating | 1 | First coating paint for epoxy | As per manufacture's specifications |
| 3. Finish Coating | 2 | Epoxy resin paint | As per manufacture's specifications |

Notes:

- (a) Degree of dryness on the surface to be painted shall be kept under 6% in water content and below PH 9.5.
- (b) Amount of paint and number of paint shall be as directed by the Consultant as they vary with the conditions of surface and required thickness of coating.

- (c) Painted surface shall be kept out of use for more than 7 days after application of final coat.

Proposed 18 Classroom at
Sn.Hithadhoo Sharafuddin School
(03 Storey)

ARCHITECTURAL & STRUCTURAL DRAWINGS
Client: Ministry of Education



RIYAN PRIVATE LIMITED


t: +9603315049 f: +9603310776
e: info@riyan.com.mv
w: www.riyan.com.mv
3rd floor, H. Azumi, Ameeeneemagui, Male'

The contents of these drawings remain as a property of Riyan Private Limited. Any use other than those expressly stated is a violation of this copyright

TABLE OF CONTENTS

| DRAWING No. | TITLE | REVISION No. | DATE | REMARKS |
|---------------------------|---|--------------|------|---------|
| A R C H I T E C T U R A L | | --- | --- | --- |
| A - 01 /21 | SITE PLAN | --- | --- | --- |
| A - 02 /21 | GROUND FLOOR PLAN | --- | --- | --- |
| A - 03 /21 | FIRST - SECOND FLOOR PLAN | --- | --- | --- |
| A - 04 /21 | ROOF PLAN | --- | --- | --- |
| A - 05 /21 | ELEVATION E1 | --- | --- | --- |
| A - 06 /21 | ELEVATION E2 | --- | --- | --- |
| A - 07 /21 | SECTION X-X | --- | --- | --- |
| A - 08 /21 | SECTION Y-Y | --- | --- | --- |
| A - 09 /21 | DOOR & WINDOW SCHEDULE - 1 | --- | --- | --- |
| A - 10 /21 | DOOR & WINDOW SCHEDULE - 2 & VENTILATION SCHEDULE | --- | --- | --- |
| A - 11 /21 | GROUND FLOOR - FLOOR FINISHES PLAN | --- | --- | --- |
| A - 12 /21 | FIRST - SECOND FLOOR - FLOOR FINISHES PLAN | --- | --- | --- |
| A - 13 /21 | GROUND FLOOR - REFLECTED CEILING PLAN | --- | --- | --- |
| A - 14 /21 | FIRST FLOOR - REFLECTED CEILING PLAN | --- | --- | --- |
| A - 15 /21 | SECOND FLOOR - REFLECTED CEILING PLAN | --- | --- | --- |
| A - 16 /21 | DETAIL - 1:STAIRCASE DETAILS | --- | --- | --- |
| A - 17 /21 | DETAIL - 2:MAIN ENTRANCE RAMP DETAILS | --- | --- | --- |
| A - 18 /21 | DETAIL - 3:TOILET DETAILS | --- | --- | --- |
| A - 19 /21 | DETAIL - 4:RC FIN DETAILS | --- | --- | --- |
| A - 20 /21 | DETAIL - 5:RAILING DETAILS | --- | --- | --- |
| A - 21 /21 | DETAIL - 6:RC WALL DETAILS | --- | --- | --- |
| S T R U C T U R A L | | --- | --- | --- |
| S - 0 /12 | GENERAL NOTES | --- | --- | --- |
| S - 01 /12 | FOUNDATION PLAN | --- | --- | --- |
| S - 02 /12 | FIRST - SECOND COLUMN LAYOUT PLAN | --- | --- | --- |
| S - 03 /12 | FIRST - SECOND FLOOR BEAM PLAN | --- | --- | --- |
| S - 04 /12 | STORE / HALF LANDING FLOOR BEAM & SLAB REIN. PLAN | --- | --- | --- |
| S - 05 /12 | FIRST - SECOND FLOOR SLAB REINFORCEMENT PLAN | --- | --- | --- |
| S - 06 /12 | ROOF BEAM PLAN - 1 (+9150) | --- | --- | --- |
| S - 07 /12 | ROOF BEAM PLAN - 2 (+9706) | --- | --- | --- |
| S - 08 /12 | ROOF TRUSS AND FRAMING PLAN | --- | --- | --- |
| S - 09 /12 | ROOF TRUSS DETAILS | --- | --- | --- |
| S - 10 /12 | STRUCTURAL DETAILS - 1 | --- | --- | --- |
| S - 11 /12 | STRUCTURAL DETAILS - 2 | --- | --- | --- |
| S - 12 /12 | STRUCTURAL DETAILS - 3 | --- | --- | --- |
| | | | | |

FLOOR PLAN

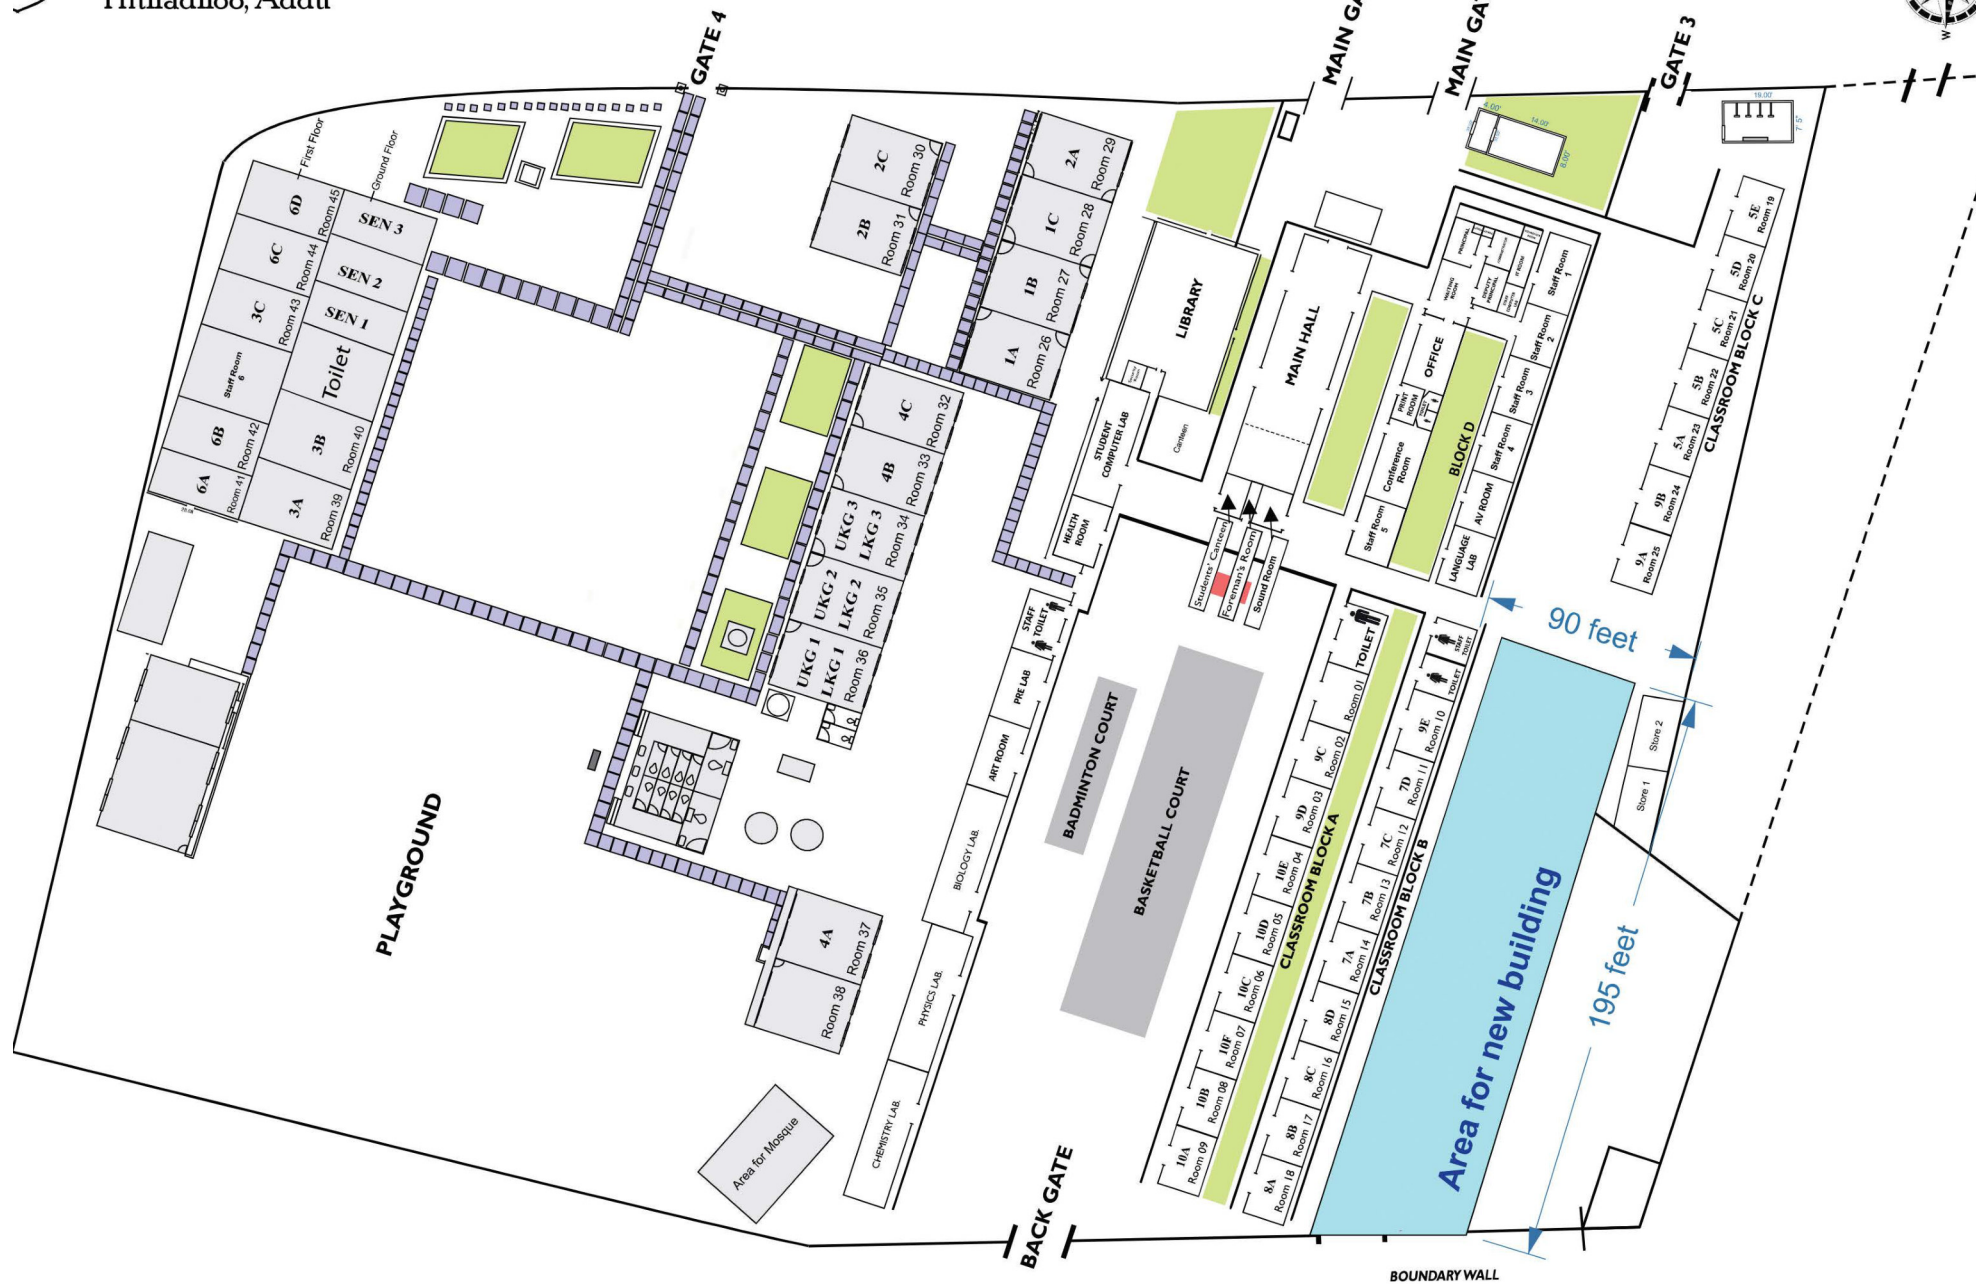

NOTE:



PROPOSED BUILDING LOCATION

EXISTING TREES / VEGETATION NEED TO BE REMOVED AS PER THE SCHOOL

SITE PLAN



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameerneemagu, Male

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education


Project Number: RI/2020/006
Date: January 2021

Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -


| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Site Plan

Page: A-01/21

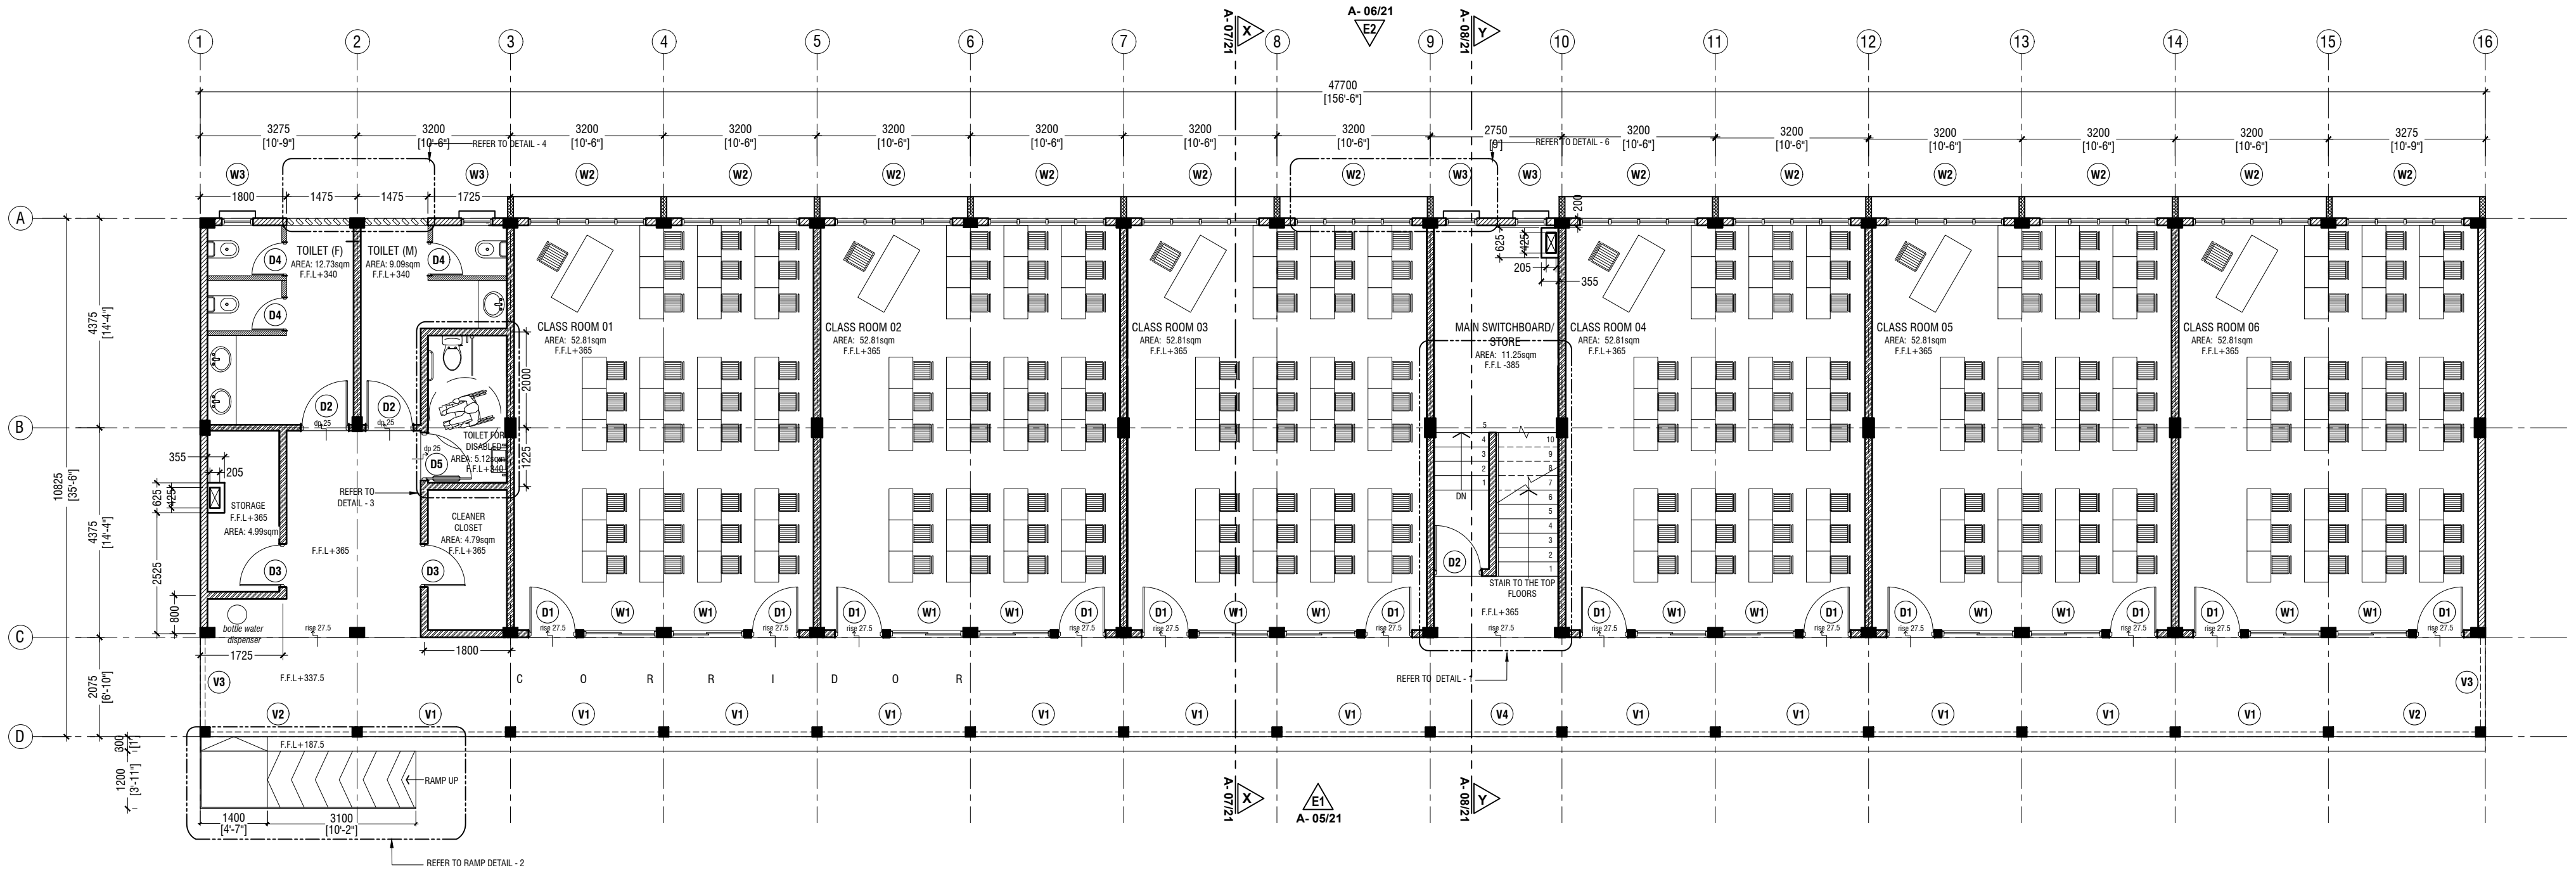

GROUND FLOOR PLAN
SCALE 1:100



NOTE:

- PROPOSED 150mm THICK SOLID BLOCK - INTERIOR MASONRY WALL
WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 150mm THICK SOLID BLOCK - EXTERIOR MASONRY WALL
WITH 20mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 100mm THICK SOLID BLOCK - INTERIOR MASONRY WALL
WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 120mm THICK RC WALL TO BE WATER PROOFED WITH
WATER PROOFING AGENT
- PROPOSED 100mm THICK 2400mm HIGH SOLID BLOCK MASONRY WALL
WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH

THE SCREEDING AND TILES ARE INCORPORATED IN THE FLOOR FINISH
LEVELS

REFER TO ARCHITECT FOR FURTHER ASSISTANCE.

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Ground Floor Plan

Page: A-02/21




RYAN PRIVATE LIMITED

T: +9603370349 F: +9603370776

E: info@ryan.com.mv

W: www.ryan.com.mv

3rd floor, H. Athun, Arneemeeqqu, Male

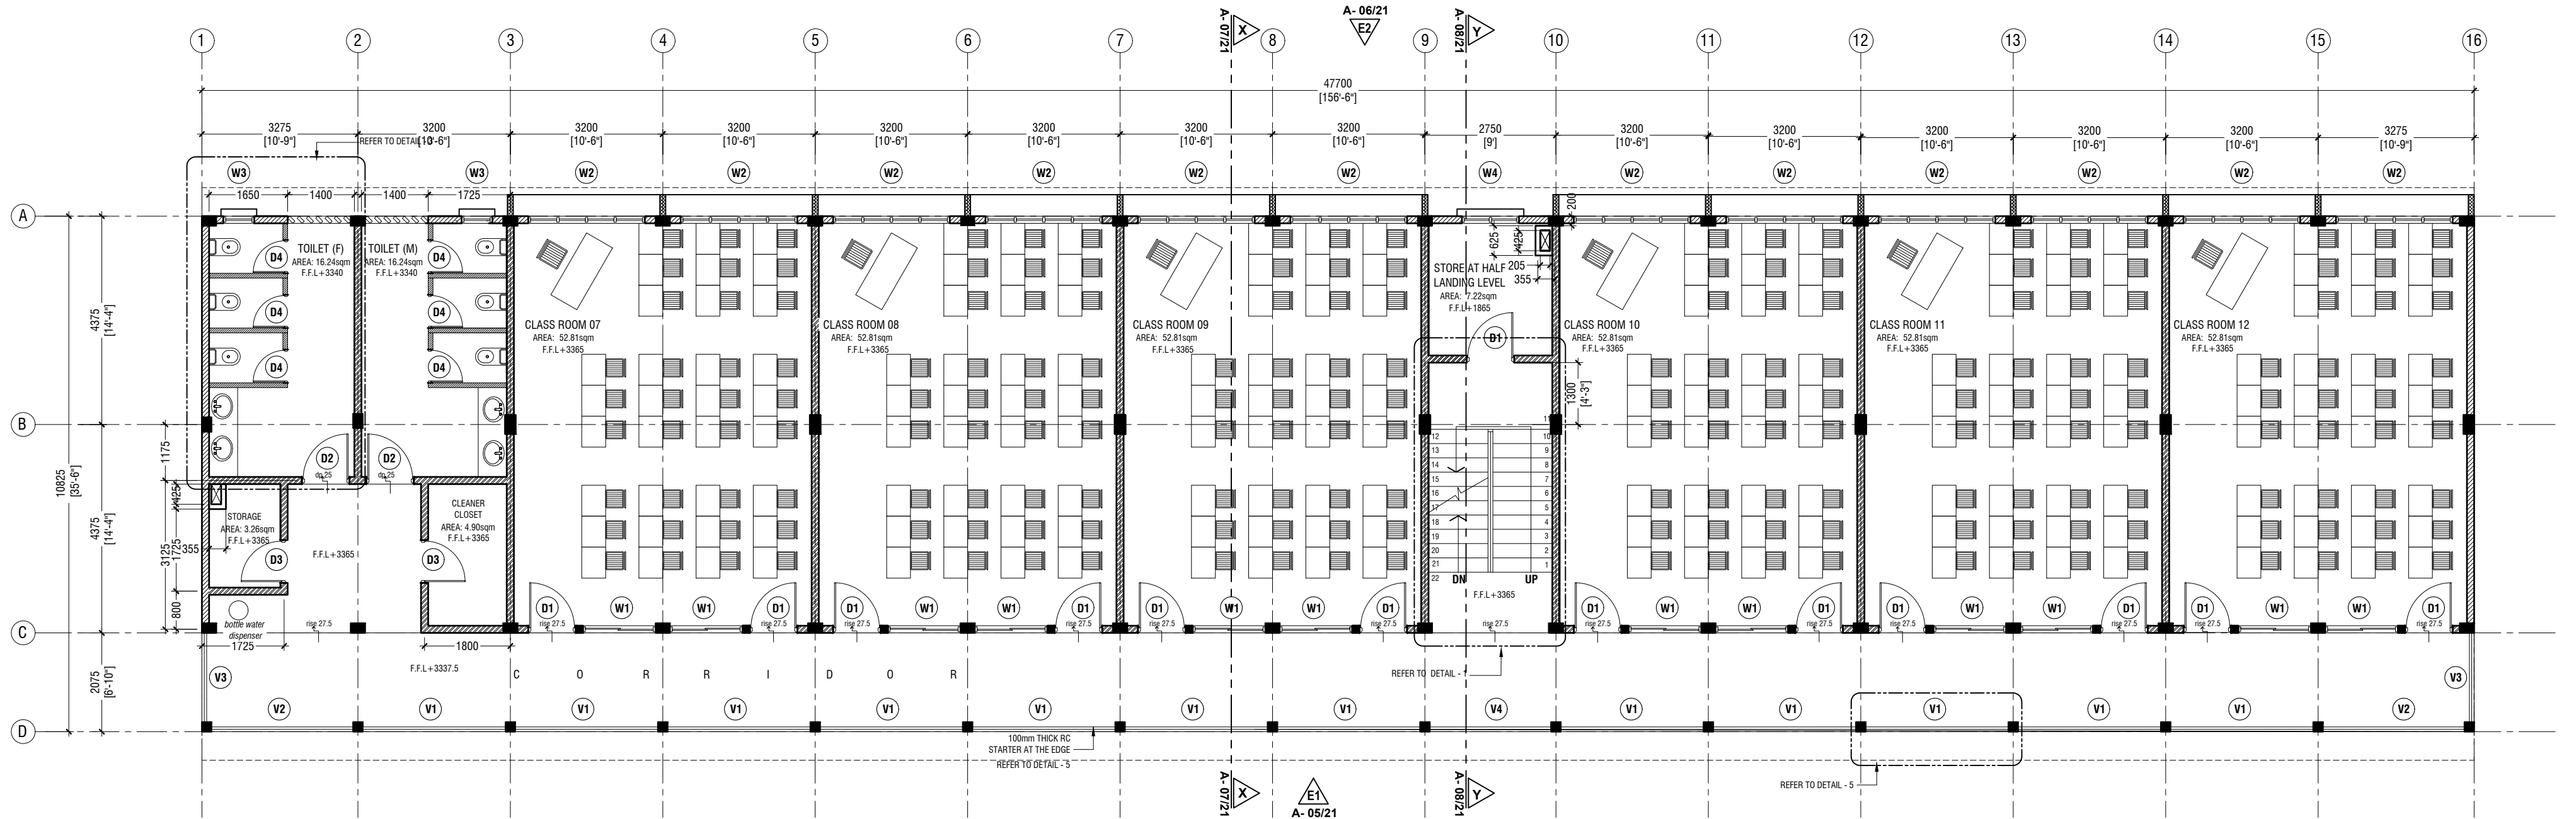

NOTE:

- PROPOSED 150mm THICK SOLID BLOCK - INTERIOR MASONRY WALL WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 150mm THICK SOLID BLOCK - EXTERIOR MASONRY WALL WITH 20mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 100mm THICK SOLID BLOCK - INTERIOR MASONRY WALL WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH
- PROPOSED 120mm THICK RC WALL TO BE WATER PROOFED WITH WATER PROOFING AGENT
- PROPOSED 100mm THICK 2400mm HIGH SOLID BLOCK MASONRY WALL WITH 16mm PLASTERING, GROUND SMOOTH IN SELECTED PAINT FINISH


THE SCREEDING AND TILES ARE INCORPORATED IN THE FLOOR FINISH LEVELS

REFER TO ARCHITECT FOR FURTHER ASSISTANCE.

FIRST - SECOND FLOOR PLAN

SCALE 1:100

0 0.5 1 2 3 4 5



RYAN PRIVATE LIMITED

T: +9603370349 F: +9603370776
E: info@ryan.com.mv
W: www.ryan.com.mv

3rd floor, H. Athun, Arneemeeqqu, Male

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no Date

-- --

-- --


-- --

-- --

-- --

Title: First - Second Floor Plan

Page: A-03/21

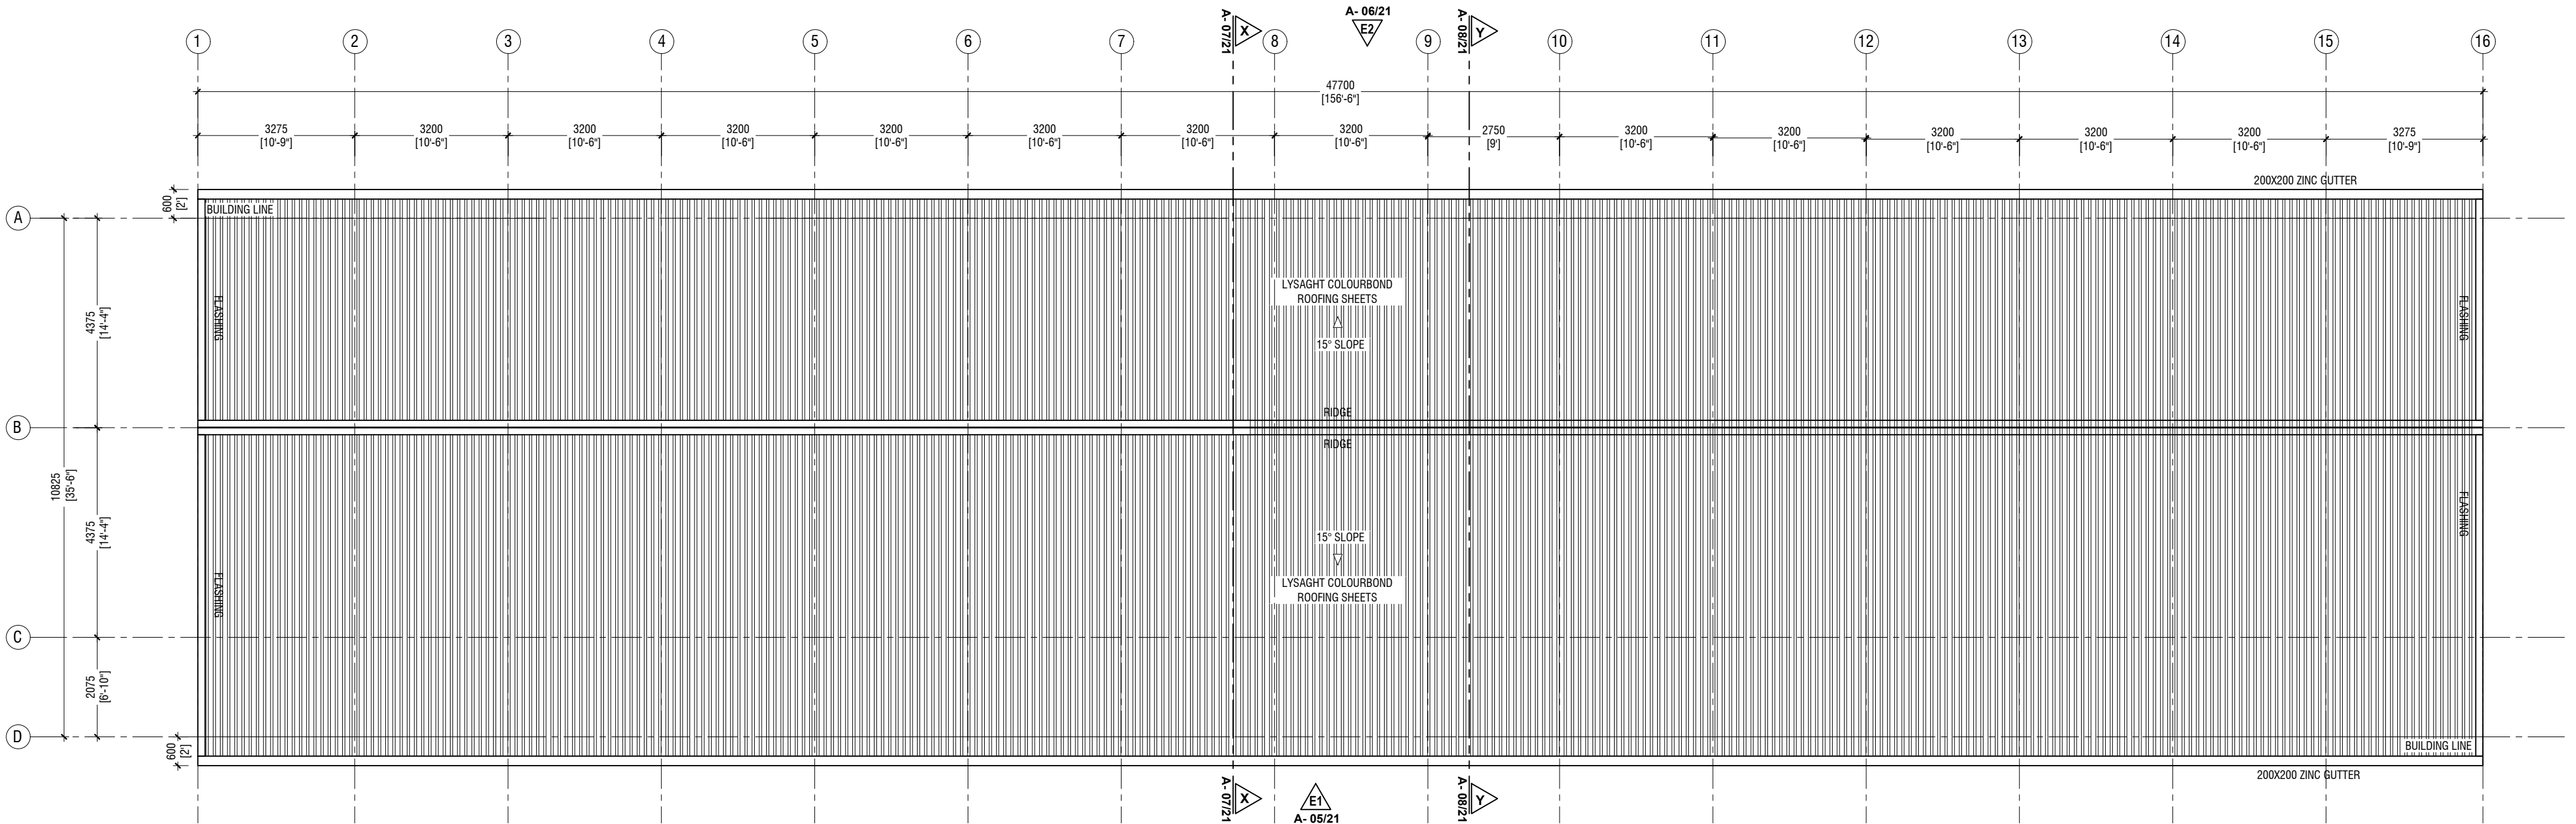

NOTE:

ROOF MATERIAL: LYSAGHT COLOURBOND ROOFING SHEETS
ROOF SLOPE : 15°
ROOF OVERHANG: 600mm

ROOF PLAN

SCALE 1:100

0 0.5 1 2 3 4 5



RIYAN PRIVATE LIMITED
T: +9603370349 F: +9603370776
E: info@riyan.com.mv
W: www.riyan.com.mv
3rd Floor, H. Azumi, Ameermeenqaa, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed


Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Roof Plan

-

Page: A-04/21

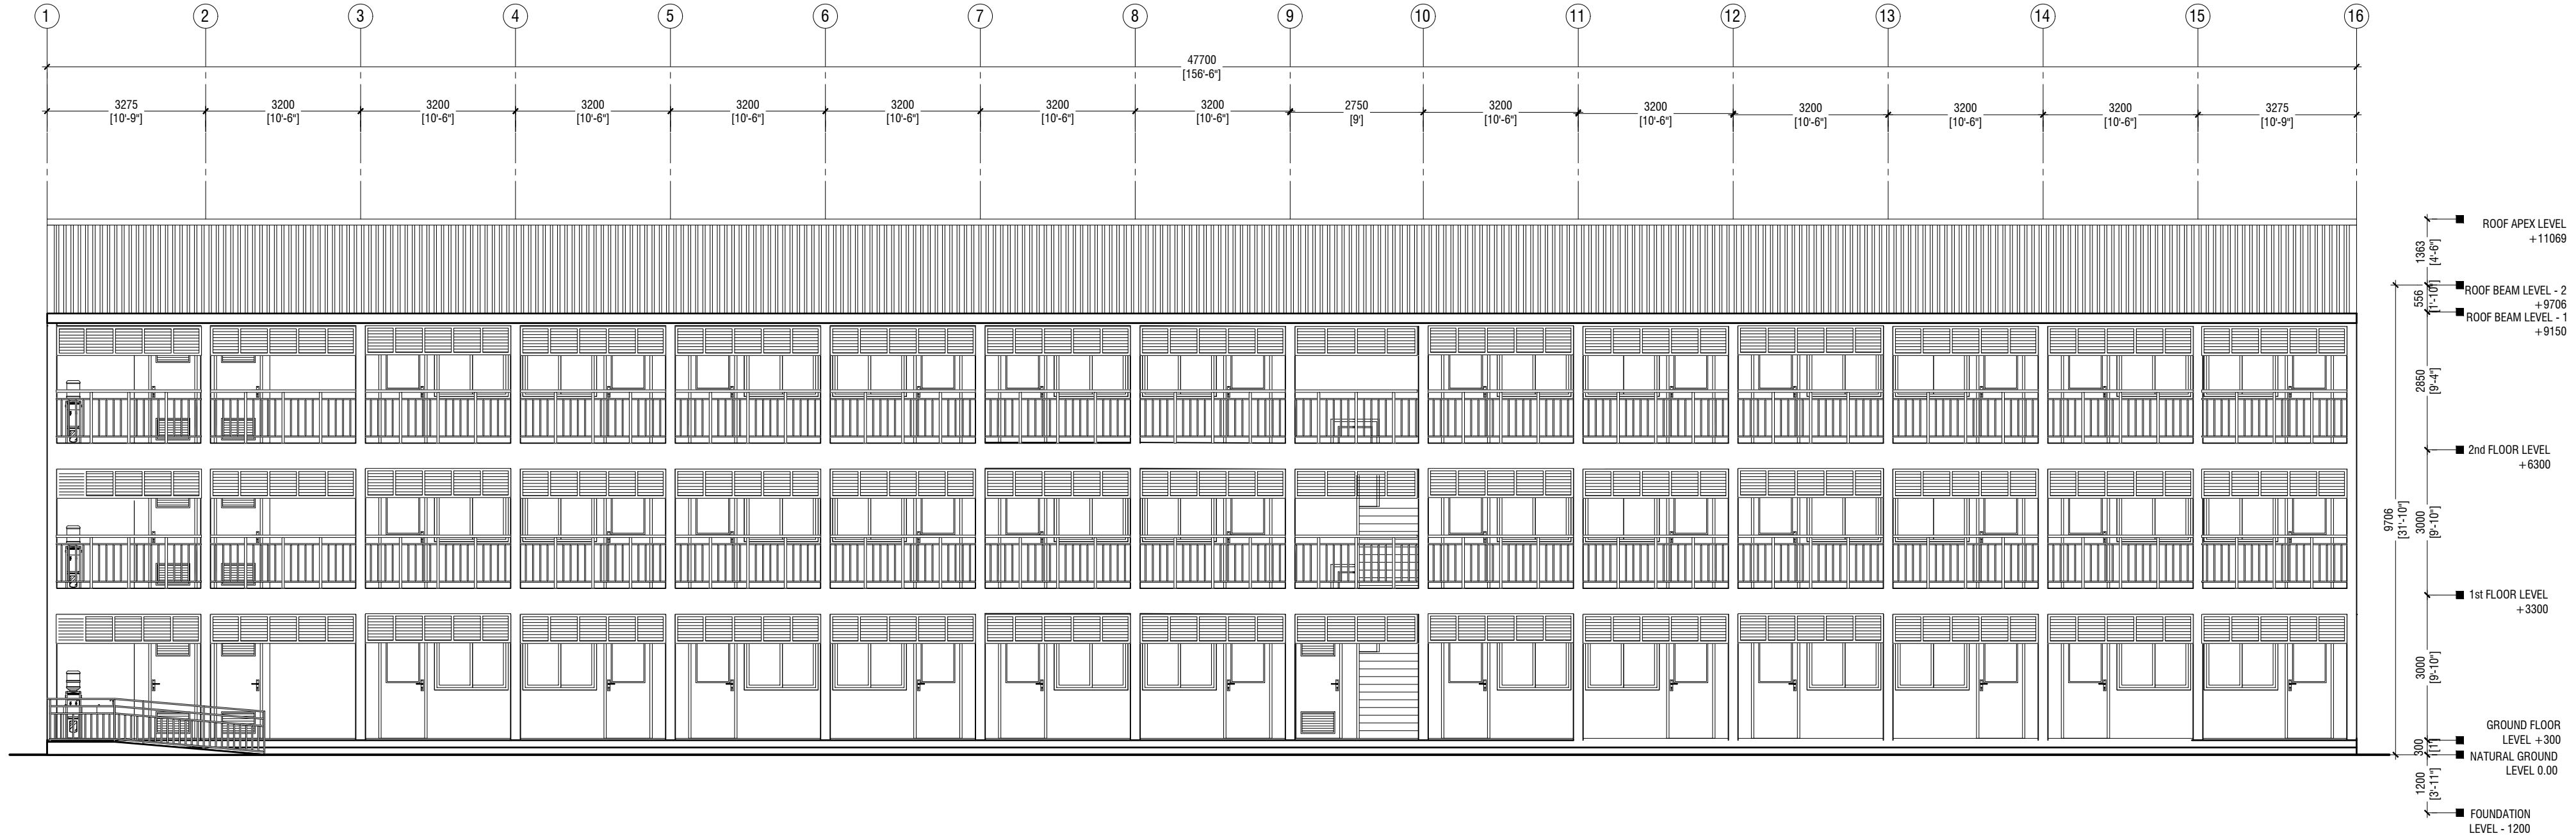

ELEVATION - E1

SCALE 1:100



RIYAN PRIVATE LIMITED

T: +9603370349 F: +9603370776
E: info@riyan.com.mv
W: www.riyan.com.mv
3rd floor, H. Azum, Arneeremaggu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no Date

-- -----

-- -----


-- -----

-- -----

Title: Elevation E1

-

Page: A-05/21

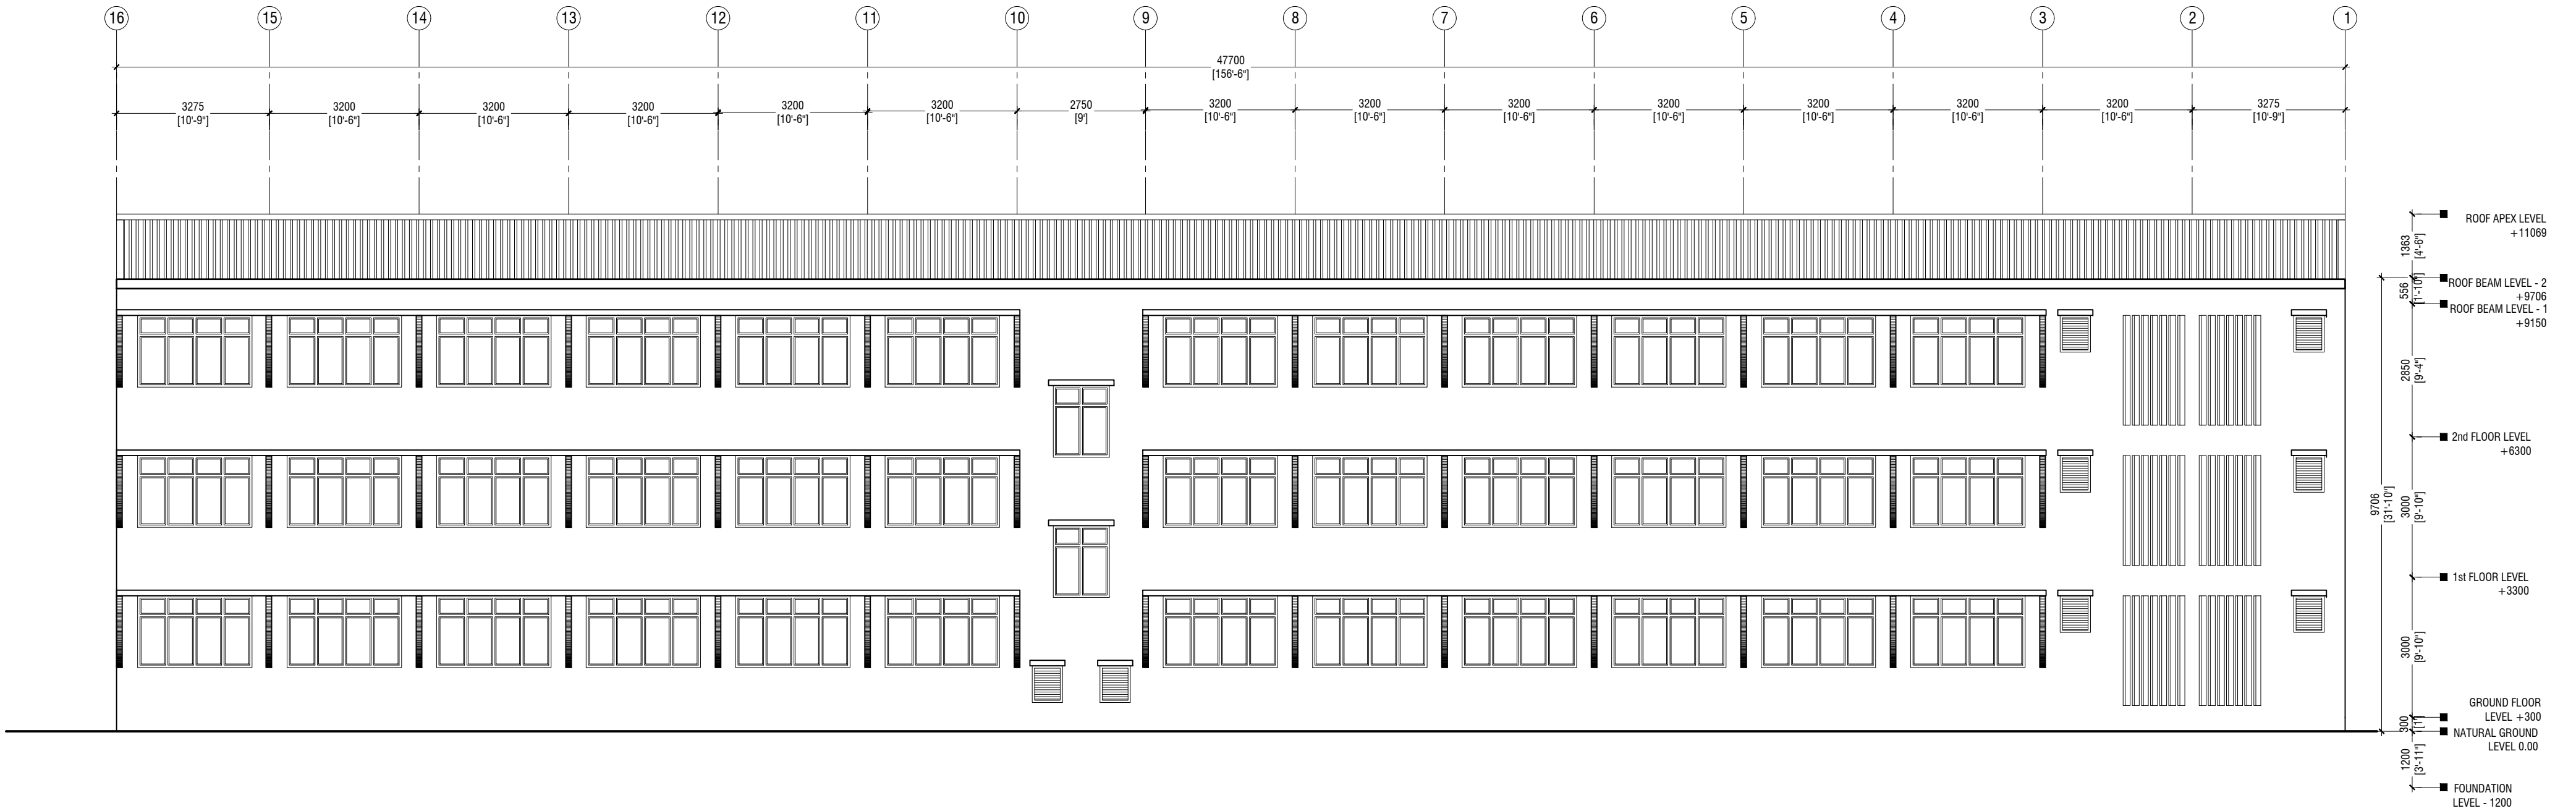

ELEVATION - E2

SCALE 1:100



RYAN PRIVATE LIMITED
T: +9603370349 F: +9603370776
E: info@ryan.com.my
W: www.ryan.com.my
3rd floor, H. Azum, Amereemogga, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no Date

-- -----

-- -----


-- -----

-- -----

Title: Elevation E2

-


Page: A-06/21

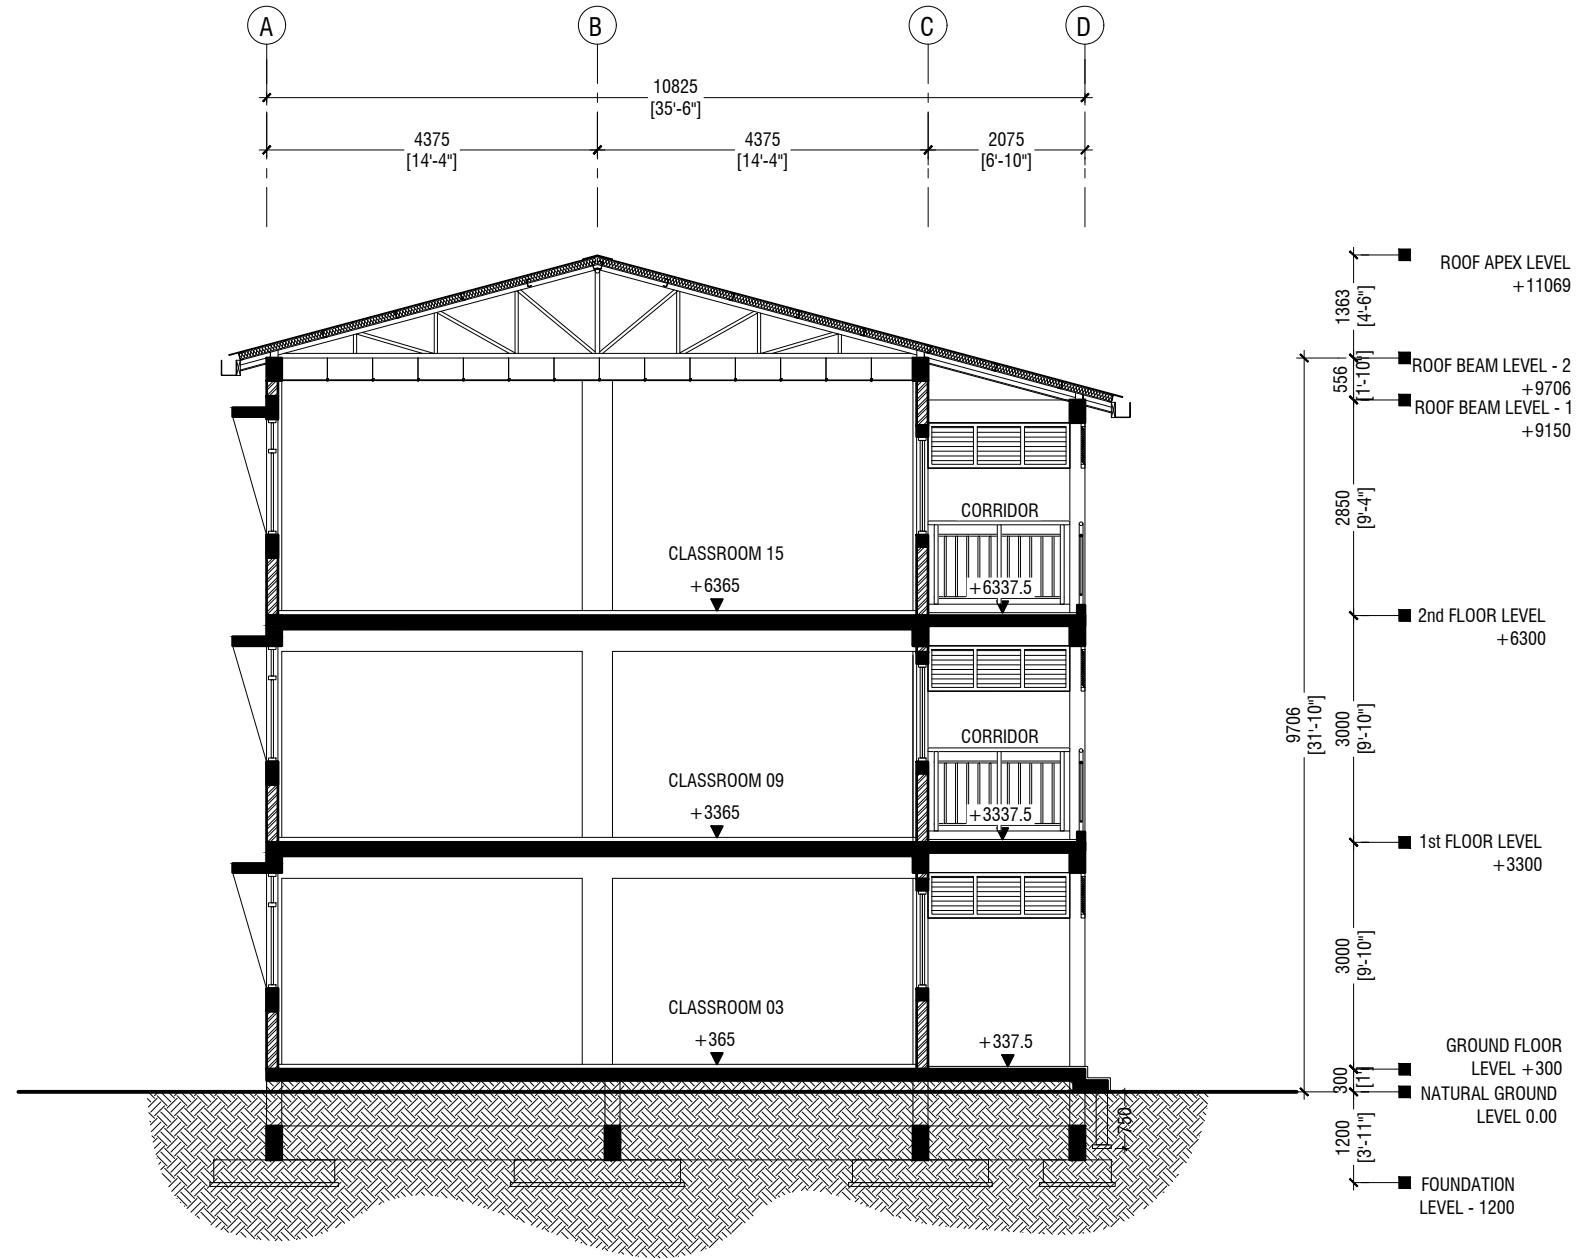

SECTION X-X

SCALE 1:100



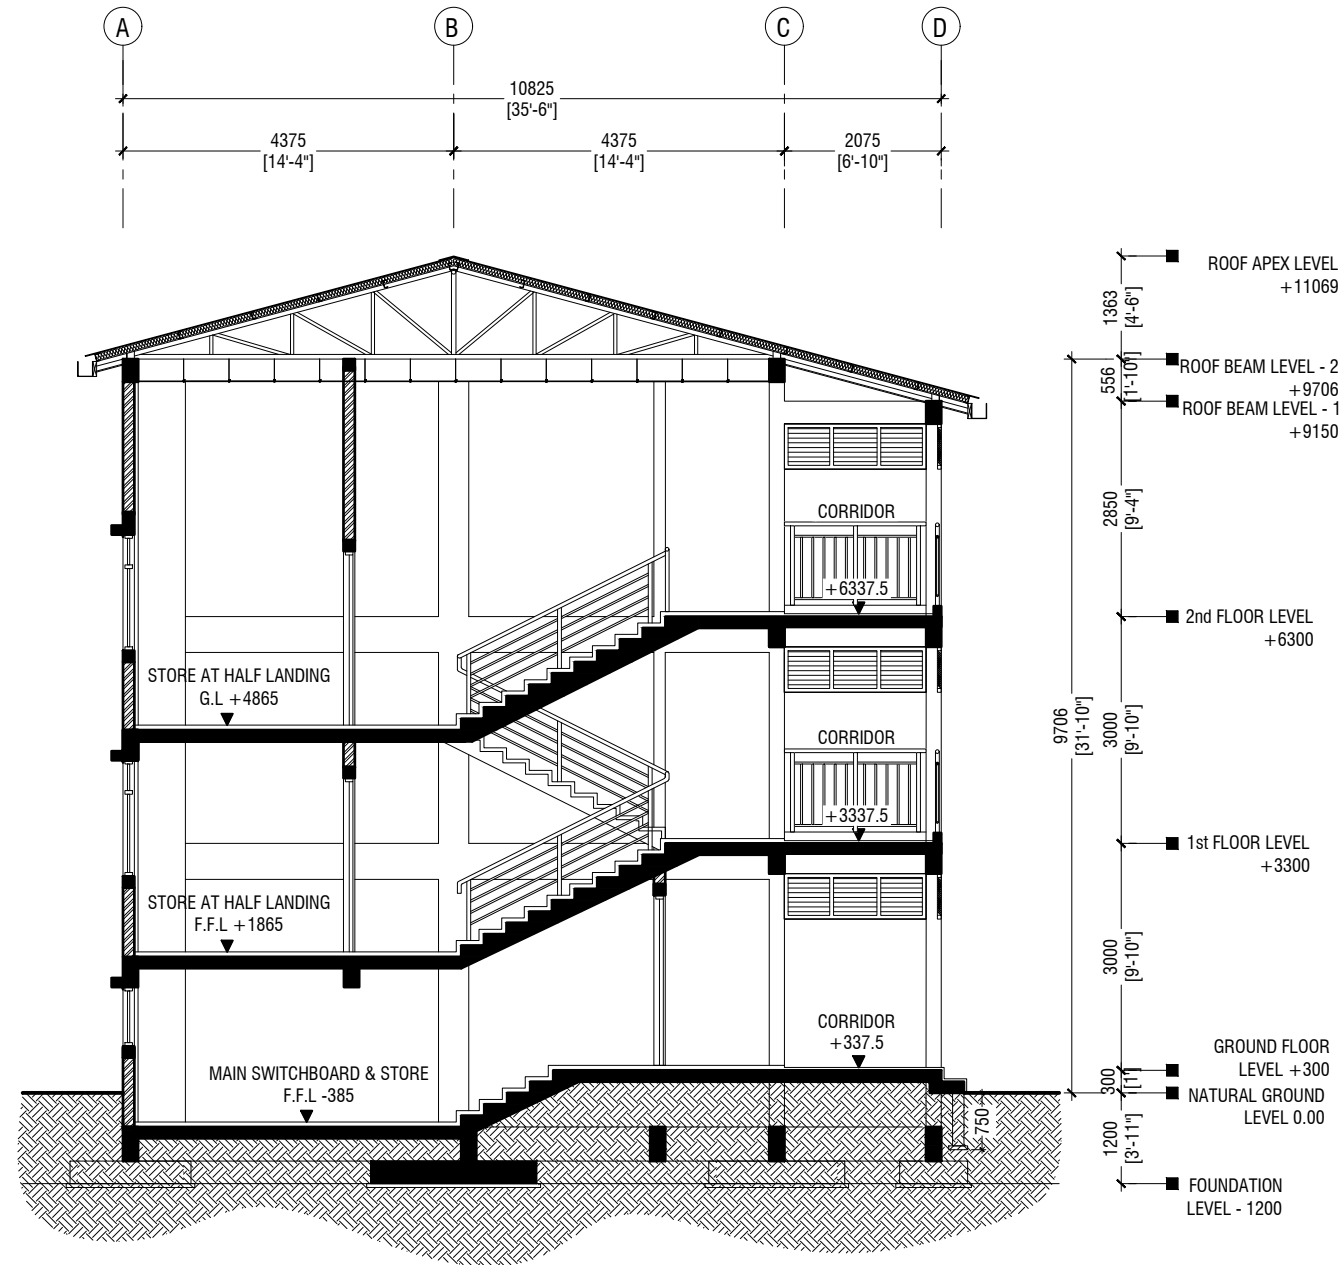

SECTION Y-Y

SCALE 1:100



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameerineemagu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education


Project Number: RI/2020/006
Date: January 2021

Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -


| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Section Y-Y


Page: A-08/21

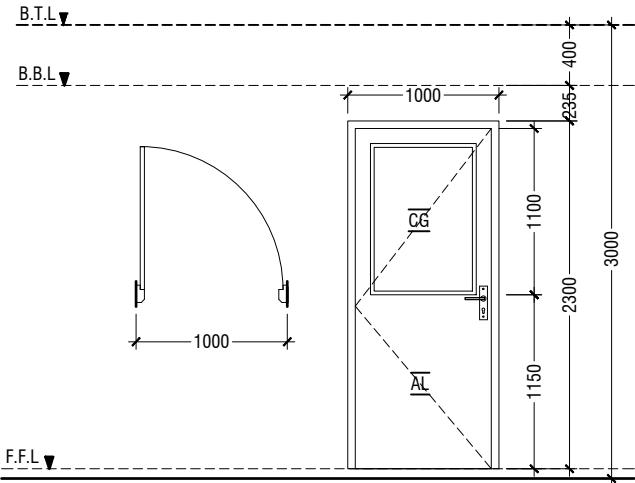


| D1 | SWING DOOR |
|-----------|--|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINIUM PANEL AND 6mm THICK CLEAR GLASS |
| LOCATION | CLASSROOMS & HALF LANDING STORE ROOM |
| QUANTITY | 38 NOS |
| OPEN AREA | 2.03 sqm |

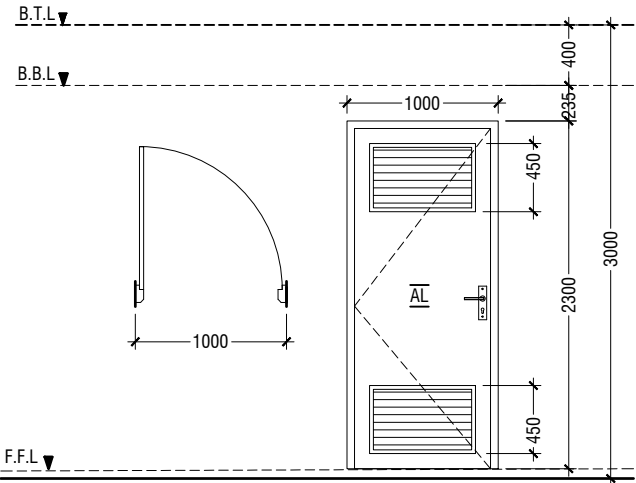


| D2 | SWING DOOR WITH ALUMINIUM LOUVERS |
|-----------|---|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINIUM PANEL AND ALUMINUM LOUVERS |
| LOCATION | TOILETS & MAIN SWITCH BOARD STORE |
| QUANTITY | 07 NOS |
| OPEN AREA | 2.03 sqm |

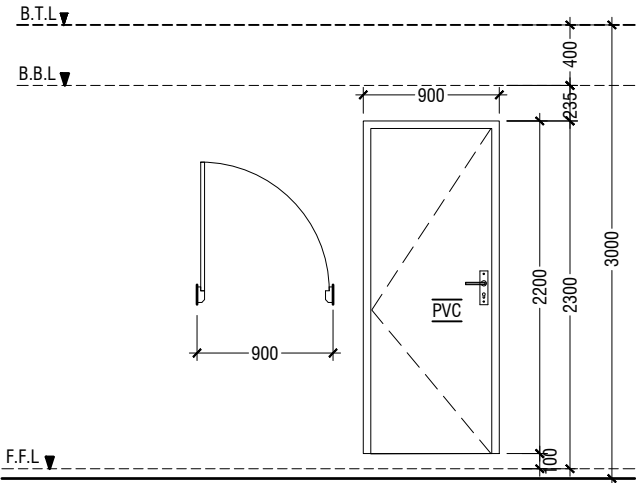


| D3 | PVC SWING DOOR |
|-----------|---------------------------|
| REMARKS | PVC WHITE FRAME AND PANEL |
| LOCATION | STORE & CLEANER CLOSET |
| QUANTITY | 06 NOS |
| OPEN AREA | 1.98 SQM |

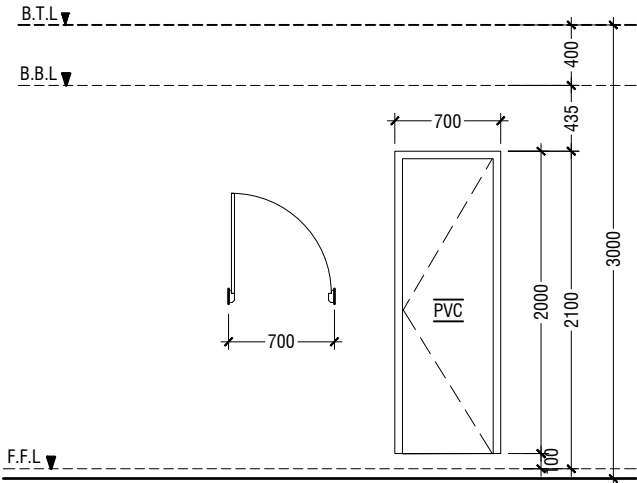


| D4 | PVC SWING DOOR |
|-----------|---------------------------|
| REMARKS | PVC WHITE FRAME AND PANEL |
| LOCATION | TOILETS STALLS |
| QUANTITY | 15 NOS |
| OPEN AREA | 1.17 SQM |

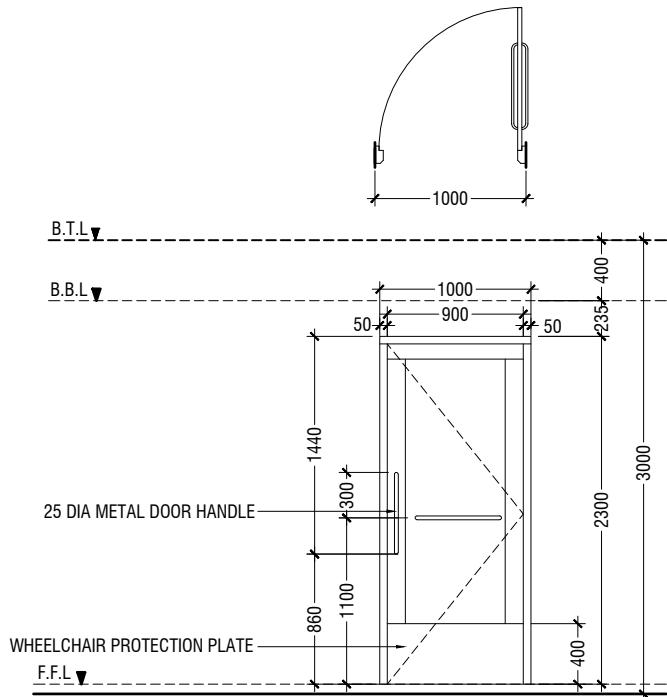


| D5 | SWING DOOR |
|-----------|--|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINIUM PANEL |
| LOCATION | DISABLED TOILET |
| QUANTITY | 01 NOS |
| OPEN AREA | 2.03 sqm |

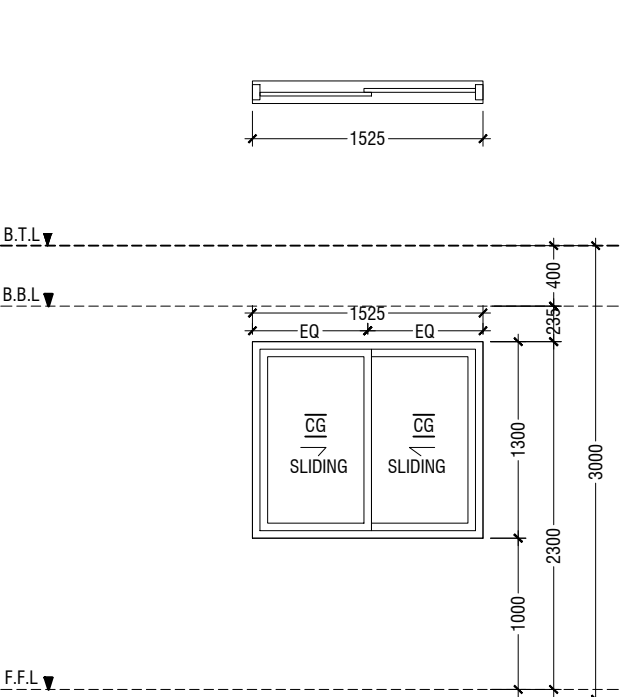

| W1 | SLIDING WINDOW |
|-----------|--|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINIUM PANEL AND 6mm THICK CLEAR GLASS |
| LOCATION | CLASSROOMS |
| QUANTITY | 36 NOS |
| OPEN AREA | 0.83 sqm |

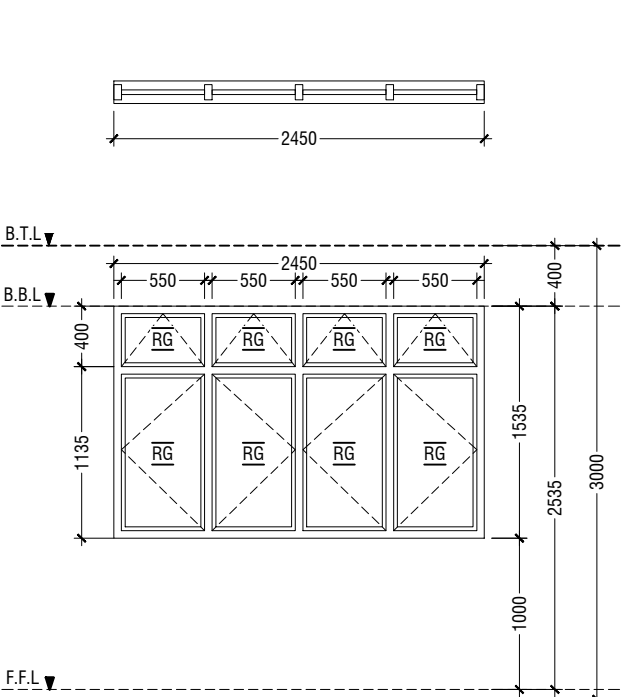

| W2 | SWING WINDOW |
|-----------|--|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WINDOW WITH 6mm THICK REFLECTIVE GLASS |
| LOCATION | CLASSROOMS |
| QUANTITY | 36 NOS |
| OPEN AREA | 2.97 sqm |

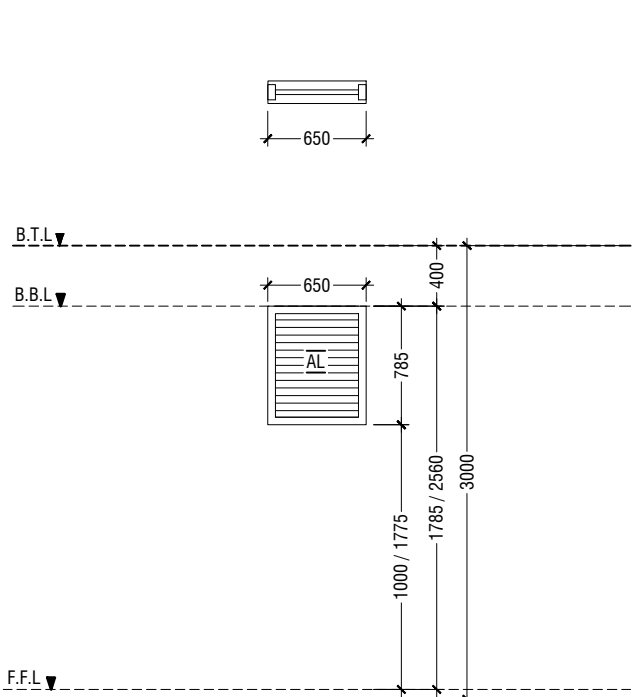

| W3 | WINDOW WITH ALUMINIUM LOUVERS |
|-----------|--|
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINIUM LOUVERS |
| LOCATION | TOILETS & MAIN SWITCH BOARD STORE |
| QUANTITY | 08 NOS |
| OPEN AREA | 0.36 SQM |



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ammeenemagu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey) Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021
Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Door & Window
Schedule - 1


Page: A-09/21

- NOTE:-
1. FLOOR TO FLOOR HEIGHT VARIES AND WILL BE SUBJECTED TO CHANGES
 2. MAINTAIN FLOOR TO WINDOW SILL STANDARD HEIGHT REGULATION OF 1M.
 3. REFER TO ARCHITECT FOR FURTHER ASSISTANCE.
 4. ALL DOORS & WINDOWS TO BE CHECKED ON SITE BEFORE FABRICATION.
 5. ALL DOOR & WINDOWS VIEWED FROM EXTERIOR, FOR DOOR SWING, REFER TO FLOOR PLANS.
 6. THE DOORS / WINDOWS WHICH DO NOT TOUCH THE BEAM SHALL HAVE A LINTEL BEAM (LB) ABOVE THE DOOR / WINDOW.
 7. FOR ALL THE WINDOWS PUT A SILL BEAM BELOW THE WINDOW (SB)
 8. FOR SAFETY PURPOSES REFER TO TECHNICAL SPECIFICATIONS FOR GLASS THICKNESS.


DOOR & WINDOW SCHEDULE - 1

SCALE: 1:50


LEGEND:
CG - CLEAR GLASS
RG - REFLECTED GLASS
AL - ALUMINIUM
PVC - POLYVINYL CHLORIDE

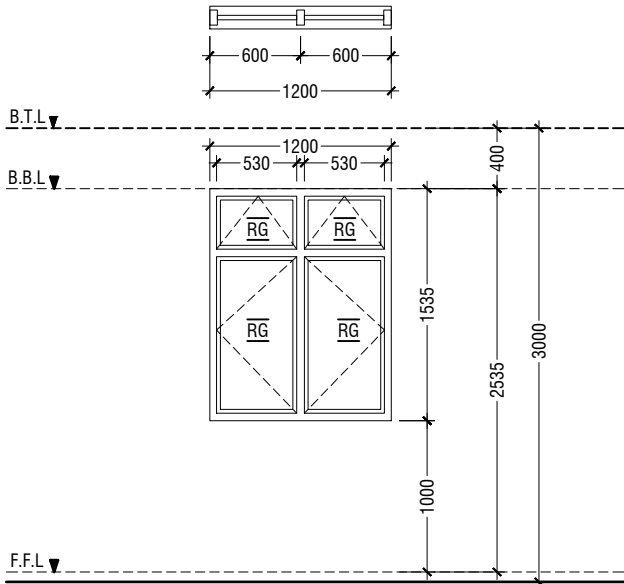


| | |
|-----------|--|
| W4 | SWING WINDOW |
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WINDOW WITH 6mm THICK REFLECTIVE GLASS |
| LOCATION | HALF LANDING STORE ROOM |
| QUANTITY | 2 NOS |
| OPEN AREA | 1.43 sqm |

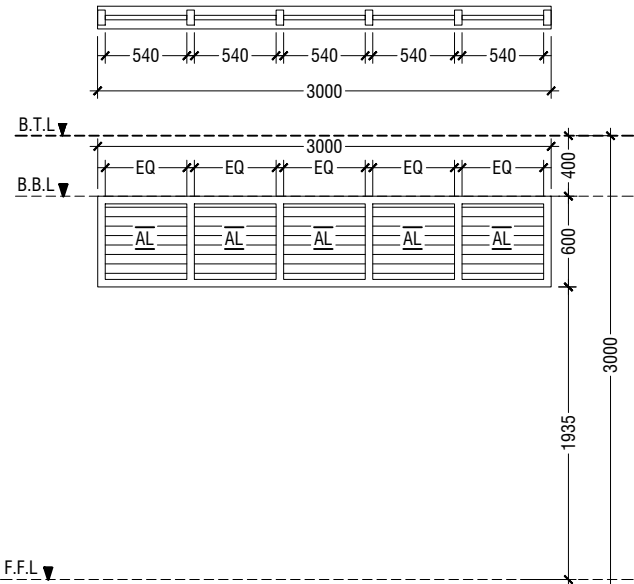


| | |
|-----------|---|
| V1 | SUNSHADING |
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINUM LOUVERS |
| LOCATION | CORRIDOR |
| QUANTITY | 36 NOS |
| OPEN AREA | 1.35 SQM |

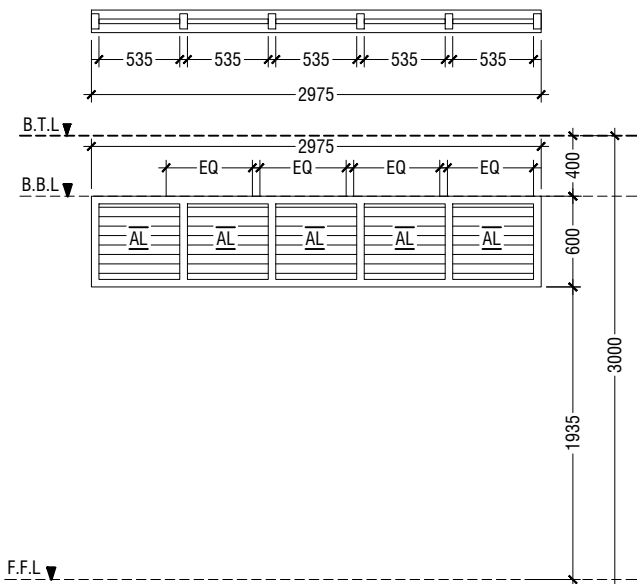

| | |
|-----------|---|
| V2 | SUNSHADING |
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINUM LOUVERS |
| LOCATION | CORRIDOR |
| QUANTITY | 06 NOS |
| OPEN AREA | 1.35 SQM |

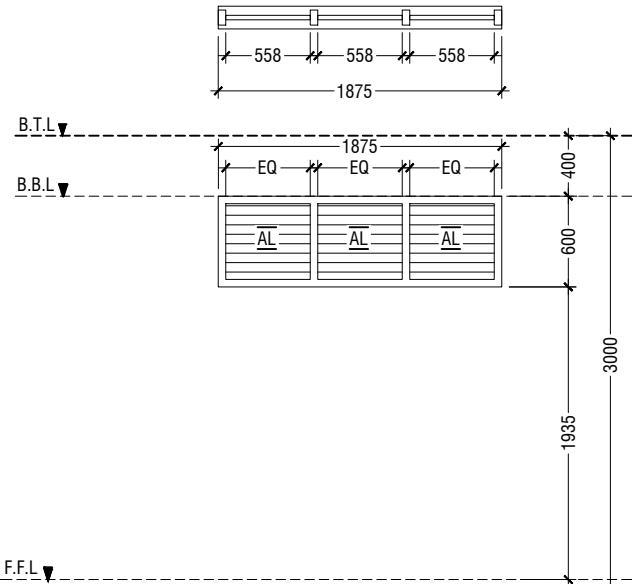

| | |
|-----------|---|
| V3 | SUNSHADING |
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINUM LOUVERS |
| LOCATION | CORRIDOR |
| QUANTITY | 06 NOS |
| OPEN AREA | 0.84 SQM |

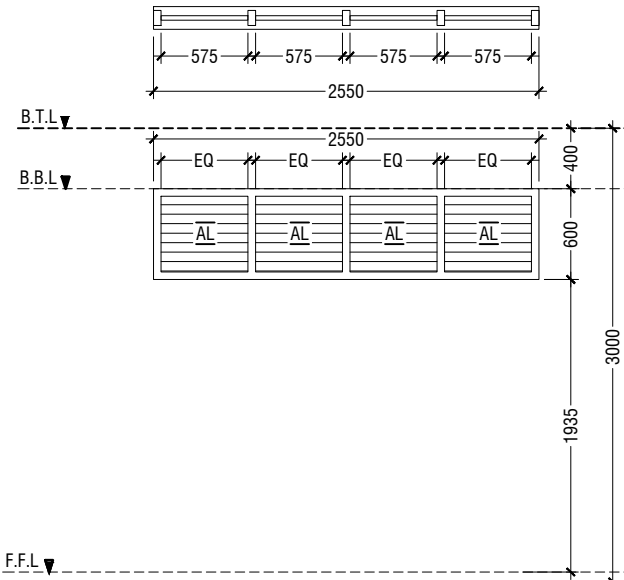

| | |
|-----------|---|
| V4 | SUNSHADING |
| REMARKS | 50mm THICK WHITE POWDER COATED (60 MICRONS) ALUMINUM FRAMED WITH ALUMINUM LOUVERS |
| LOCATION | CORRIDOR |
| QUANTITY | 03 NOS |
| OPEN AREA | 1.15 SQM |

LEGEND:
CG - CLEAR GLASS
RG - REFLECTED GLASS
AL - ALUMINIUM
PVC - POLYVINYL CHLORIDE

NOTE:-
1. FLOOR TO FLOOR HEIGHT VARIES AND WILL BE SUBJECTED TO CHANGES
2. MAINTAIN FLOOR TO WINDOW SILL STANDARD HEIGHT REGULATION OF 1M.
3. REFER TO ARCHITECT FOR FURTHER ASSISTANCE.
4. ALL DOORS & WINDOWS TO BE CHECKED ON SITE BEFORE FABRICATION.
5. ALL DOOR & WINDOWS VIEWED FROM EXTERIOR, FOR DOOR SWING, REFER TO FLOOR PLANS.
6. THE DOORS / WINDOWS WHICH DO NOT TOUCH THE BEAM SHALL HAVE A LINTEL BEAM (LB) ABOVE THE DOOR / WINDOW.
7. FOR ALL THE WINDOWS PUT A SILL BEAM BELOW THE WINDOW (SB)
8. FOR SAFETY PURPOSES REFER TO TECHNICAL SPECIFICATIONS FOR GLASS THICKNESS.

DOOR & WINDOW SCHEDULE - 2

SCALE 1:50
0 0.25 0.5 1 1.5 2 2.5

SCHEDULE OF VENTILATION FOR S.HITHADHOO SHARAFUDDIN SCHOOL

| Room name/ Number | Room Areas (sqm) (Specify centre to centre or clear) | Window (opening) number | Required opening areas (sqm) | Designed opening areas (sqm) | Open % |
|-------------------------------|---|----------------------------|------------------------------------|---------------------------------|--------|
| Ground Floor | | | | | |
| 1 Classroom 1 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 2 Classroom 2 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 3 Classroom 3 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 4 Classroom 4 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 5 Classroom 5 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 6 Classroom 6 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 7 Toilet (F) | 12.73 | | | W3 & RC FINS | |
| 8 Toilet (M) | 9.09 | | | W3 & RC FINS | |
| 9 Toilet for disabled | 5.12 | | | Mechanical Ventilation | |
| 10 Main switchboard /store | 11.25 | | | Mechanical Ventilation | |
| First to Second Floor | | | | | |
| 1 Classroom 7 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 2 Classroom 8 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 3 Classroom 9 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 4 Classroom 10 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 5 Classroom 11 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 6 Classroom 12 | 52.81 | 2W1, 2W2 & 2D1 | 5.28 | 11.66 | 22.08% |
| 7 Toilet (F) | 12.64 | | | W3 & RC FINS | |
| 8 Toilet (M) | 12.65 | | | W3 & RC FINS | |
| 9 Store at half landing level | 7.22 | W4 | 0.72 | 1.43 | 19.81% |

VENTILATION SCHEDULE

NO SCALE



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ammeenemagu, Male'


Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021
Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| | |
|--------|-------|
| Rev no | Date |
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Door/Window - 2 &
Ventilation Schedule

Page: A-10/21

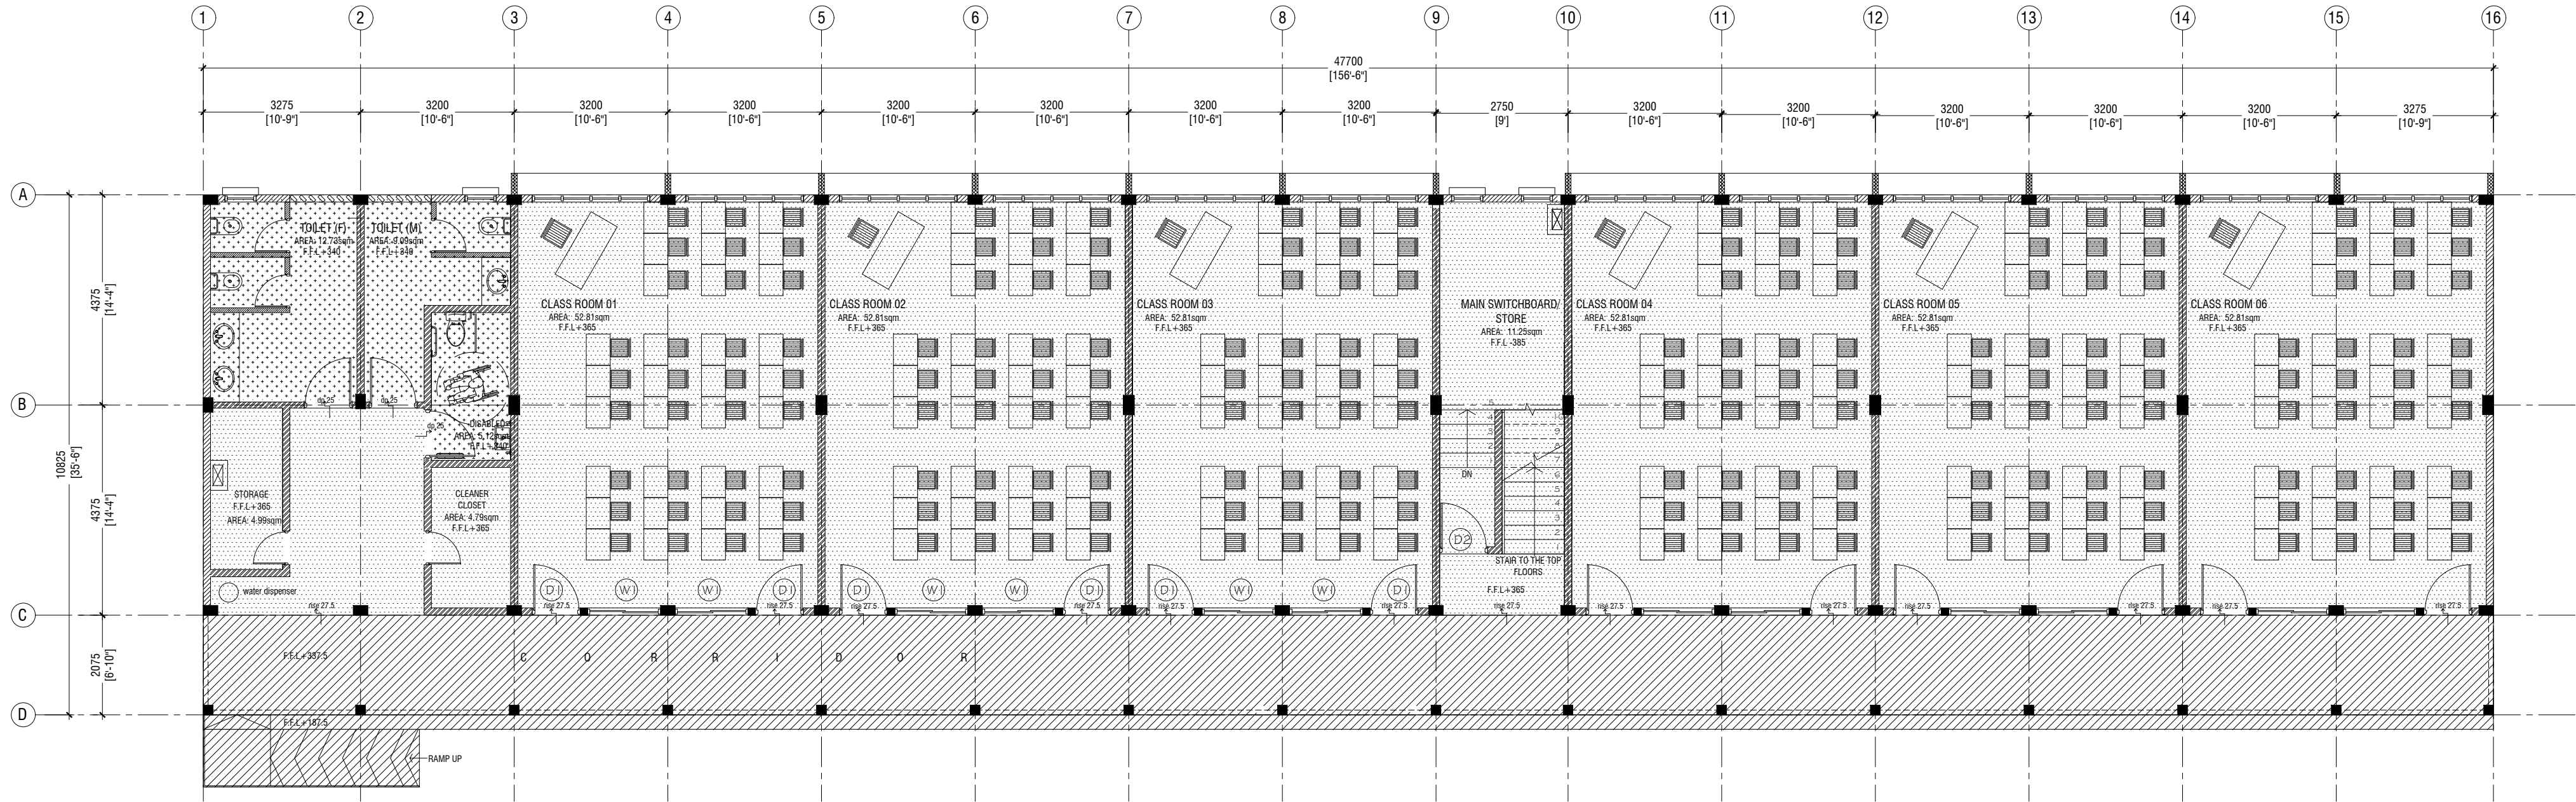

**GROUND FLOOR
FLOOR FINISHES PLAN**

SCALE 1:100



LEGEND

| CODE | DESCRIPTION |
|------|---|
| | 600X600mm HOMOGENOUS NON-SLIP TILES OVER 50mm SCREEDING |
| | 35mm NORMAL SCREEDING WITH 2.5mm SELF LEVELING CEMENT WITH EPOXY FLOOR PAINT (2 COATS OF EPOXY) |
| | 300X300mm HOMOGENOUS NON-SLIP TILES OVER 25mm SCREEDING |




RIYAN PRIVATE LIMITED
T: +9603370349 F: +9603370776
E: info@riyan.com.mv
W: www.riyan.com.mv
3rd floor, H. Athun, Arneememogu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021
Architect: Mariyam Irasha Shareef
Engineer: Mohamed Muththalib Waleed
Drawn by: Mariyam Leevan Jaleel
Services: Aishath Ahmed
Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Ground Floor Plan
Floor Finishes Plan
Page: A-11/21

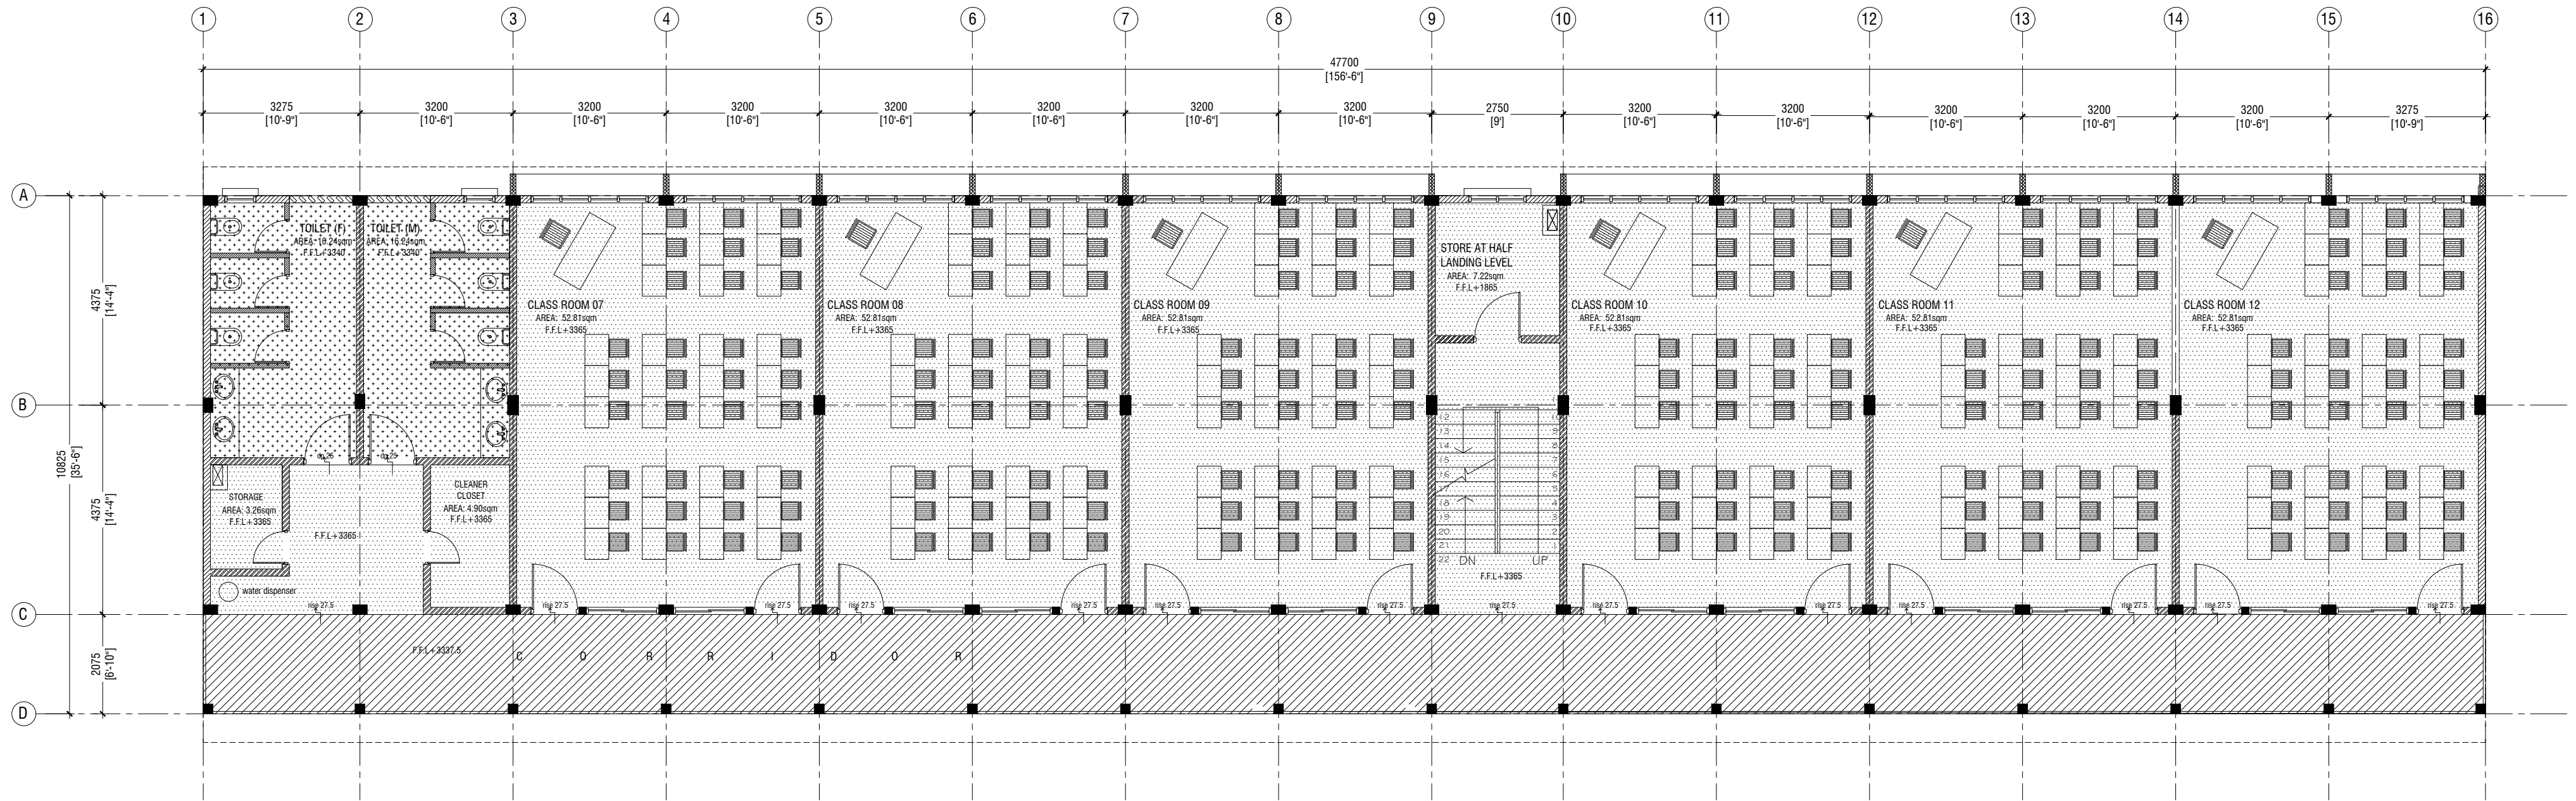


**FIRST - SECOND FLOOR
FLOOR FINISHES PLAN**

SCALE 1:100



LEGEND

| CODE | DESCRIPTION |
|------|---|
| | 600X600mm HOMOGENOUS NON-SLIP TILES OVER 50mm SCREEDING |
| | 35mm NORMAL SCREEDING WITH 2.5mm SELF LEVELING CEMENT WITH EPOXY FLOOR PAINT (2 COATS OF EPOXY) |
| | 300X300mm HOMOGENOUS NON-SLIP TILES OVER 25mm SCREEDING |

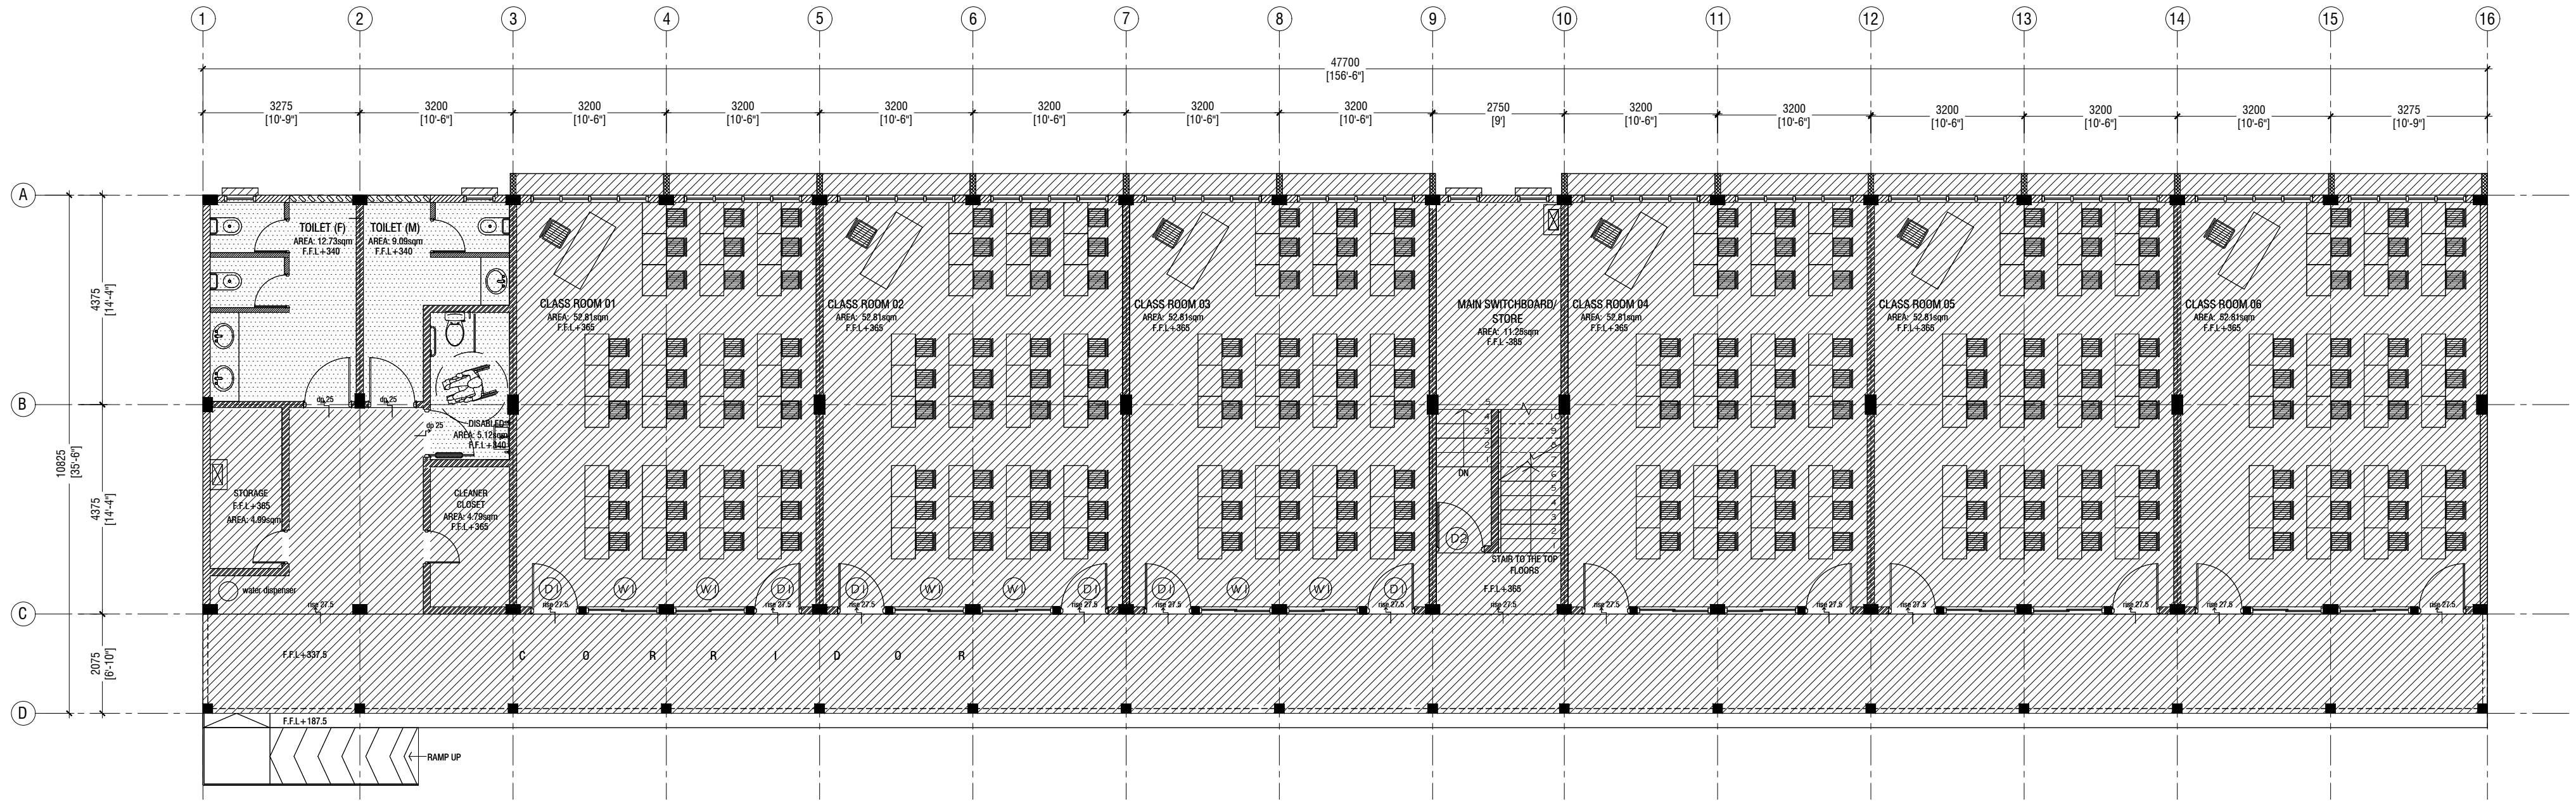

**GROUND FLOOR
REFLECTED CEILING PLAN**
SCALE 1:100



LEGEND

| CODE | DESCRIPTION |
|------|--|
| | EXPOSED SLAB SOFFIT TO BE GROUND SMOOTH IN SELECT PAINT FINISH (ONE COAT OF PUTTY FOLLOWED BY SEALER AND 2 COATS OF PAINT) |
| | 6mm THICK CEMENT BOARD ON ROOF EAVE/GABLE CEILING (ONE COAT OF PUTTY FOLLOWED BY SEALER AND 2 COATS OF PAINT) |



RIYAN PRIVATE LIMITED
T: +9603370340 F: +9603370776
E: info@riyan.com.mv
W: www.riyan.com.mv
3rd floor, H. Azum, Arneemeeqqu, Male'


Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021
Architect: Mariyam Irasha Shareef
Engineer: Mohamed Muththalib Waleed
Drawn by: Mariyam Leevan Jaleel
Services: Aishath Ahmed
Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Ground Floor Reflected Ceiling Plan

Page: A-13/21

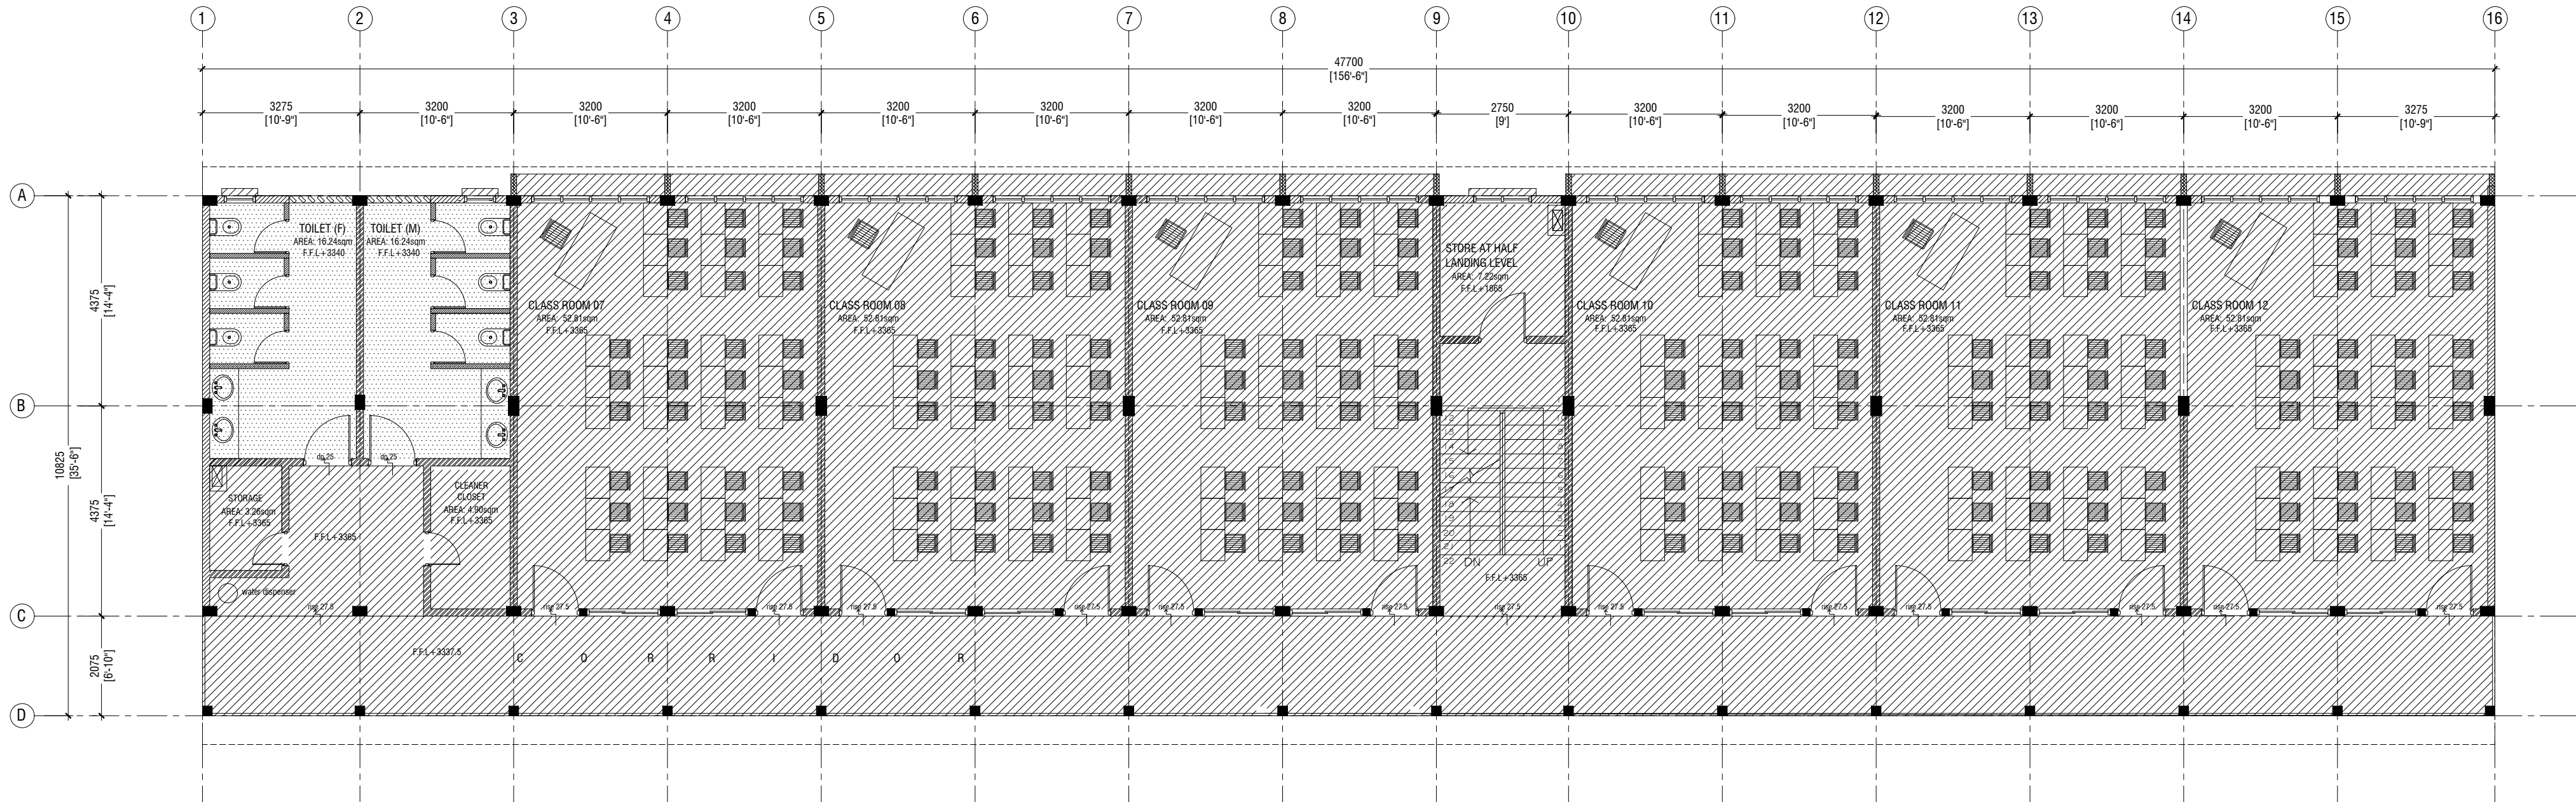

**FIRST FLOOR
REFLECTED CEILING PLAN**
SCALE 1:100

LEGEND

| CODE | DESCRIPTION |
|------|--|
| | EXPOSED SLAB SOFFIT TO BE GROUND SMOOTH IN SELECT PAINT FINISH (ONE COAT OF PUTTY FOLLOWED BY SEALER AND 2 COATS OF PAINT) |
| | 6mm THICK CEMENT BOARD ON ROOF EAVE/GABLE CEILING (ONE COAT OF PUTTY FOLLOWED BY SEALER AND 2 COATS OF PAINT) |




RYAN PRIVATE LIMITED
T: +9603370349 F: +9603370776
E: info@ryan.com.mv
W: www.ryan.com.mv
3rd floor, H. Athun, Arneemeeqqu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021
Architect: Mariyam Irasha Shareef
Engineer: Mohamed Muththaliib Waleed
Drawn by: Mariyam Leevan Jaleel
Services: Aishath Ahmed
Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: First Floor Reflected
Ceiling Plan
Page: A-14/21

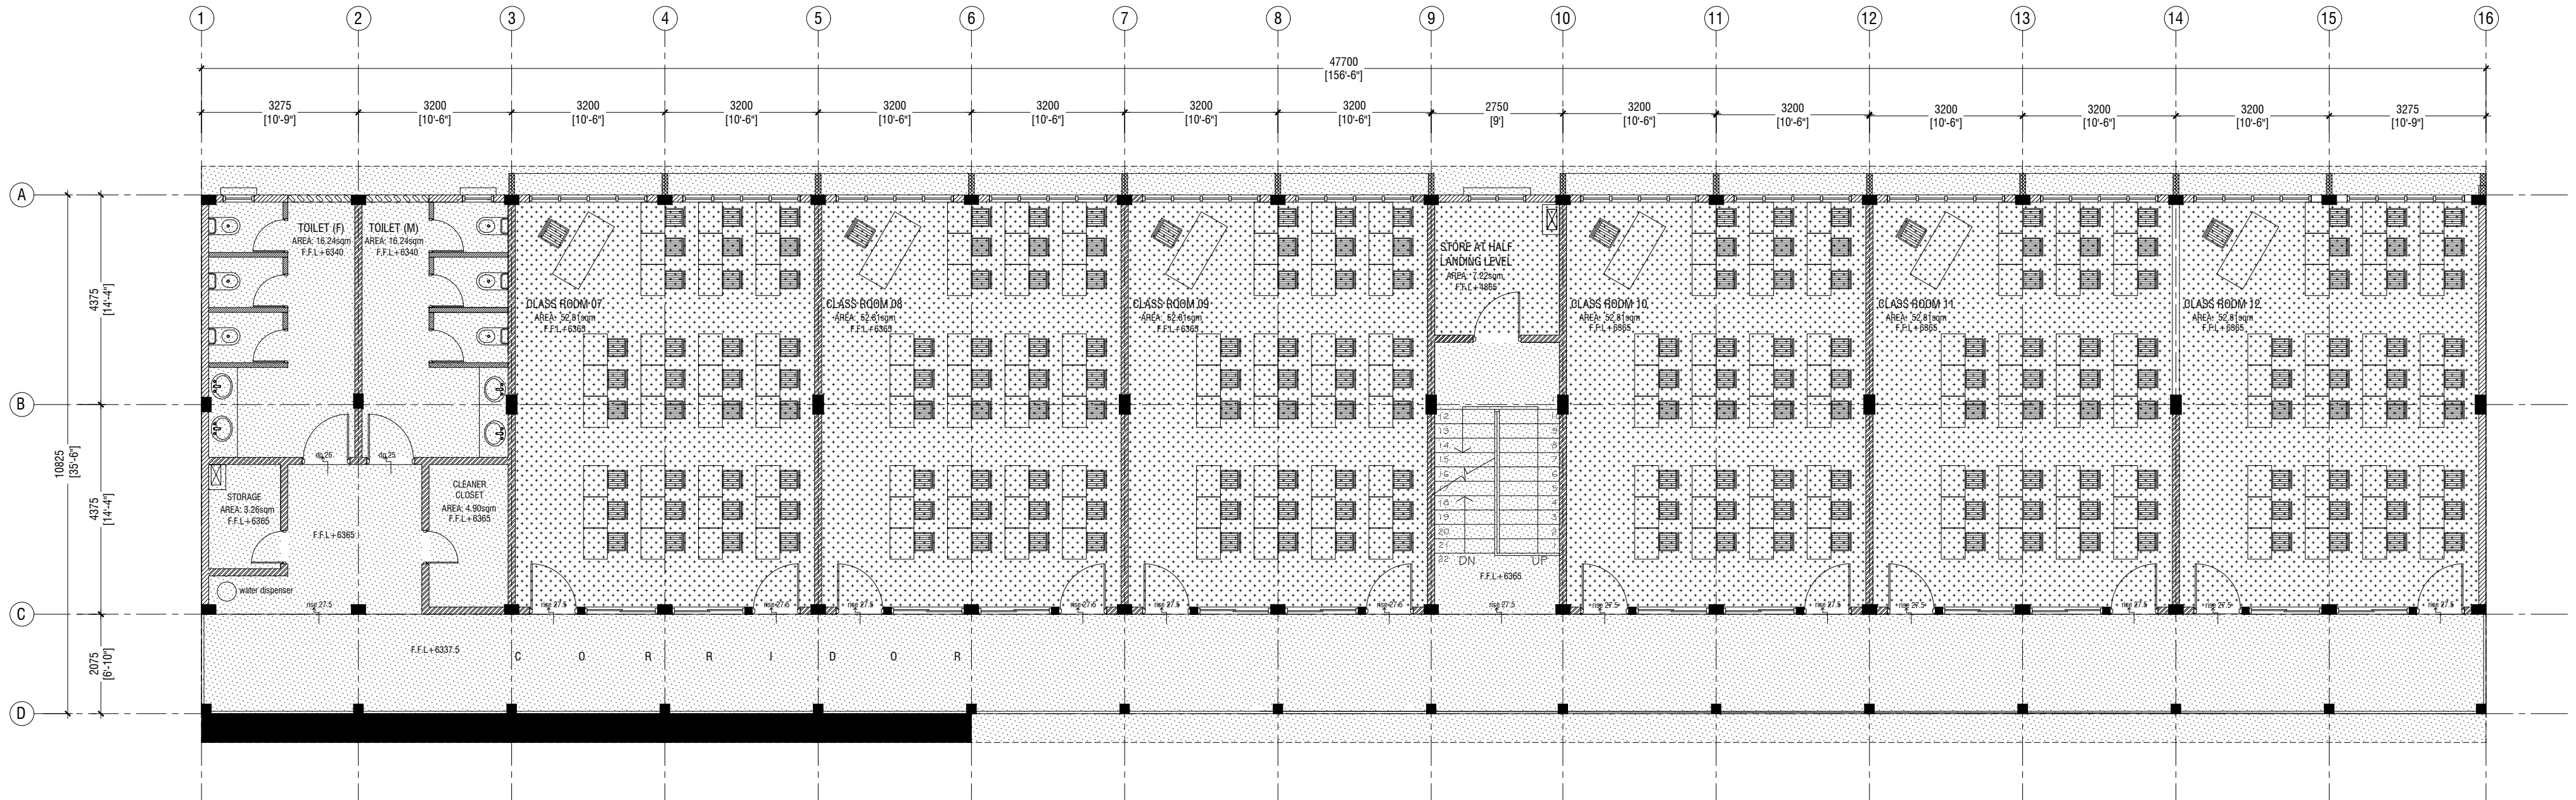

**SECOND FLOOR
REFLECTED CEILING PLAN**

SCALE 1:100



LEGEND

| CODE | DESCRIPTION |
|------|---|
| | 9mm THICK FIXED CEILING 'BORAL' OR EQUIVALENT PLASTERBOARD CEILING SYSTEM WITH TIMBER FRAMES, APPLIED WITH GROUND SMOOTH FINISH IN SELECTED PAINT |
| | 6mm THICK CEMENT BOARD ON ROOF EAVE/GABLE CEILING (ONE COAT OF PUTTY FOLLOWED BY SEALER AND 2 COATS OF PAINT) |



RYAN PRIVATE LIMITED

T: +9653370349 F: +9653370776
E: info@ryan.com.mu
W: www.ryan.com.mu

3rd floor, H. Azum, Amreeemogga, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no Date

--

--





--



--

--

Title: Second Floor Reflected
Ceiling Plan


Page: A-15/21

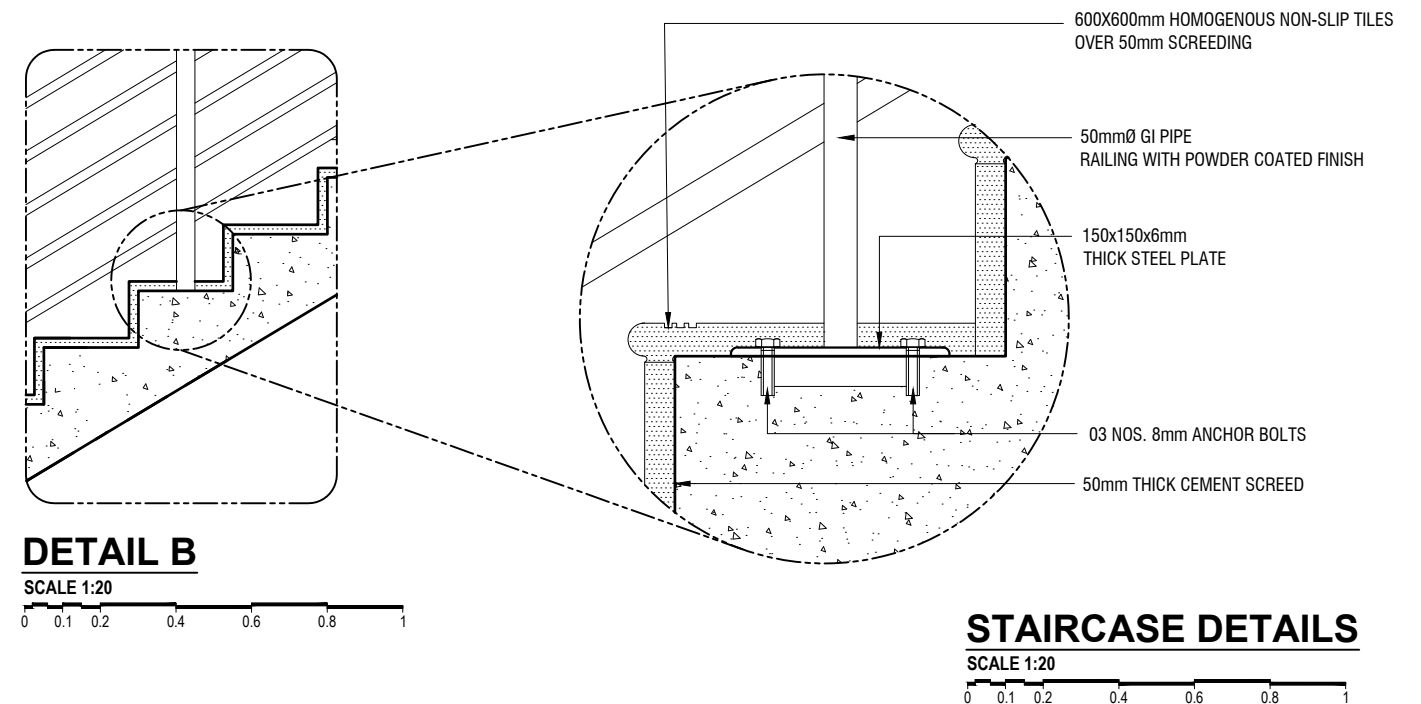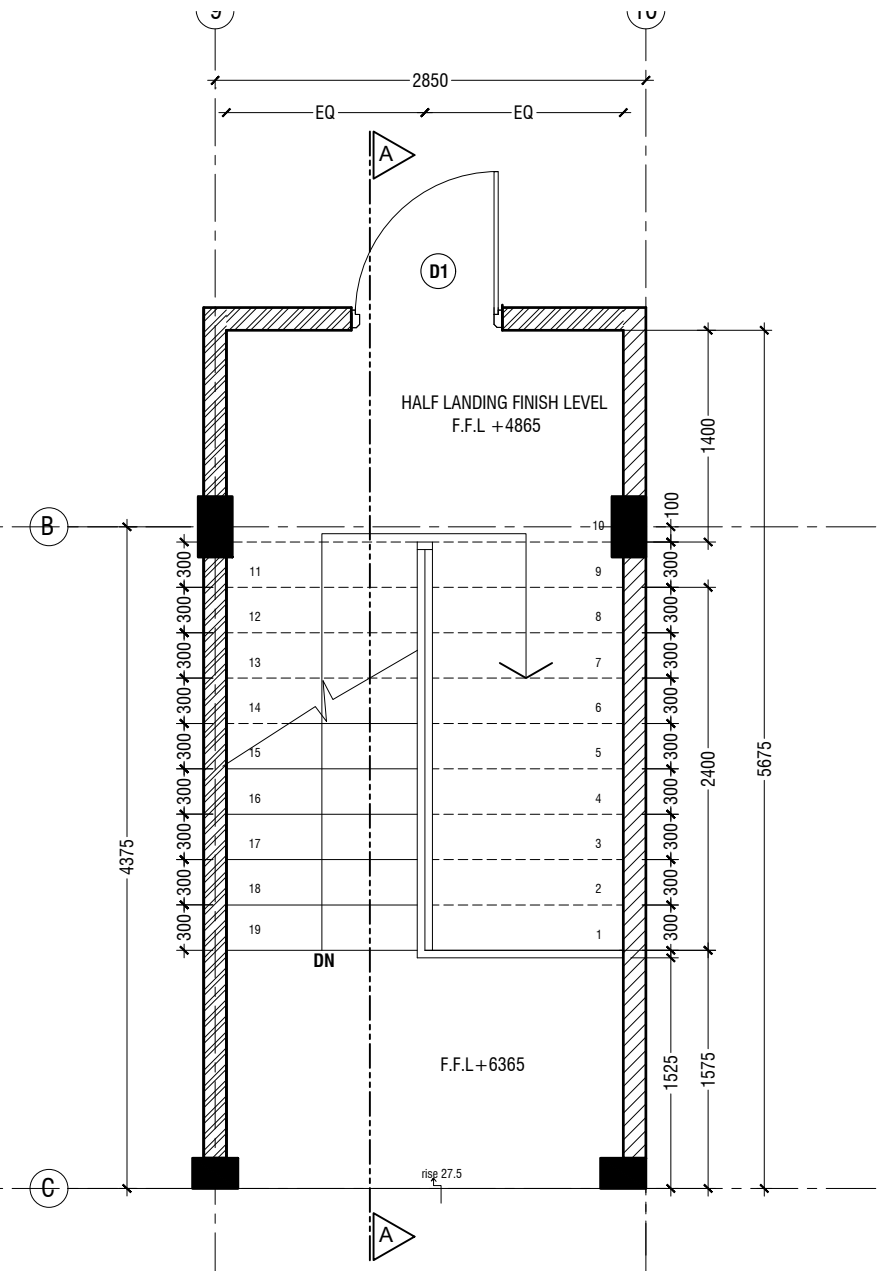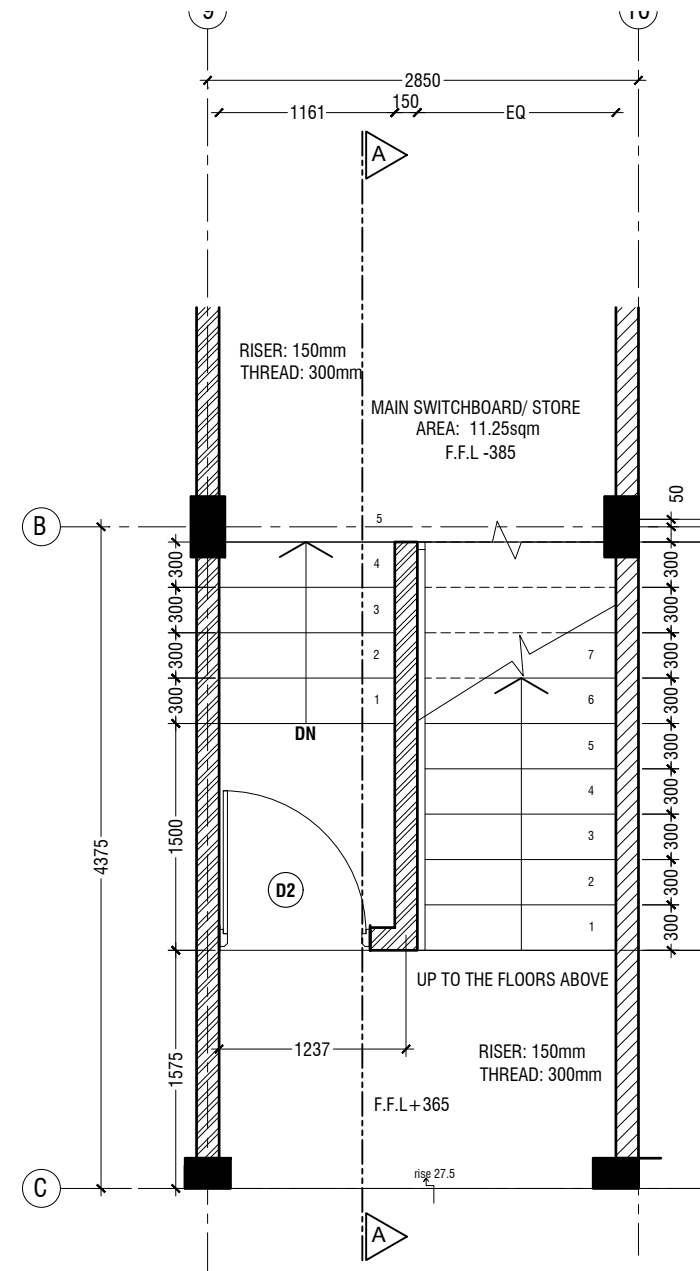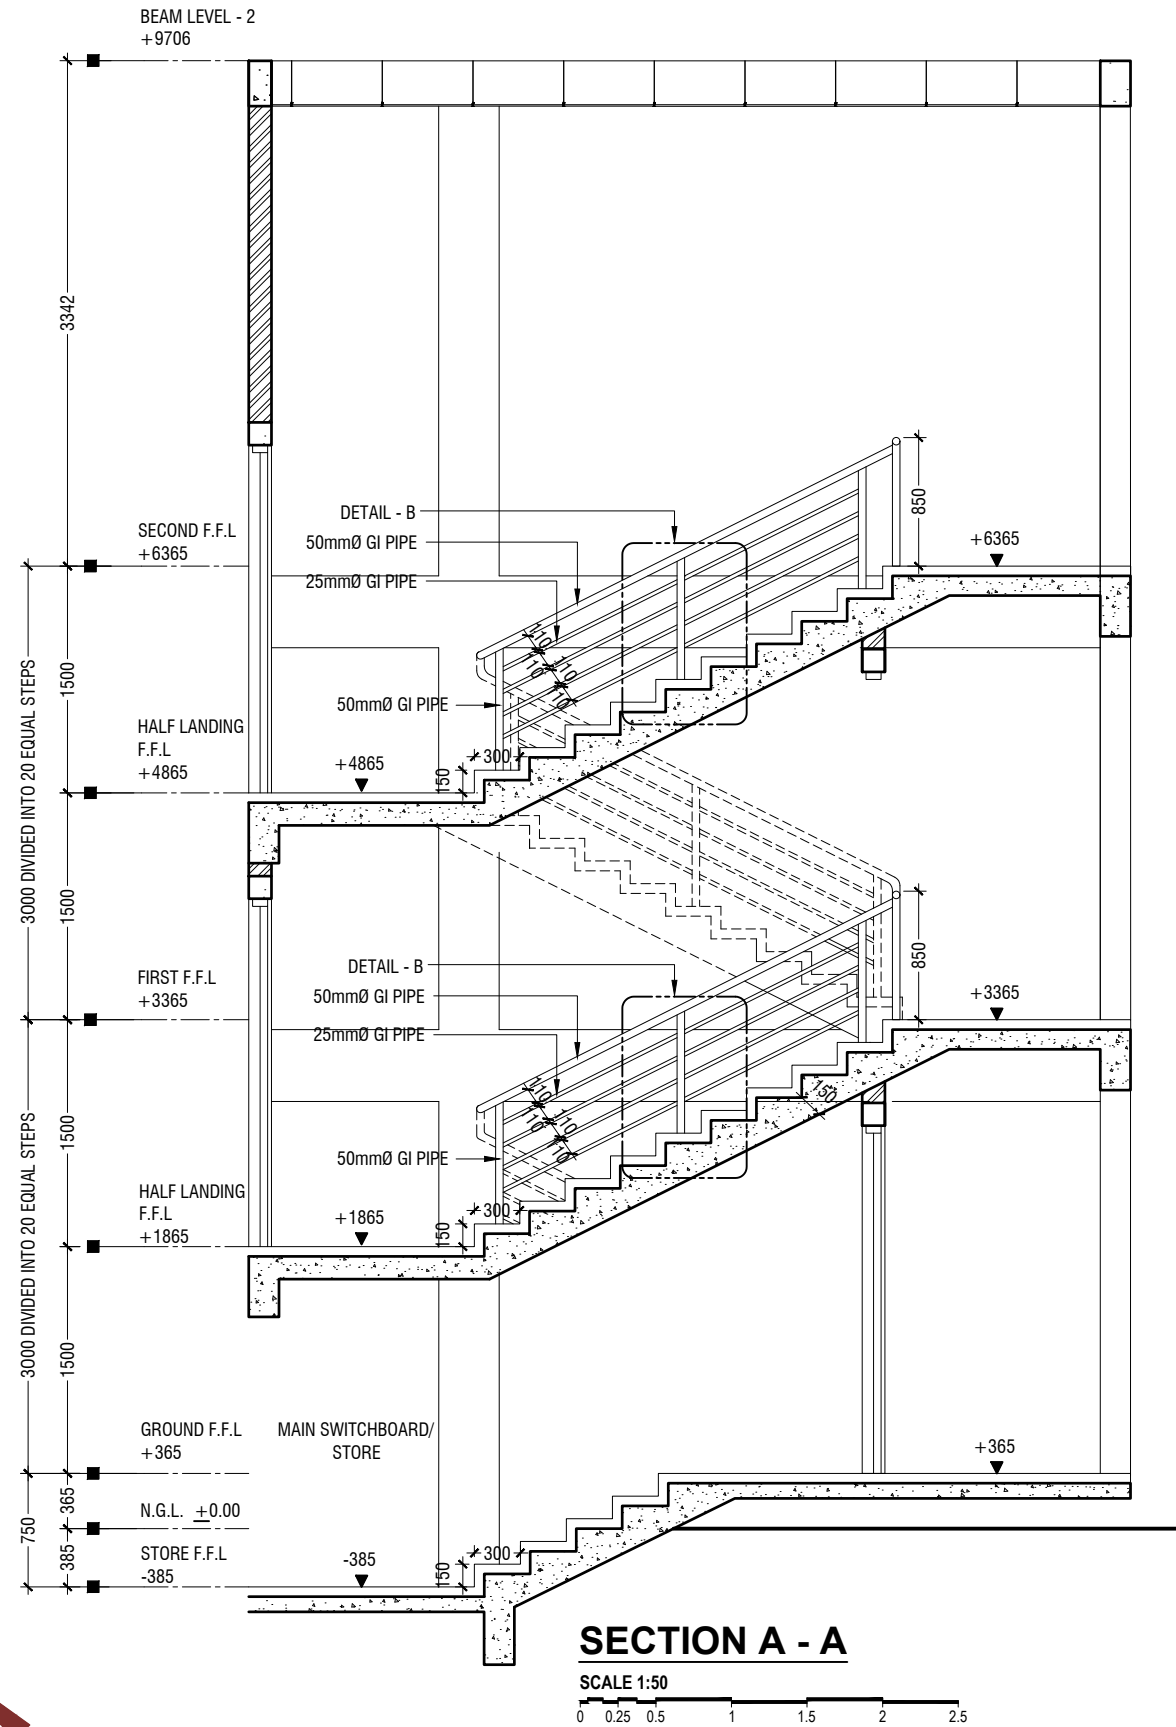

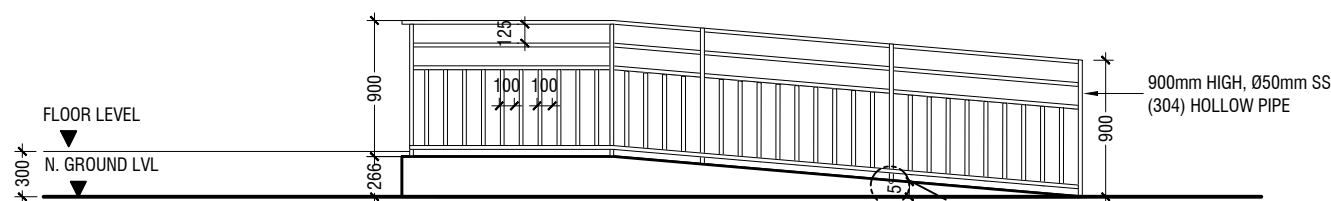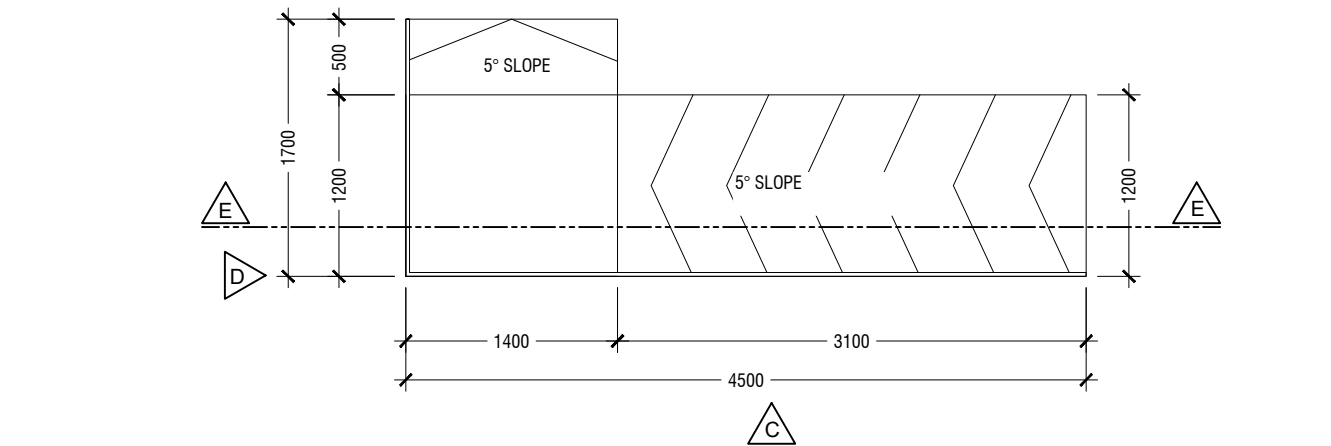

ELEVATION C


Ø50mm SS (304) HOLLOW PIPE
4 NOS. 12mm ANCHOR BOLTS FIXED TO THE RC FLOOR WITH SS PLATE AND COVERED BY PLASTERING
100mm THICK RC CONCRETE SLAB

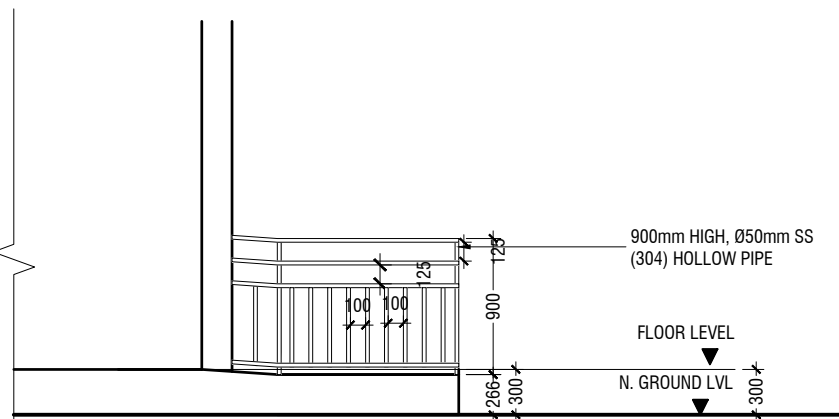

ELEVATION D

DETAIL - 2 MAIN ENTRANCE RAMP DETAILS

SCALE 1:50
0 0.25 0.5 1 1.5 2 2.5

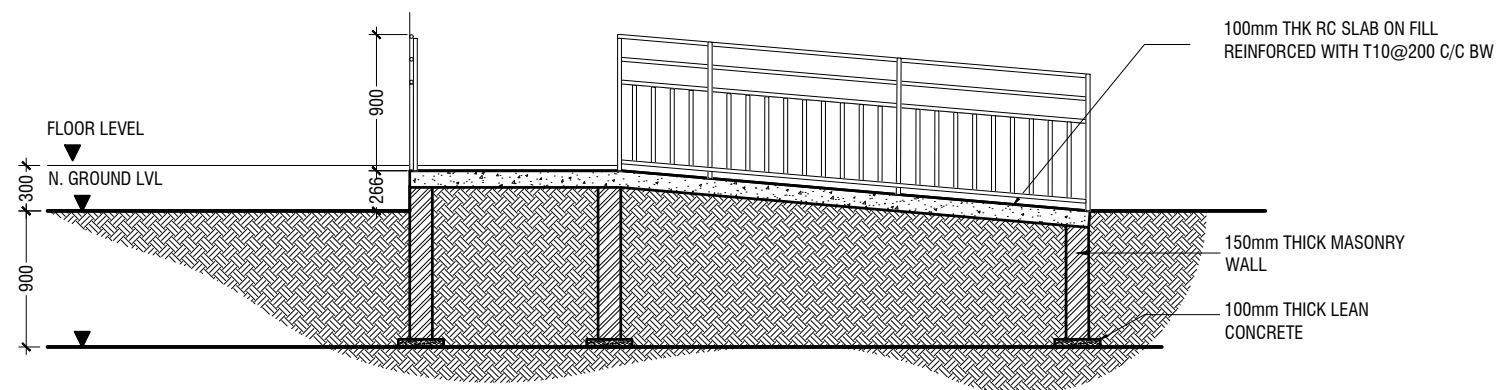

SECTION E-E



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameeremagu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021

Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |



Title: Main Entrance Ramp
Details

Page: A-17/21



PLAN

SCALE 1:20

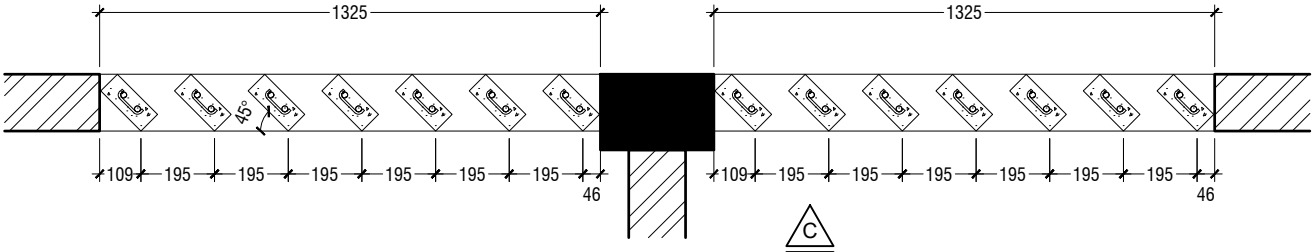


RC FIN DETAIL

SCALE 1:20



FLOOR LEVEL

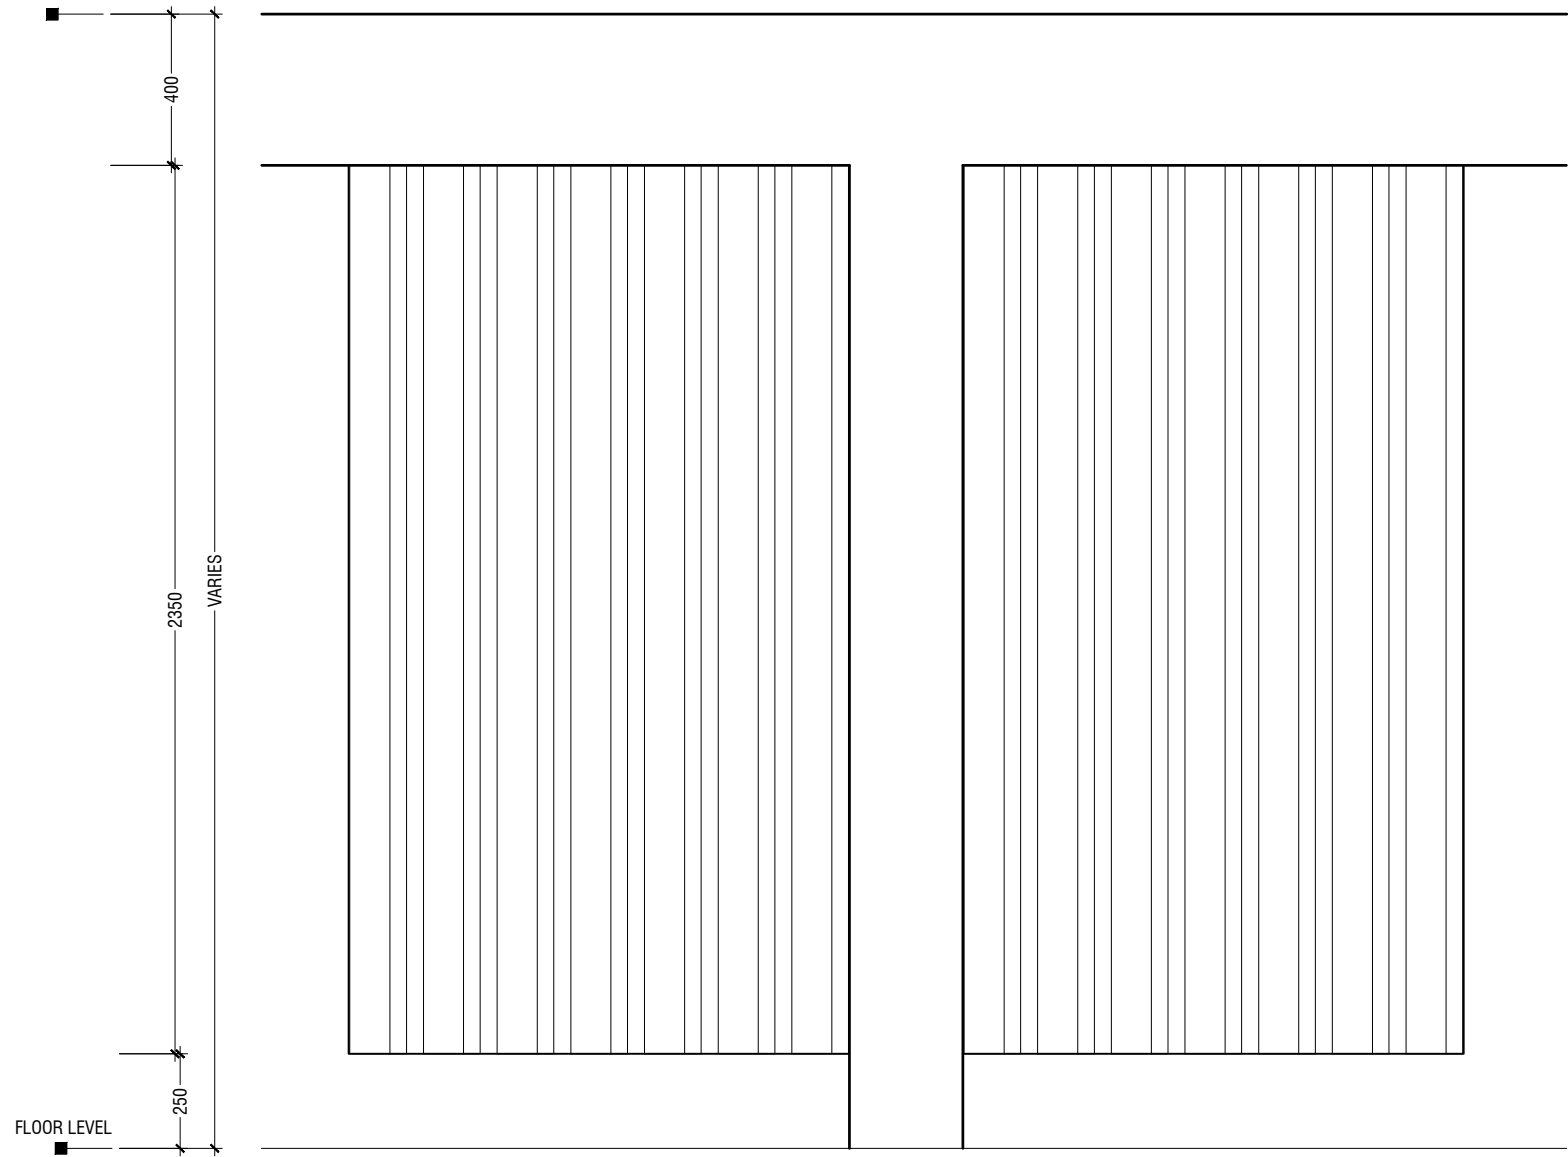

ELEVATION - C

SCALE 1:20



NOTE:-
FLOOR TO FLOOR HEIGHT VARIES AND WILL BE SUBJECTED TO CHANGES

DETAIL - 4

RC FIN DETAILS (TOILET)

SCALE 1:20



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameerneemagu, Male'

Project Number: RI/2020/006
Date: April 2020


Client: Ministry of Education

Architect : Razana Amir
Engineer : Ahmed Zuhail Zaeem
Drawn by : Aishath Mohamed Rasheed
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|---------------|
| 01 | 02 April 2020 |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: RC Fin Detail


Page: A-20/23

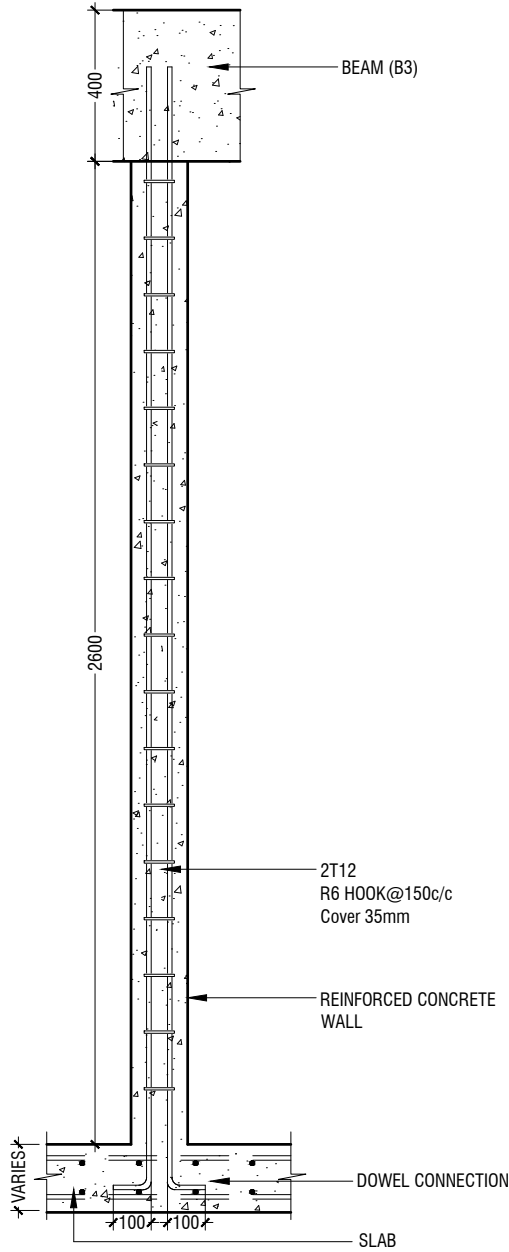

SECTION C-C


SCALE 1:20



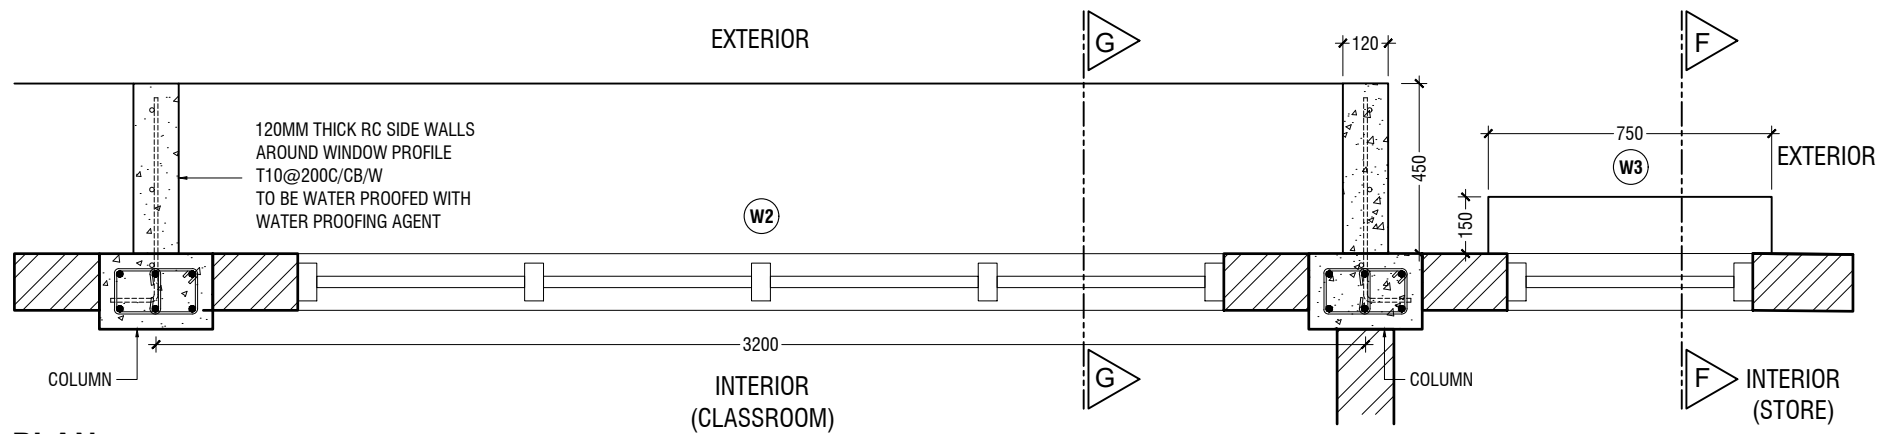


PLAN

SCALE 1:20

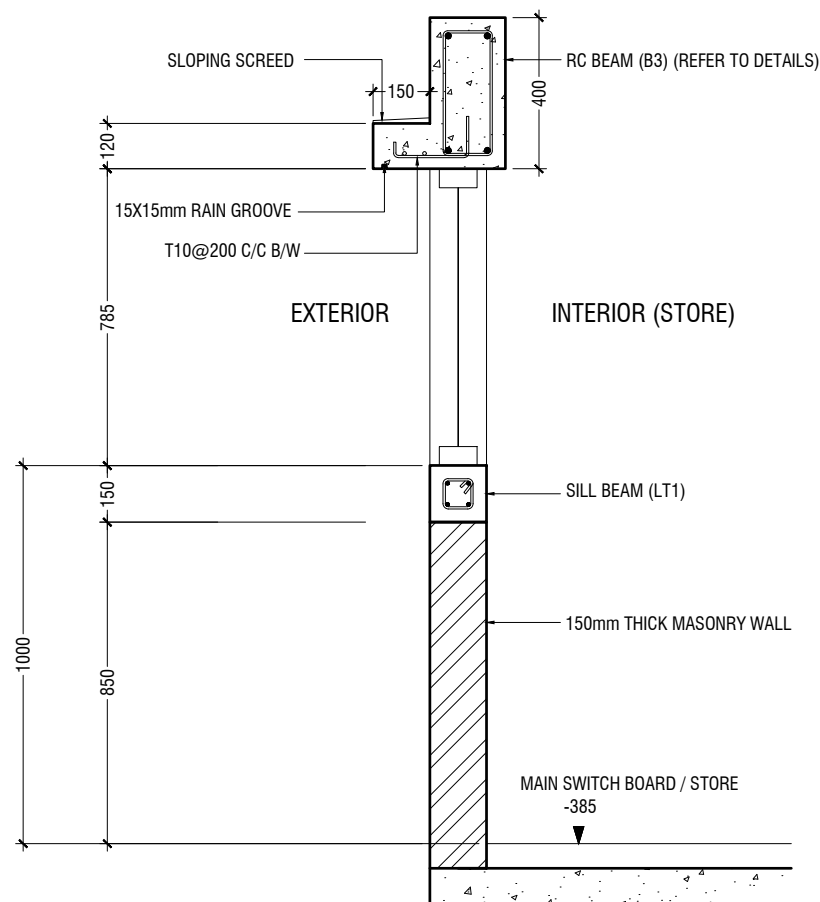

SECTION F-F

SCALE 1:20

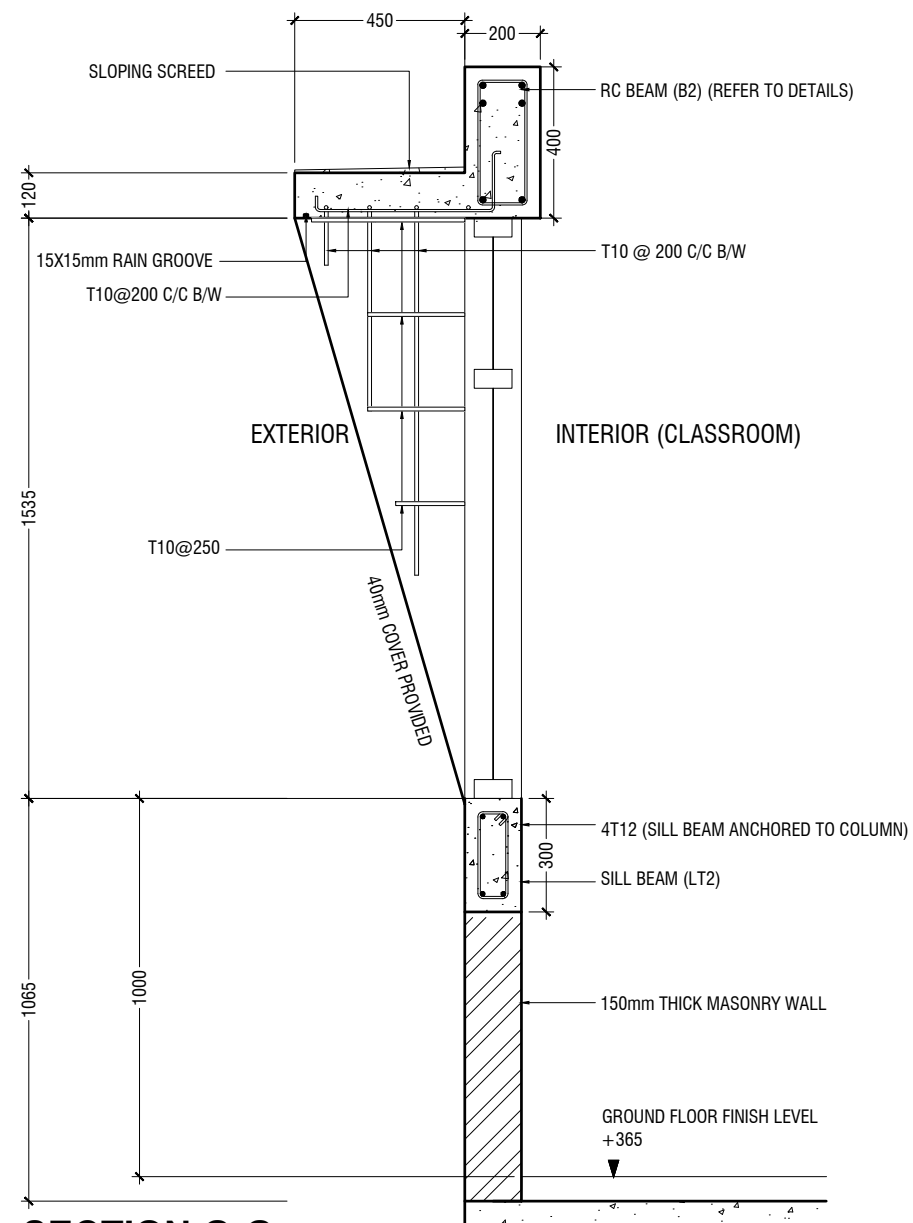


SECTION G-G

SCALE 1:20



* NOTE: GROUND FLOOR

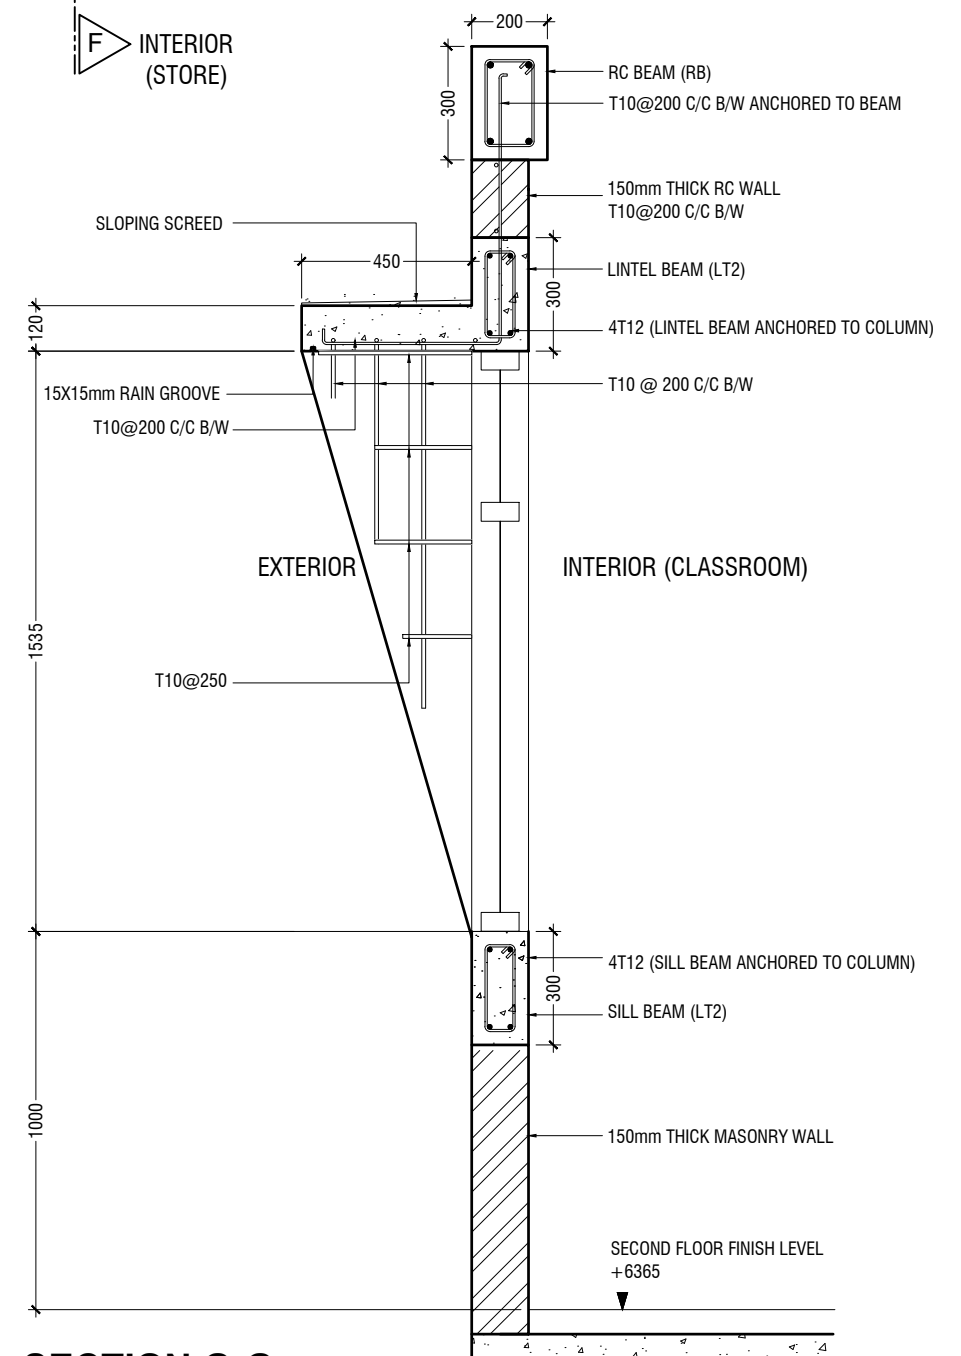

SECTION G-G


SCALE 1:20



* NOTE: SECOND FLOOR

DETAIL - 6 RC WALL DETAILS

SCALE 1:20



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ammeenemagu, Male

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021

Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: RC Wall Details

Page: A-21/21

GENERAL NOTES

THE GENERAL NOTES SHALL BE READ IN CONJUNCTION WITH THE CONTRACT SPECIFICATIONS AND DRAWINGS. REGARDLESS OF WHETHER OR NOT SHOWN IN DRAWINGS OR OTHER TENDER DOCUMENTS, THE STANDARD PROVISIONS SPECIFIED HEREUNDER FOR COMPLIANCE BY THE CONTRACTOR SHALL APPLY TO ALL RELEVANT PORTIONS OF THE STRUCTURAL WORKS AND SHALL FORM PART OF THIS CONTRACT.

1.0 VERIFICATION OF DIMENSIONS AND LEVELS

- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND LEVELS ON SITE, AND RESOLVE ALL DISCREPANCIES WITH THE ARCHITECT OR ENGINEER PRIOR TO COMMENCEMENT OF WORK.
- DRAWING INDICATES GENERAL & TYPICAL DETAILS OF CONSTRUCTION. WHERE CONDITIONS ARE OF SIMILAR CHARACTER TO DETAILS SHOWN AND ALTHOUGH NOT SPECIFICALLY INDICATED, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED SUBJECTED TO REVIEW BY THE ENGINEER.
- PRIOR TO COMMENCEMENT OF WORKS, THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND LEVELS IN THE CONTRACT DRAWINGS.
- DISCREPANCIES IN DRAWINGS ARISING FROM SUCH VERIFICATION WORKS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER.

2.0 SHOP DRAWINGS

- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ENSURING TOTAL COORDINATION OF ALL WORKS AND SHALL TAKE SITE MEASUREMENTS PRIOR TO THE PREPARATION OF ANY SHOP DRAWINGS OR BEFORE COMMENCING FABRICATION.
- THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL SPECIALIST TRADES, SUCH AS PRESTRESSING, CURTAIN WALLING, ETC. FOR REVIEWS AND COMMENTS BY THE ARCHITECT/ENGINEER PRIOR TO COMMENCEMENT OF WORK. SUCH SHOP DRAWINGS SUBMITTED SHALL INCORPORATE ALL NECESSARY CONNECTION DETAILS TO THE STRUCTURAL MEMBERS SUCH AS CAST-IN INSERTS, EMBEDDED PLATES, ETC.

3.0 INCORPORATION OF M&E REQUIREMENTS IN THE STRUCTURE

- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ENSURING TOTAL COORDINATION OF STRUCTURAL, M & E PENETRATION DRAWINGS OF SERVICES AND SUBMIT SUCH SHOP DRAWINGS TO THE ARCHITECT/ENGINEER FOR REVIEWS AND APPROVAL PRIOR TO COMMENCEMENT OF WORK.
- THESE SHOP DRAWINGS SHALL INCORPORATE ALL MECHANICAL, ELECTRICAL AND SANITARY WORKS TO BE EMBEDDED IN CONCRETE AND ALL OPENINGS FOR ALL PIPE OR DUCT WORKS, BASED ON THE REQUIREMENTS OF M & E DRAWINGS IN HIS POSSESSION.
- HE SHALL CHECK AND RESOLVE ALL DISCREPANCIES WITH THE RESPECTIVE ENGINEER PRIOR TO PLACEMENT OF CONCRETE.

4.0 LEAN CONCRETE FOR SUSPENDED STRUCTURES

- UNLESS OTHERWISE STATED, 50 MM THICK LEAN CONCRETE WITH A MINIMUM 28-DAY CUBE STRENGTH OF 15N/MM² SHALL BE PROVIDED ON ALL SOIL SURFACES FORMING THE UNDERSIDE OF STRUCTURAL CONCRETE MEMBERS.

5.0 STRUCTURAL ELEMENTS ON GRADE

- UNLESS OTHERWISE STATED, A SINGLE LAYER OF 0.25 MM(HEAVY DUTY) POLYTHENE SHEET, OR EQUIVALENT THERMOPLASTIC MATERIAL, LAID OVER A COMPACTED 60 MM THICK LAYER OF HARD CORE BLINDED WITH SAND TO PREVENT GROUT LOSS FROM SEEPAGE INTO THE GROUND SHALL BE PROVIDED ON ALL SOIL SURFACES FORMING THE UNDERSIDE OF THE NON-SUSPENDED SLABS.

6.0 SUBGRADE UNDER STRUCTURAL ELEMENTS

- WHERE THE CONTRACTOR REQUIRES REMOVAL AND SUBSEQUENT BACKFILL OF SUBGRADE PRIOR TO CASTING OF PILECAP/WALL/BEAM/SLAB, HE SHALL ENSURE THAT THE BACKFILL IS OF APPROVED MATERIAL AND THAT THE BACKFILL SHALL BE REASONABLY COMPACTED TO ENSURE THAT THE COMPACTED SOIL IS ABLE TO WITHSTAND THE WEIGHT OF THE WET CONCRETE. THE CONTRACTOR SHALL EXERCISE PROPER SKILL AND CARE TO AVOID DAMAGE TO ADJACENT INSTALLED STRUCTURES ARISING FROM HIS CONSTRUCTION SEQUENCE.

7.0 WATERPROOFING FOR STRUCTURES

- THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND METHOD STATEMENTS FOR THE ENGINEER'S APPROVAL PRIOR TO COMMENCEMENT OF WORK. REQUIRED SHOP DRAWING DETAILS INCLUDE BUT ARE NOT LIMITED TO TREATMENT OF FLASHINGS, WATERSTOP AT CONSTRUCTION JOINTS, WALL AND SLAB PENETRATIONS.
- ALL PENETRATIONS THROUGH STRUCTURAL ELEMENTS SHALL BE CAST-IN, SLEEVED AND PROVIDED WITH APPROVED PUDDLE FLANGE DETAIL. IF FOR ANY REASON THE CONTRACTOR IS UNABLE TO LAY WATERSTOP AT CONSTRUCTION JOINTS AS INDICATED IN THE DRAWINGS, HE SHALL AT HIS OWN EXPENSES PROVIDE ADEQUATE GROUT TUBES FOR WATERPROOF PRESSURE GROUTING TO ENSURE WATERTIGHTNESS OF THE JOINT.
- ALL GROUT TUBES SHALL BE MARKED AND PROTECTED FROM BLOCKAGE.
- BACKFILLING OPERATIONS AGAINST VERTICAL SURFACE SHALL BE CARRIED OUT AS SOON AS THE WATERPROOFING BARRIER IS INSTALLED TO THE SATISFACTION OF THE ENGINEER.

8.0 CASTING LAYERS

- INCLINED CASTING LAYERS AND INCLINED CONSTRUCTION JOINTS SHALL BE AVOIDED.
- HORIZONTAL CASTING LAYERS SHALL NOT IN GENERAL EXCEED 0.6 M THICKNESS UNLESS OTHERWISE APPROVED BY THE ENGINEER.

9.0 FOUNDATIONS

- ALL FOUNDATIONS HAS BEEN DESIGNED FOR SAFE GROUND PRESSURE OF 150 KN/M.
- ALL BACKFILL SHOULD BE DONE WITH MATERIALS APPROVED BY THE CONSULTANT AND SOURCE. ALL BACKFILL SHOULD BE STRUCTURAL FILL, COMPACTED IN LAYERS AS SPECIFIED.
- WEAK POCKETS FOUND BELOW THE ASSUMED FOUNDATION LEVELS SHALL BE REMOVED AND REPLACED BY PLAIN CONCRETE.
- IN CASE OF EXCAVATIONS BELOW THE ASSUMED LEVEL OF THE FOUNDATION, THE SOIL SHALL BE REPLACED BY PLAIN CONCRETE.
- IN CASE GROUND WATER IS PRESENT ABOVE FOUNDATION LEVEL, THE CONTRACTOR SHALL BE RESPONSIBLE FOR DEWATERING THE BELOW LEVEL OF FOUNDATIONS.
- THE CONTRACTOR SHALL MAINTAIN DRY WORKING CONDITIONS THROUGH OUT THE CONSTRUCTION PERIOD. RESTORING WATER TABLE CAN BE DONE AFTER BACKFILLING AND COMPACTION UP TO THE SLAB ON GRADE LEVEL, OR AS DIRECTED BY THE ENGINEER.
- NO BACK FILLING SHALL BE PLACED AGAINST WALLS RETAINING EARTH, UNLESS THE WALLS ACHIEVE SUFFICIENT STRENGTH TO PREVENT MOVEMENT OR STRUCTURAL DAMAGE.

10.0 CONSTRUCTION LOAD AND SHORING

- CONSTRUCTION LIVE LOAD IMPOSED ON ANY SINGLE FLOOR SHALL NOT EXCEED 1.5 KN/M². UNLESS OTHERWISE APPROVED BY THE ENGINEER, DEAD LOAD OF THE TOP CONSTRUCTION FLOOR SHALL BE SUPPORTED BY TWO COMPLETED FLOORS DIRECTLY BELOW IT.
- PROPS TO BEAMS AND SLABS AT ANY FLOORS SHALL NOT BE REMOVED UNTIL THE TWO IMMEDIATE FLOORS ABOVE THAT LEVEL ARE CAPABLE OF SUPPORTING THEMSELVES AS WELL AS ANY LOADS IMPOSED DURING CONSTRUCTION. CONSIDERATIONS GOVERNING REMOVAL OF PROPS INCLUDE BUT ARE NOT LIMITED TO THE ATTAINMENT OF 28-DAY STRENGTH FOR THE CONCRETE, DESIGN LOAD CAPACITY OF THE FLOOR UNDER REVIEW AND THE COMPLETION OF PRESTRESSING AND GROUTING OPERATIONS IN THE CASE OF A PRESTRESSED STRUCTURAL FLOOR SYSTEM.

- PROPS SHALL BE LEFT IN PLACE FOR SUPPORTING THE CONSTRUCTION LOADS APPROVED BY THE ENGINEER.
- NO ALLOWANCE HAS BEEN MADE IN THE DESIGN OF THE PERIMETER BEAMS/WALLS FOR THE SUPPORT OF TEMPORARY SCAFFOLDINGS.
- THE CONTRACTER SHALL ENGAGE HIS OWN PROFESSIONAL ENGINEER TO DESIGN AND STRENGTHEN THE BEAMS/WALLS.
- THE CONTRACTER SHALL ENGAGE HIS OWN PROFESSIONAL ENGINEER CHECK THE ADEQUACY OF SHORING DETAIL PROVIDED PROCEEDING THE WORK, AS SHORING WAS DESIGNED, CONSIDERING THE STATUS OF THE BUILDING AT THE TIME OF DESIGN.

11.0 CONCRETE COVER

- MINIMUM COVER TO OUTERMOST REINFORCEMENT INCLUDING LINKS SHALL BE AS FOLLOWS.

| STRUCTURAL ELEMENT | COVER (mm) |
|----------------------------------|------------|
| RAFT BEAM & SLAB (EARTH FACE) | 60 |
| RAFT BEAM & SLAB (INTERNAL FACE) | 60 |
| COLUMN | 40 |
| BEAM | 35 |
| BEAM (EXTERNAL FACE) | 40 |
| SLAB | 30 |
| INTERNAL WALL | 30 |
| EXTERNAL WALL | 40 |

- NOTE: EARTH FACE COVER OF BEAMS, COLUMNS & WALLS SHOULD BE 50mm

12.0 MATERIAL STRENGTHS

12.1 CONCRETE

- UNLESS OTHERWISE STATED, ORDINARY PORTLAND CEMENT CONFORMING TO BS 12, TO BE USED FOR ALL THE RC STRUCTURAL ELEMENTS.
- THE MINIMUM 28-DAY COMPRESSIVE CUBE STRENGTH OF CONCRETE FOR SPECIFIED STRUCTURAL ELEMENTS SHALL BE AS FOLLOWS UNLESS OTHERWISE STATED:

| MAIN BUILDING | |
|---|----------------------|
| LEAN CONCRETE | 15 N/mm ² |
| MASS CONCRETE | 30 N/mm ² |
| COLUMN, BEAM AND SLAB | 30 N/mm ² |
| EXTERNAL WORK | |
| PAVEMENTS | 30 N/mm ² |
| ALL OTHERS (CULVERT, DRAINS, MANHOLE, ETC) | 30 N/mm ² |
| FOUNDATION | |
| PILECAP, FOOTING, RAFT TIE-BEAM, CAPPING BEAM | 30 N/mm ² |

- CEMENT SHALL BE ORDINARY PORTLAND CEMENT TO BS 12.

Sn.Hithadhoo Sharafuddin School – 18 Classroom (03 Storey)
Client: Ministry of Education

| Project Number: RI/2020/006 | Rev no | Date |
|--------------------------------------|--------|-------|
| Date: January 2021 | -- | ----- |
| Architect : Mariyam Irasha Shareef | -- | ----- |
| Engineer : Mohamed Muththalib Waleed | -- | ----- |
| Drawn by : Mariyam Leevan Jaleel | -- | ----- |
| Services : Alishath Ahmed | -- | ----- |
| Interior : - | -- | ----- |



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagau, Male'

Title: General Notes

Page: S-00/12

12.2 REINFORCEMENT

- UNLESS OTHERWISE STATED, BAR SIZE 10MM DIAMETER OR LARGER SHALL BE HIGH TENSILE TYPE II DEFORMED BARS. THE MINIMUM YIELD STRENGTH OF STEEL BAR REINFORCEMENT SHALL BE AS FOLLOWS:

| | |
|-----------------------------------|-----------|
| MILD STEEL PLAIN BAR | 250 N/mm2 |
| HIGH TENSILE TYPE II DEFORMED BAR | 415 N/mm2 |

12.25 REINFORCEMENT ANCHORAGE OR LAPPING IS AS FOLLOWS U.N.O.

| | |
|-------------|---------------|
| | BAR GRADE 415 |
| TENSION | 45Ø |
| COMPRESSION | 45Ø |

Ø IS DIAMETER OF THE SMALLER SIZED LAPPED BAR.

- NO SPLICE SHALL BE MADE AT POINT OF MAXIMUM STRESS,EG IN BEAMS AND SLABS, THERE SHALL BE NO SPLICING OF TOP BARS OVER SUPPORTS NOR BOTTOM BARS AT MID-SPANS. SPLICES SHALL BE STAGGERED WHEREVER POSSIBLE. LAP LENGTH FOR UNEQUAL SIZE BARS (OR WIRES IN FABRIC) MAY BE BASED UPON THE SMALLER BAR. FOR BUNDLED BARS, THE EQUIVALENT DIAMETER SHALL BE USED. CRANKING OF BARS SHALL NOT EXCEED A SLOPE OF 1:10.
- FOR LAP LENGTH, WHERE SYMBOLS ARE NOT INDICATED, THE TENSION LAP LENGTH SHALL BE FOLLOWED.

13.0 STIRRUPS, LINKS AND TIES

- ALL STIRRUPS, LINKS AND TIES IN BEAMS, COLUMNS AND WALLS RESPECTIVELY SHALL TERMINATE NOT MORE THAN 75mm FROM THE FACE OF ANY ADJACENT STRUCTURAL MEMBERS.

14.0 SLAB DISTRIBUTION BARS

- REGARDLESS OF WHETHER OR NOT SHOWN ON PLAN, ALL DISTRIBUTION BARS FOR SLAB SHALL COMPRISE TYPICALLY ONE OF THE FOLLOWING COMBINATIONS, UNLESS OTHERWISE STATED IN THE RELEVANT DRAWINGS :

| SLAB THICKNESS (mm) | MIN. DISTRIBUTION BAR |
|--|-----------------------|
| 250 OR LESS | T10-300 |
| GREATER THAN 250 BUT LESS THAN OR EQUAL TO 300 | T10-200 |
| GREATER THAN 300 BUT LESS THAN OR EQUAL TO 400 | T10-150 |

15.0 FLOOR RENDERING

- THICKNESS OF SCREED RENDERING/MASS CONCRETE TOPPING EXCEEDING 60 OR MORE SHALL BE REINFORCED WITH ONE LAYER OF R6.

16.0 SHRINKAGE CRACKS


- THE SURFACE OF CONCRETE SHALL BE ADEQUATELY AND CONTINUOUSLY CURED TO SPECIFICATION TO PREVENT FORMATION OF SHRINKAGE CRACKS.THOUGH SHRINKAGE CRACKS HAVE NO EFFECT ON THE STRENGTH AND INTEGRITY OF THE STRUCTURE,THEY SHOULD BE SEALED BY EPOXY PRESSURE GROUTING. ALL COST INCURRED FOR THE NECESSARY SEALING UP OF SHRINKAGE CRACKS BY EPOXY PRESSURE GROUTING SHALL BE DEEMED TO BE INCLUDED IN THE CONCRETE WORK AS TENDERED.

17.0 STEEL BAR CORROSION PROTECTION

- ALL EXPOSED BARS FOR FUTURE CONSTRUCTION PURPOSES (EXCEEDING 3 MONTHS) MUST BE COATED WITH MASTER EMACO 8100 AP OR APPROVED EQUIVALENT AND PROVIDED WITH ADEQUATE MAINTENANCE.


18.0 SPACER BARS

- ALL SPACER BARS BETWEEN 2 OR MORE LAYERS OF REINFORCEMENT SHALL T25 OR BAR DIAMETER (WHICHEVER IS GREATER) AT ±1-5M C/C.




Ø = DIA OF LINK


SHEAR LINKS ANCHORAGE DETAIL

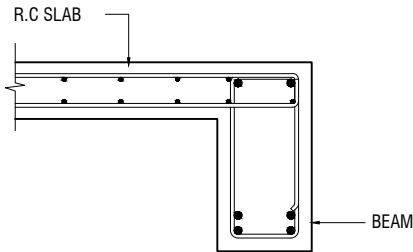

SLAB-BEAM ANCHORAGE DETAIL

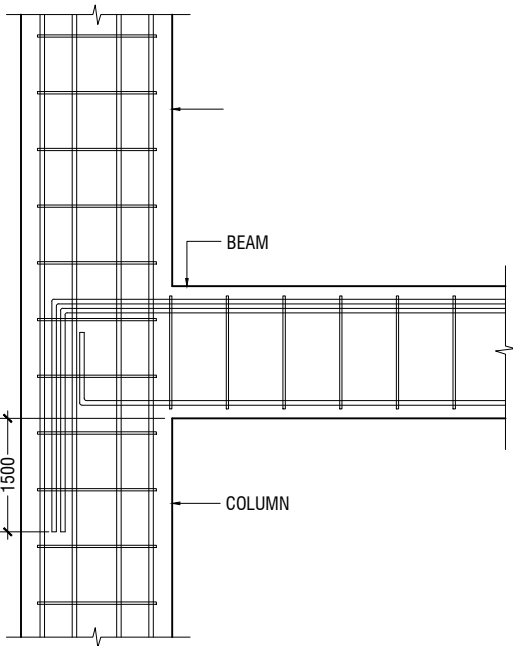

BEAM TO COLUMN CONNECTION

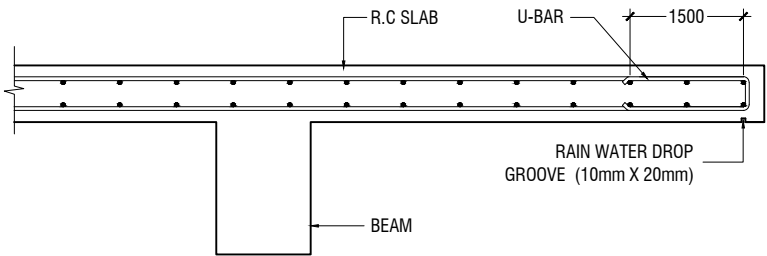

CANTILEVERED SLAB EDGE DETAIL

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

| Project Number | Rev no | Date |
|---------------------------------------|--------|-------|
| Ri/2020/006 | -- | ----- |
| Date: January 2021 | -- | ----- |
| Architect : Mariyam Irasha Shareef | -- | ----- |
| Engineer : Mohammed Muththalib Waleed | -- | ----- |
| Drawn by : Mariyam Leevan Jaleel | -- | ----- |
| Services : Aishath Ahmed | -- | ----- |
| Interior : - | -- | ----- |



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagau, Male'

Title: General Notes

Page: S-00/12

The contents of these drawings remain as a property of Riyan Private Limited. Any use other than those expressly stated is a violation of this copyright

19.0 STRUCTURAL TIMBER SPECIFICATION

19.1 THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE COMPLETED STRUCTURE, AND ARE NOT INTENDED TO INDICATE THE METHOD OR MEANS OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, PROCEDURES, TECHNIQUES, SEQUENCES, AND FOR JOB SAFETY.

19.2 THE ENGINEER DOES NOT HAVE CONTROL OR CHARGE OF, AND SHALL NOT BE RESPONSIBLE FOR, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, OR PROCEDURES, FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK, OR FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

19.3 ALL CONSTRUCTION IS IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING ALL WORK IN COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS.

19.4 ALL TIMBER FOR STRUCTURAL USE SHALL BE HARDWOOD OR SOFTWOOD OF VISUAL GRADE C/D IN ACCORDANCE WITH BS 5756 WITH THE FOLLOWING MINIMUM GRADE STRESSES:

19.5 CONNECTIONS
PLATES - STAINLESS STEEL GRADE 316 OF STATED THICKNESS
BOLTS - SS GRADE 316

19.6 TIMBER TREATMENT
MOISTURE - PRESSURE IMPREGNATION OF CCA
INSECTS - TERMITE TREATMENT FOR TIMBER IN / NEAR GROUND

20.0 STRUCTURAL STEEL SPECIFICATION

1. SEE 21.0 ON PRIMARY CODES AND SPECIFICATIONS.

2. MATERIALS:

W-SHAPES & WT-SHAPES..... ASTM A992
S-SHAPES, M-SHAPES, HP-SHAPES..... ASTM A36
ST-SHAPES & MT-SHAPES..... ASTM A36
C-SHAPES & MC-SHAPES..... ASTM A36
ANGLES & PLATES..... ASTM A36
HSS SHAPES..... ASTM A500, GRADE B
STEEL PIPE..... ASTM A53 (TYPE E OR S), GRADE B
HIGH STRENGTH BOLTS..... ASTM A325
MACHINE BOLTS..... ASTM A307
ANCHOR RODS.....ASTM F1554, GRADE 55 TYPE S1(UNO)
WELDED HEADED STUDS..... ASTM A108
DEFORMED BAR ANCHORS..... ASTM A496
WELDING ELECTRODES..... AWS D1.1, E70 SERIES

3. NON-SHRINK, NON-METALLIC GROUT WITH A 28 DAY STRENGTH OF 35MPa SHALL BE USED UNDER BASE PLATES AND SHALL CONFORM TO BS EN 12390-3 AND EN 196-1. MASTERFLOW 542 OR EQUIVALENT MAYBE USED.

23.0 POST-INSTALLED ANCHORS

1. POST-INSTALLED ANCHORS SHALL ONLY BE USED WHERE SPECIFIED ON THE DRAWINGS. CONTRACTOR SHALL OBTAIN APPROVAL FROM ENGINEER OF RECORD (EOR) PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSINGS OR MISPLACED ANCHORS.

2. CARE SHALL BE GIVEN TO AVOID CONFLICTS WITH EXISTING REINFORCING WHEN DRILLING HOLES. HOLES SHALL BE DRILLED AND CLEANED PER THE MANUFACTURER'S INSTRUCTIONS. ANCHORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AT NOT LESS THAN MINIMUM EDGE DISTANCES AND/OR SPACINGS INDICATED IN THE MANUFACTURER'S LITERATURE.

3. SPECIAL INSPECTION SHALL BE PROVIDED FOR ALL ADHESIVE AND MECHANICAL ANCHOR INSTALLATIONS AS REQUIRED BY THE EOR. INDEPENDENT ON-SITE PROOF LOAD TESTING SHALL BE PERFORMED AS REQUIRED BY THE EOR. CONTACT EOR FOR NUMBER OF ANCHORS REQUIRED TO BE TESTED AND REQUIRED PROOF LOAD MAGNITUDE.



RIYAN PRIVATE LIMITED


t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagui, Male'

Title: General Notes

Page: S-00/12


Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

| Project Number: RI/2020/006 | Rev no | Date |
|--------------------------------------|--------|-------|
| Date: January 2021 | -- | ----- |
| Architect : Mariyam Irasha Shareef | -- | ----- |
| Engineer : Mohamed Muththalib Waleed | -- | ----- |
| Drawn by : Maryam Leevan Jaleel | -- | ----- |
| Services : Aishath Ahmed | -- | ----- |
| Interior : - | -- | ----- |

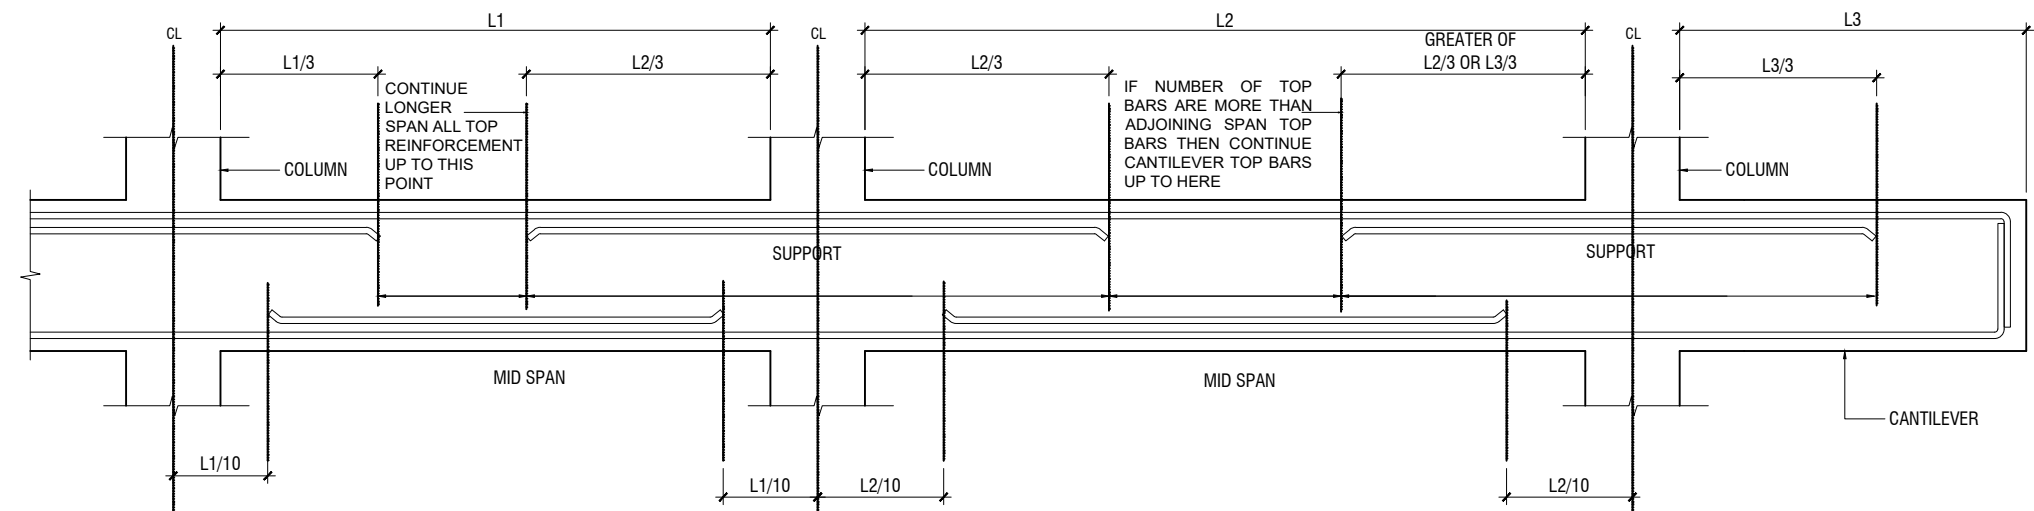


SIMPLIFIED DETAILING RULES FOR BEAMS (BS8110-1)

L1 = SHORTER SPAN
L2 = LONGER SPAN
L3 = CANTILEVER LENGTH

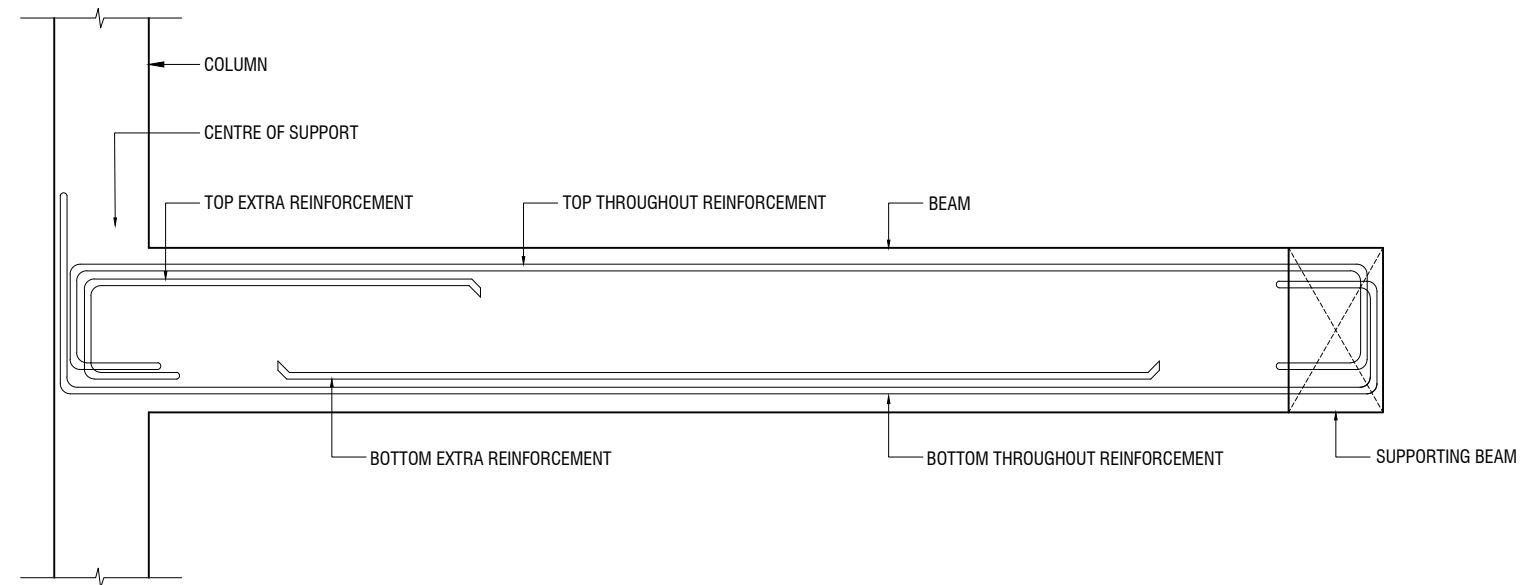

LONGITUDINAL SECTION OF TYPICAL SLAB BEAM SPANNING BETWEEN A COLUMN AND BEAM
SHOWING END SPAN MID SPAN REINFORCEMENT DETAILS

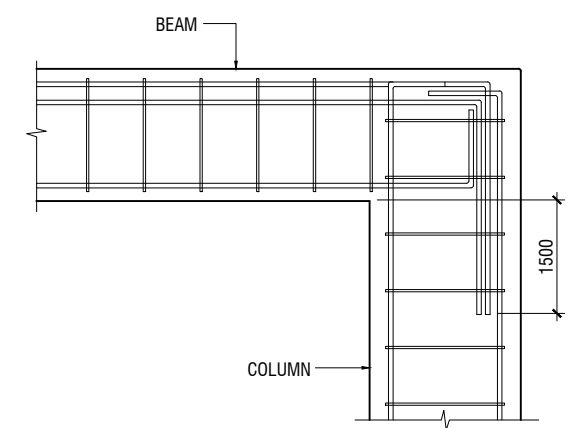

END COLUMN TO BEAM CONNECTION

NOTE:
STANDARD DETAILS GIVEN HERE ALSO APPLIES TO FOUNDATION MEMBERS
OTHER DETAILS NOT FOUND HERE SHALL BE REFEREED TO IN RELEVANT BS
CODES OR SHALL BE APPROVED BY CLIENT'S ENGINEER

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

| Project Number | Rev no | Date |
|---------------------------------------|--------|-------|
| R/2020/006 | -- | ----- |
| Date: January 2021 | -- | ----- |
| Architect : Mariyam Irasha Shareef | -- | ----- |
| Engineer : Mohammed Muththalib Waleed | -- | ----- |
| Drawn by : Mariyam Leevan Jaleel | -- | ----- |
| Services : Aishath Ahmed | -- | ----- |
| Interior : - | -- | ----- |




RIYAN PRIVATE LIMITED
t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagau, Male'


Title: General Notes

Page: S-00/12

The contents of these drawings remain as a property of Riyan Private Limited. Any use other than those expressly stated is a violation of this copyright

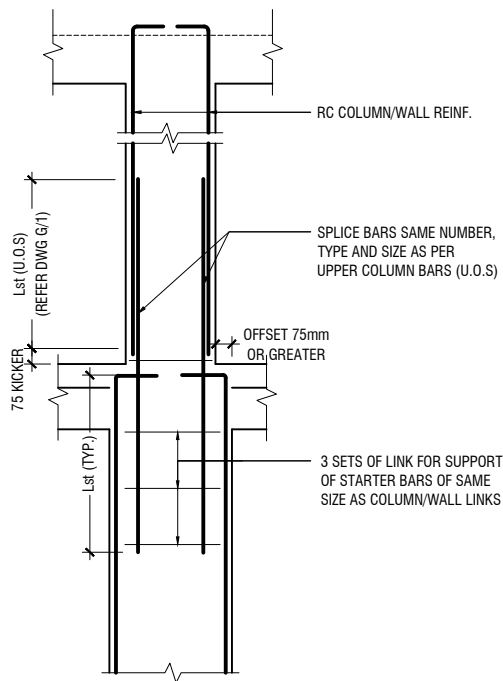


A) FOR COLUMN OFFSET > 75mm
TO BE VERIFIED BY THE CONSULTING ENGINEER

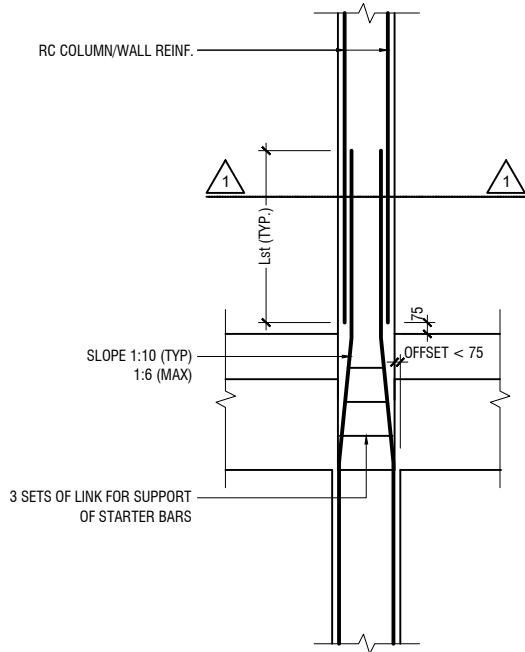


B) FOR COLUMN OFFSET < 75mm

COLUMN/WALL REINF. LAPPING DETAIL AT FLOOR LEVEL

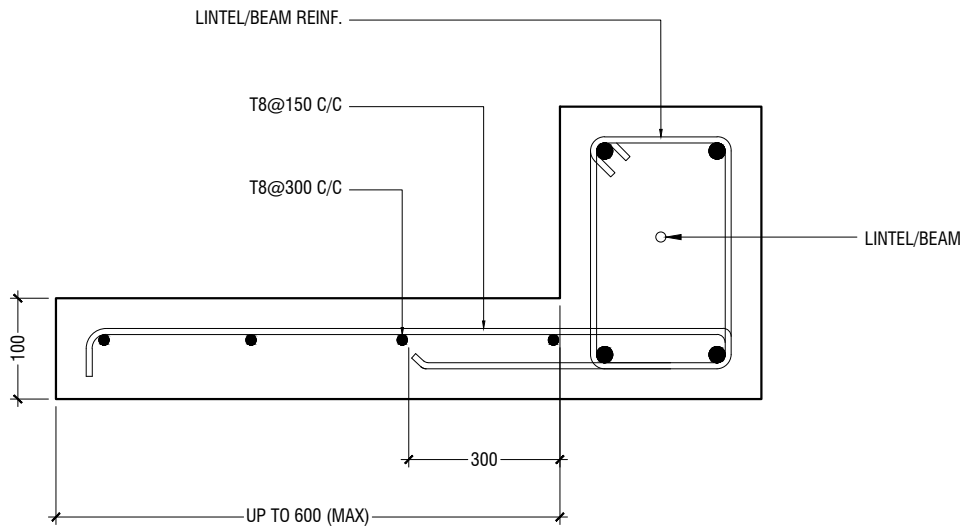


TYPICAL CANTILEVER DETAILS




SECTION-1-1

REINF. FROM LOWER FLOOR

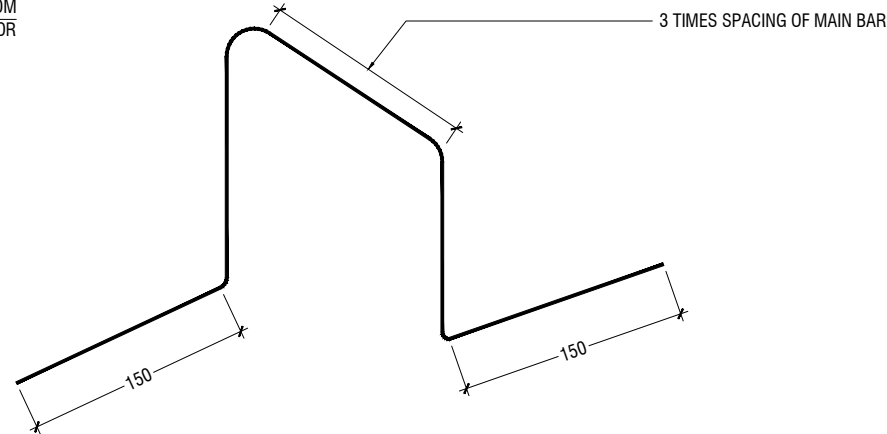

TYPICAL CHAIR DETAIL

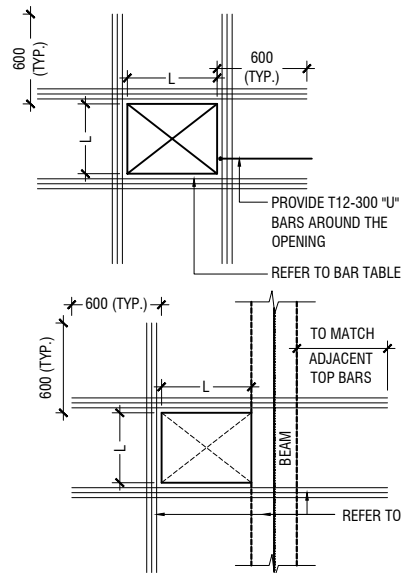

| FLOOR OPENING (L) | ADD BARS |
|-------------------|------------|
| LESS THAN 250 | 3T12 T & B |
| L = > 250 < 500 | 3T16 T & B |
| L = ≥ 500 < 1000 | 3T16 T & B |

NOTE:-

- FOR OPENINGS LESS THAN 200x200. SLAB REBARS TO BE ADJUSTED AROUND OPENING.
- FOR OPENINGS GREATER THAN 250x250 TO BE APPROVED BY THE ENGINEER.
- ALL SLAB OPENINGS LOCATION TO BE APPROVED BY THE ENGINEER.
- EQUIVALENT OPENING AREA SHALL APPLY THE DETAILS SHOWN ABOVE.
- EQUIVALENT OPENING AREA SHALL INCLUDE RECTANGLE, TRIANGLE AND ANY POLYGON SHAPE.
- EXCEPT HACKING, NO SLAB CORING ARE ADVISABLE FOR POST-TENSIONED SLAB.

TYPICAL TRIMMER BARS DETAILS FOR OPENING IN SLABS

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

| Project Number: RI/2020/006 | Rev no | Date |
|--------------------------------------|--------|------|
| Date: January 2021 | -- | --- |
| Architect : Mariyam Irasha Shareef | -- | --- |
| Engineer : Mohamed Muththalib Waleed | -- | --- |
| Drawn by : Mariyam Leevan Jaleel | -- | --- |
| Services : Aishath Ahmed | -- | --- |
| Interior : - | -- | --- |




RYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@ryan.com.mv
w : www.ryan.com.mv
3rd floor, H. Azum, Ameenemagau, Male'

Title: General Notes

Page: S-00/12

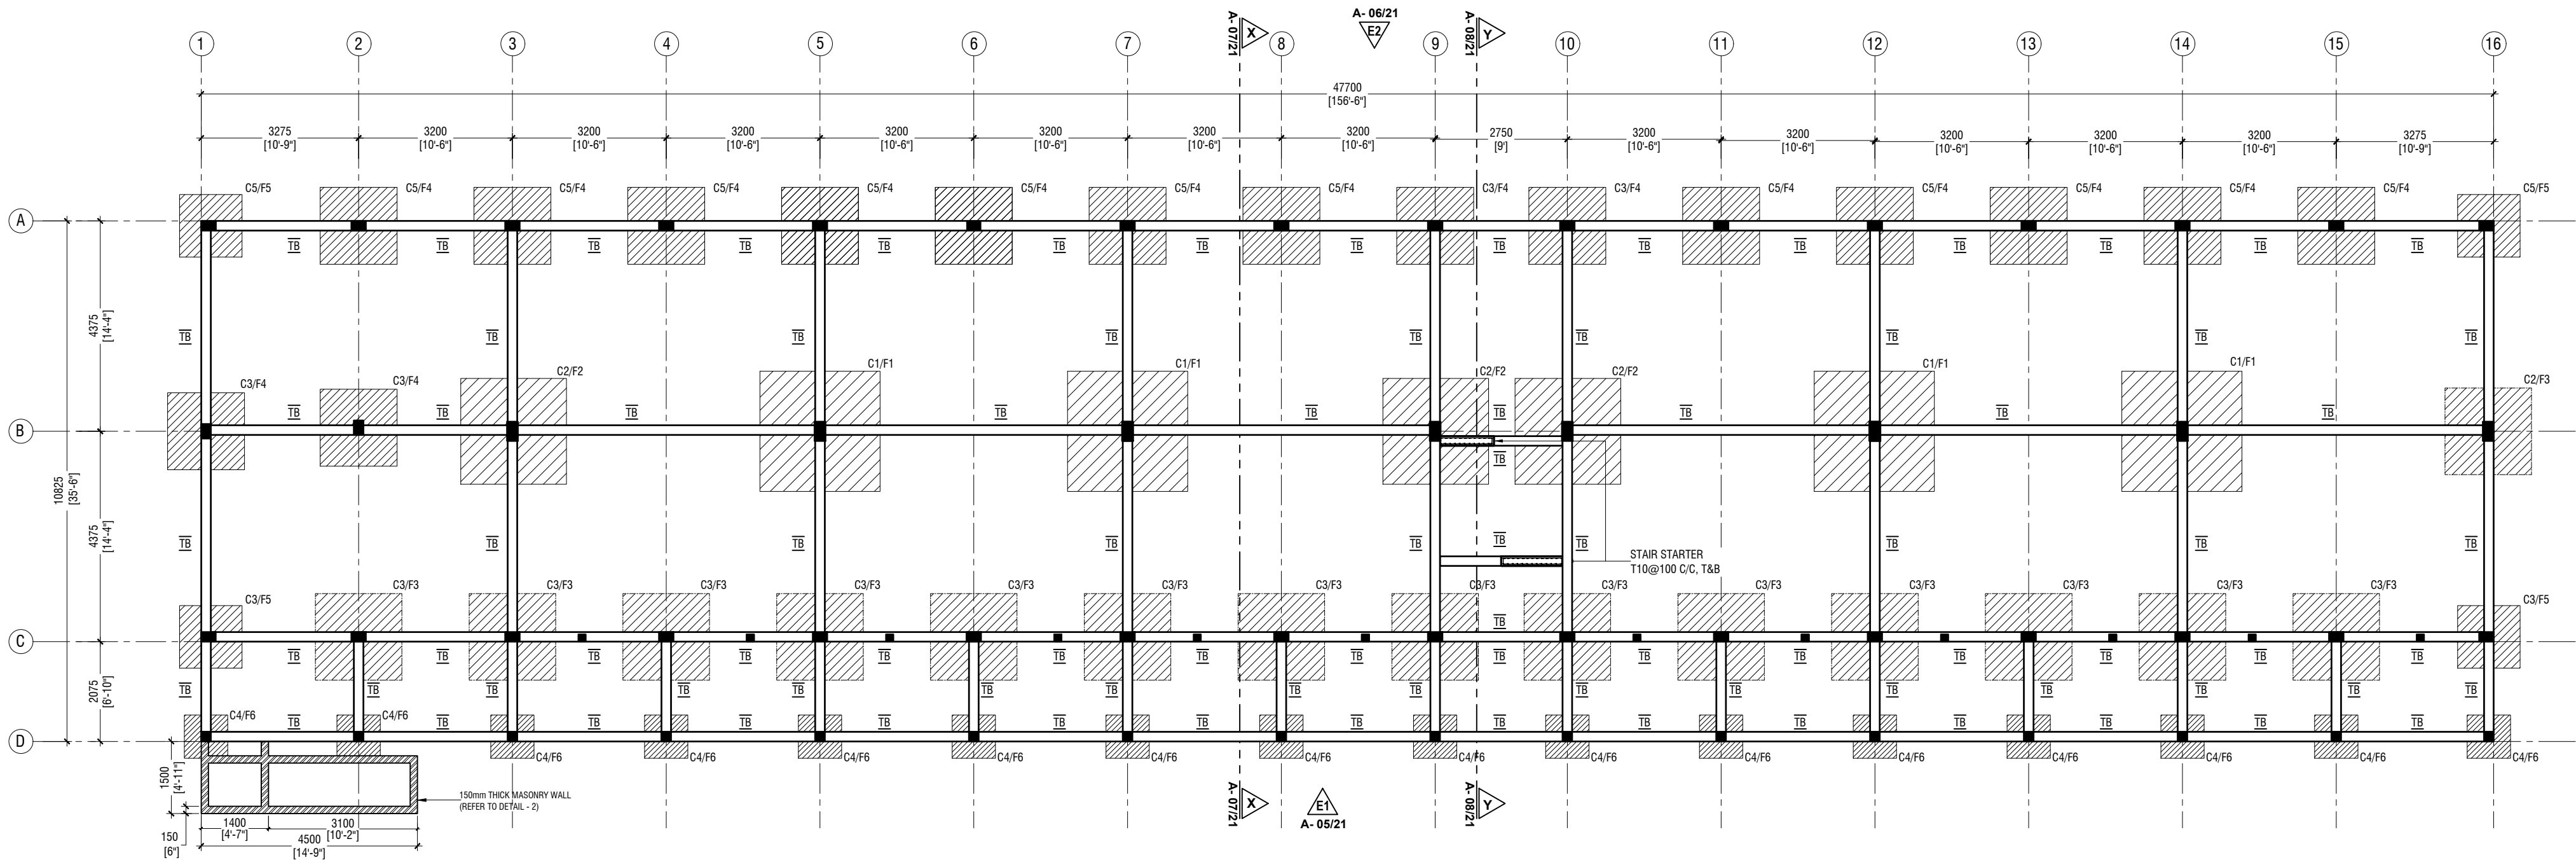

FOUNDATION PLAN

SCALE 1:100



NOTE:

COLUMN SIZES

| | |
|-------|----------------|
| C1 | : 225 x 400 mm |
| C2 | : 225 x 400 mm |
| C3 | : 200 x 300 mm |
| C4 | : 200 x 200 mm |
| C5 | : 200 x 300 mm |
| SC | : 150 x 150 mm |
| COVER | : 40mm |

FOUNDATION PAD SIZES

| | DIMENSION | REINFORCEMENT |
|----|-------------------|---------------------|
| F1 | 2500 x 2500 x 400 | T16@125 C/C B/W (B) |
| F2 | 2200 x 2200 x 350 | T16@150 C/C B/W (B) |
| F3 | 1800 x 1800 x 300 | T12@125 C/C B/W (B) |
| F4 | 1600 x 1600 x 300 | T12@125 C/C B/W (B) |
| F5 | 1300 x 1300 x 300 | T12@150 C/C B/W (B) |
| F6 | 900 x 900 x 300 | T12@150 C/C B/W (B) |

NOTE:

CONCRETE COVER

| | |
|----------|--------|
| COLUMN | : 40mm |
| SLAB | : 30mm |
| BEAM | : 35mm |
| FOOTING | : 50mm |
| TIE BEAM | : 50mm |

LAP LENGTH FOR BARS

| | |
|------|-----------|
| 25MM | : 1125 mm |
| 20MM | : 900 mm |
| 16MM | : 720 mm |
| 12MM | : 550 mm |
| 10MM | : 450 mm |

CONCRETE GRADE = M25

SAFE BEARING CAPACITY = 150KPa

HOOK LENGTH AND OTHER DETAILS ARE PROVIDED IN THE GENERAL NOTES

FOUNDATION DEPTH : 1200mm BELOW GROUND LEVEL

ALL FOOTINGS ARE TO BE LAID ON TOP OF 50mm THICK LEAN CONCRETE
APPLY WATER PROOFING TO SUBSTRUCTURE (BELOW GROUND ELEMENTS)

TIE BEAM SIZES

| | |
|-------|----------------|
| TB | : 200 x 450 mm |
| COVER | : 50mm |

GROUND SLAB : 100mm THK RC SLAB ON FILL
REINFORCED WITH T10@200 C/C BW

-150mm THK. SOLID MASONRY BLOCK WALL

RAMP SLAB : 100mm THK RC SLAB ON COMPACTED FILL
REINFORCED WITH T10@200 C/C BW



RIYAM PRIVATE LIMITED

t : +9603315049 f : +9603310776

e : info@riyam.com.mv

w : www.riyam.com.mv

3rd floor, H. Azumi, Ameeremadju, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect : Mariyam Irasha Shareef

Engineer : Mohamed Muththalib Waleed

Drawn by : Mariyam Leevan Jaleel

Services : Aishath Ahmed

Interior : -

Rev no

Date

--


--

--

--

Title: Foundation Plan

Page: S-01/12

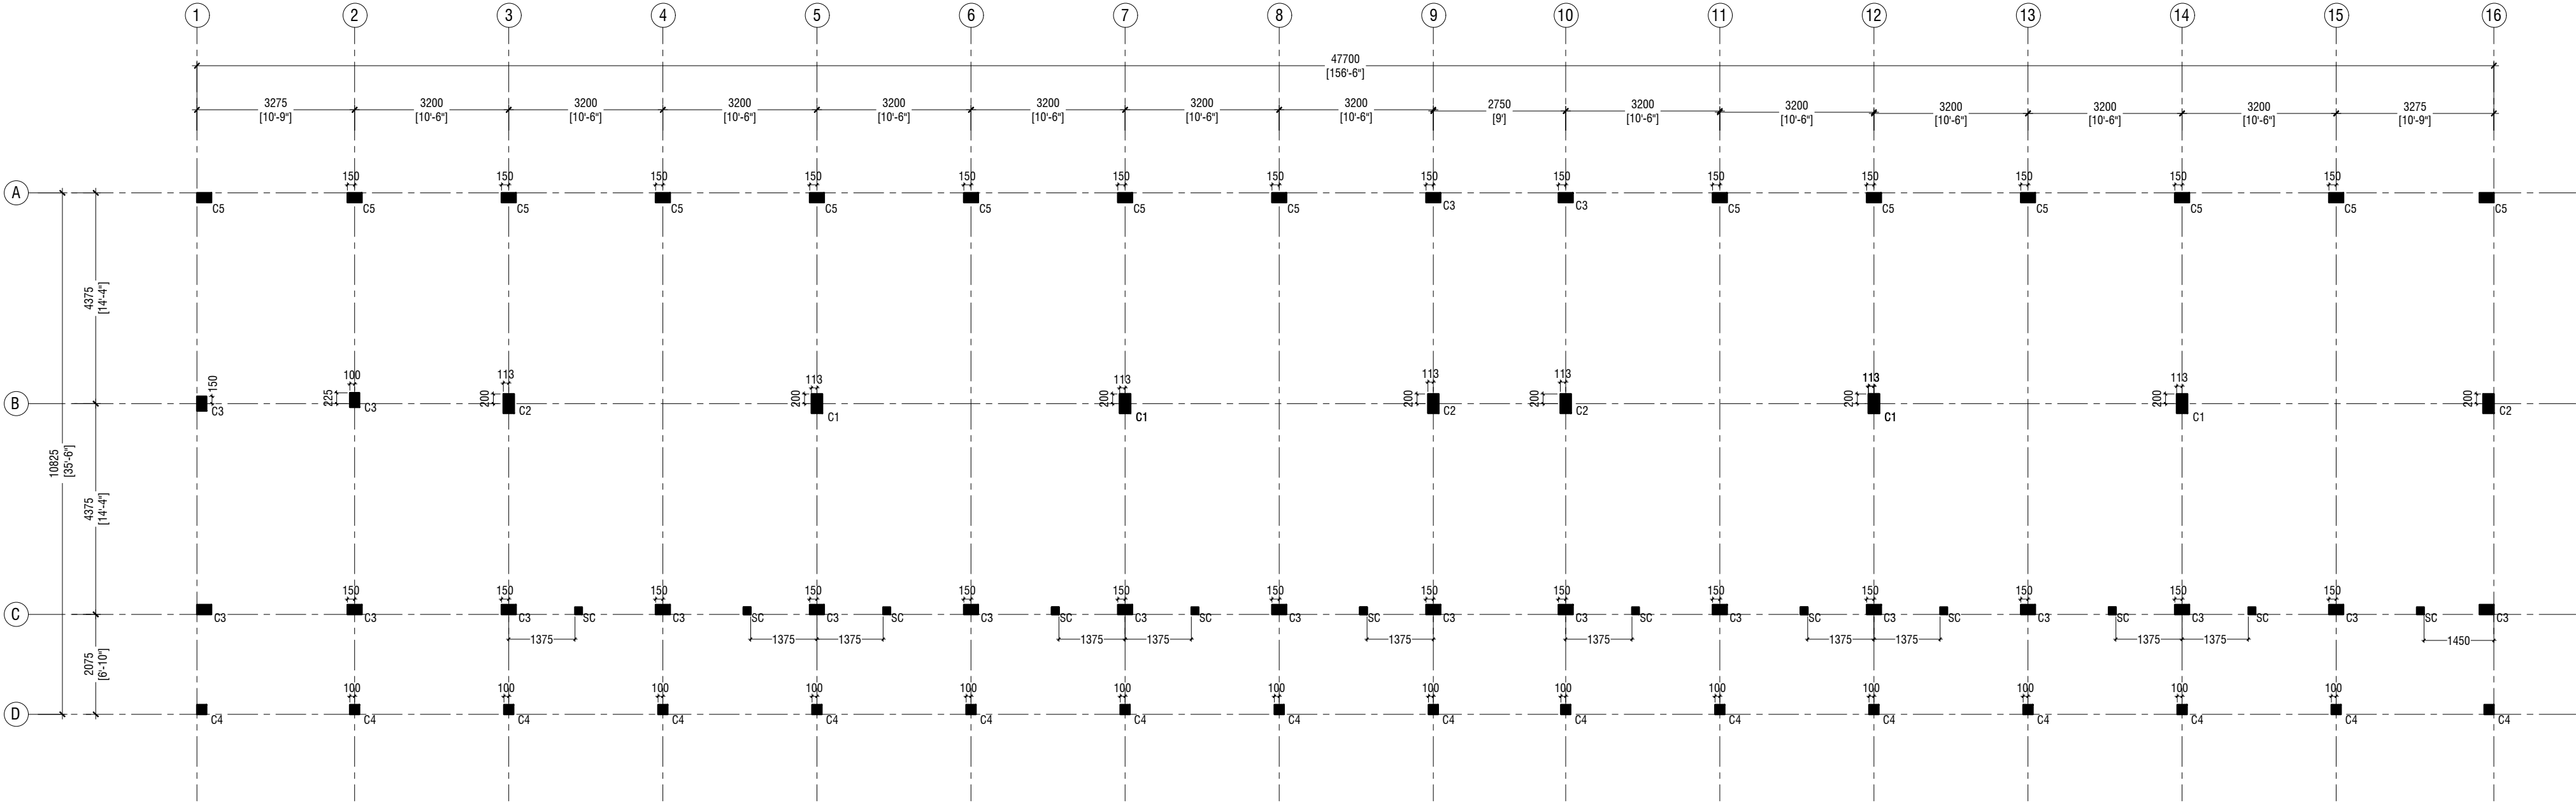


NOTE:

COLUMN SIZES

- C1 : 225 x 400 mm
- C2 : 225 x 400 mm
- C3 : 200 x 300 mm
- C4 : 200 x 200 mm
- C5 : 200 x 300 mm
- SC : 150 x 150 mm
- COVER : 40mm

FIRST - SECOND FLOOR COLUMN LAYOUT PLAN



RIYAH PRIVATE LIMITED
t : +9603350495 f : +960330776
e : info@riyah.com.mv
w : www.riyah.com.mv
3rd floor, H. Azim, Amereemajuu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no

Date

--


--

--

--

Title: Column Layout Plan

Page: S-02/12

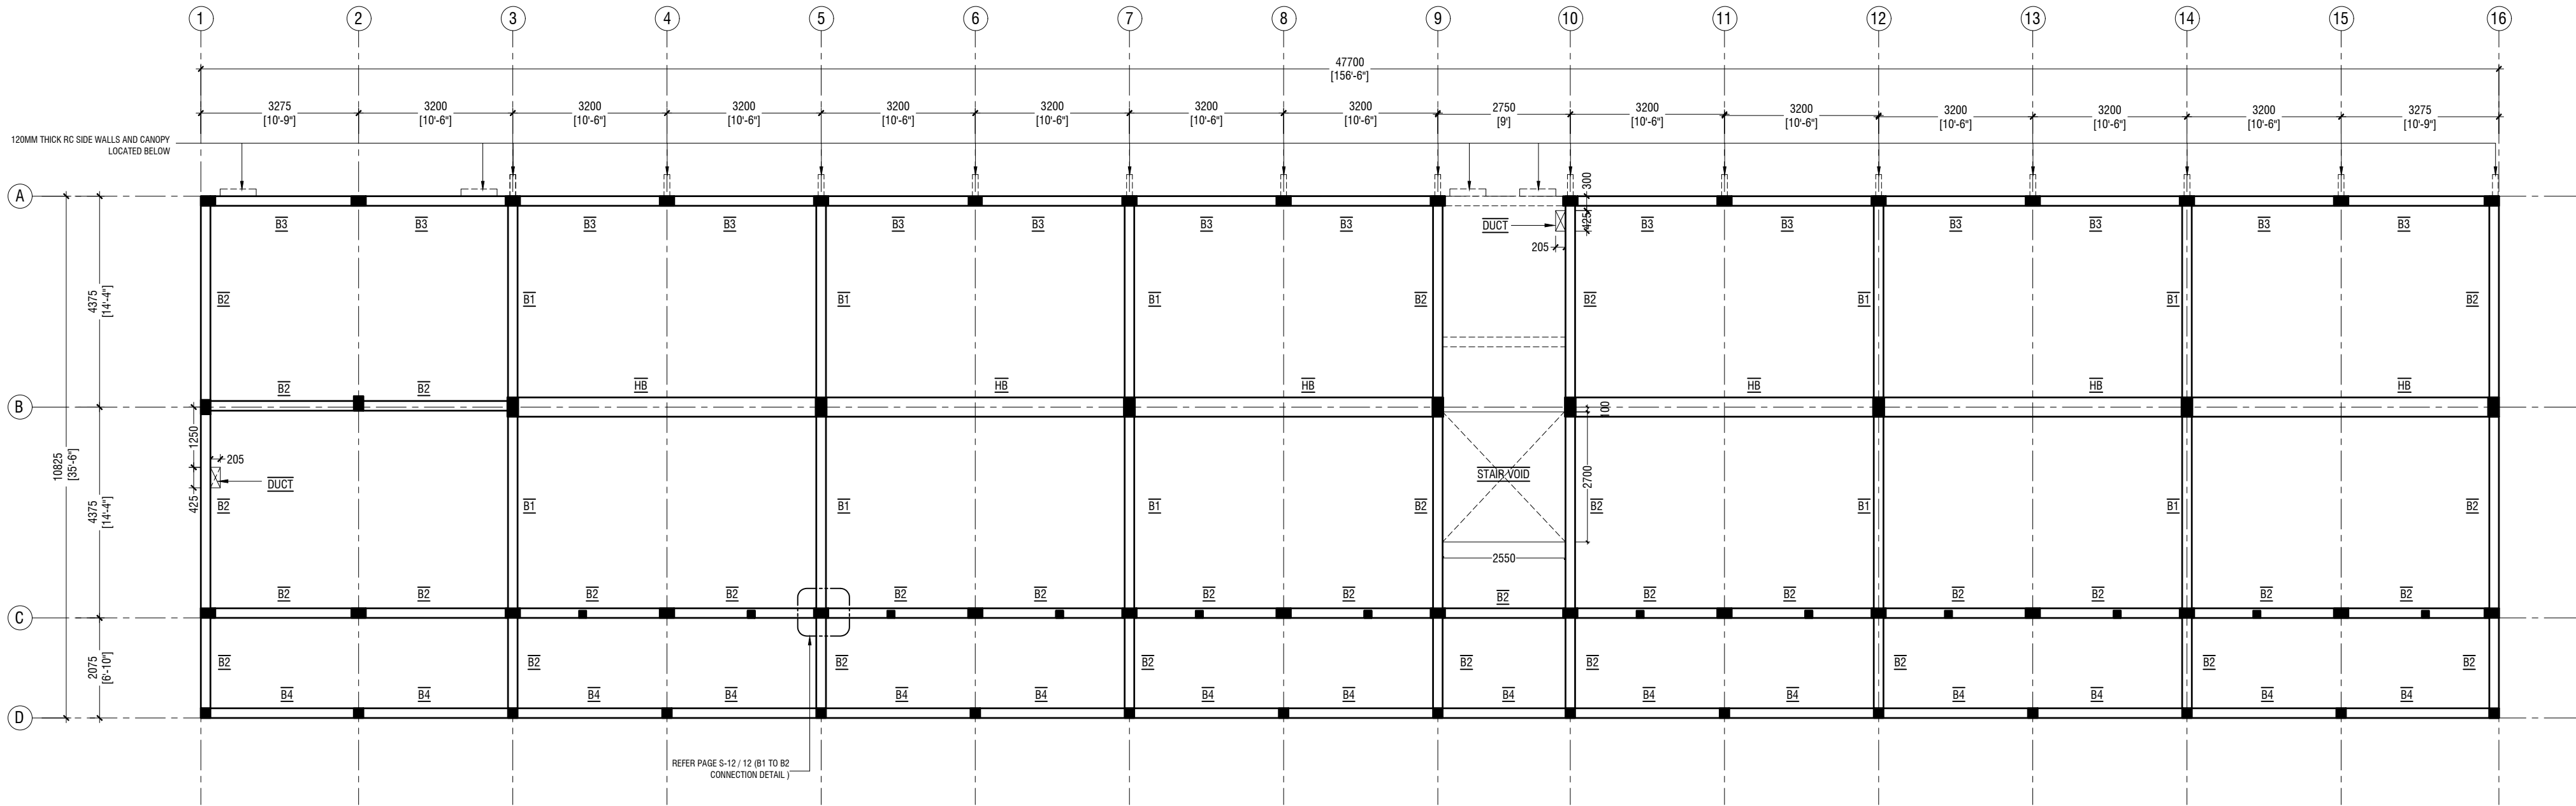

NOTE:

COLUMN SIZES

| | |
|-------|----------------|
| C1 | : 225 x 400 mm |
| C2 | : 225 x 400 mm |
| C3 | : 200 x 300 mm |
| C4 | : 200 x 200 mm |
| C5 | : 200 x 300 mm |
| SC | : 150 x 150 mm |
| COVER | : 40mm |

BEAM SIZES

| | |
|-------|--------------|
| B1 | : 200x475 mm |
| B2 | : 200x400 mm |
| B3 | : 200x400 mm |
| HB | : 400x180 mm |
| COVER | : 35mm |

FIRST - SECOND FLOOR BEAM PLAN

SCALE 1:100



RIYAN PRIVATE LIMITED

T : +9603350495 F : +9603310776
E : info@riyan.com.mv
W : www.riyan.com.mv
3rd Floor, H. Azumi, Ameenemajuu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no

Date

--


--

--

--

Title: 1st - 2nd Beam Plan

Page: S-03/12

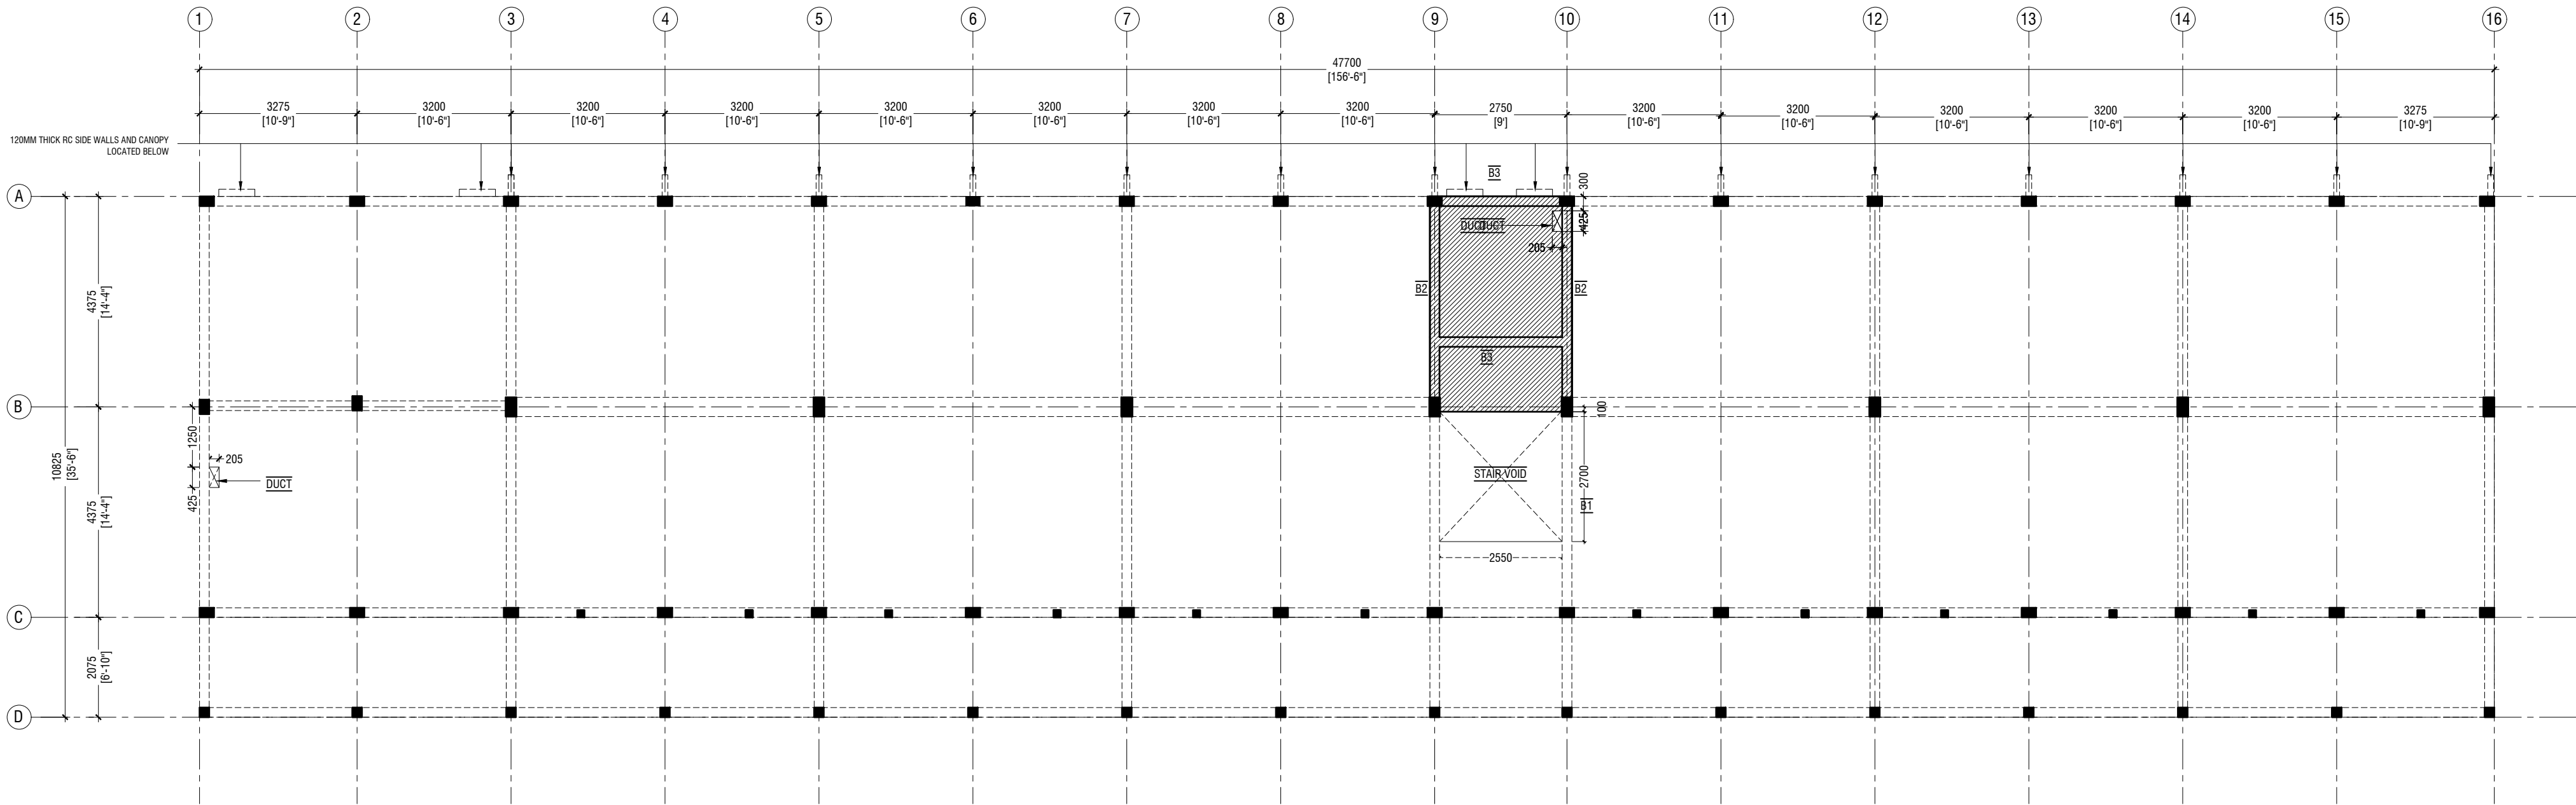

NOTE:

COLUMN SIZES

C1 : 225 x 400 mm
C2 : 225 x 400 mm
C3 : 200 x 300 mm
C4 : 200 x 200 mm
C5 : 200 x 300 mm
SC : 150 x 150 mm
COVER : 40mm

BEAM SIZES

B1 : 200x475 mm
B2 : 200x400 mm
B3 : 200x400 mm
HB : 400x180 mm
COVER : 35mm




SLAB THICKNESS: 150mm

REINFORCEMENT: T10@150C/C B/W (T&B)

ALL REINFORCEMENT TO BE DISCONTINUOUS OVER THE VOIDS

STORE / HALF LANDING FLOOR BEAM & SLAB REINFORCEMENT PLAN (+1865 & +4865)

SCALE 1:100



RIYAN PRIVATE LIMITED
t : +9603350495 f : +9603307076
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azumi, Ameenemadugu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

Rev no Date

-- -----

-- -----


-- -----

-- -----


-- -----


Title: Store Half Landing & Slabe Reinf. Plan

Page: S-04/12

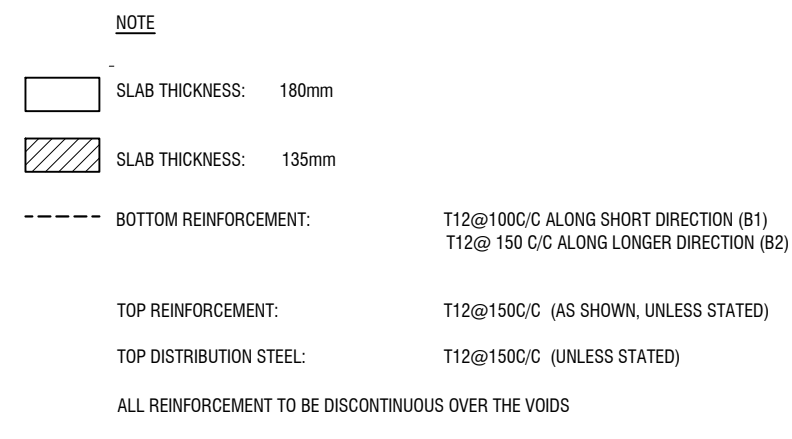

SCALE 1:100



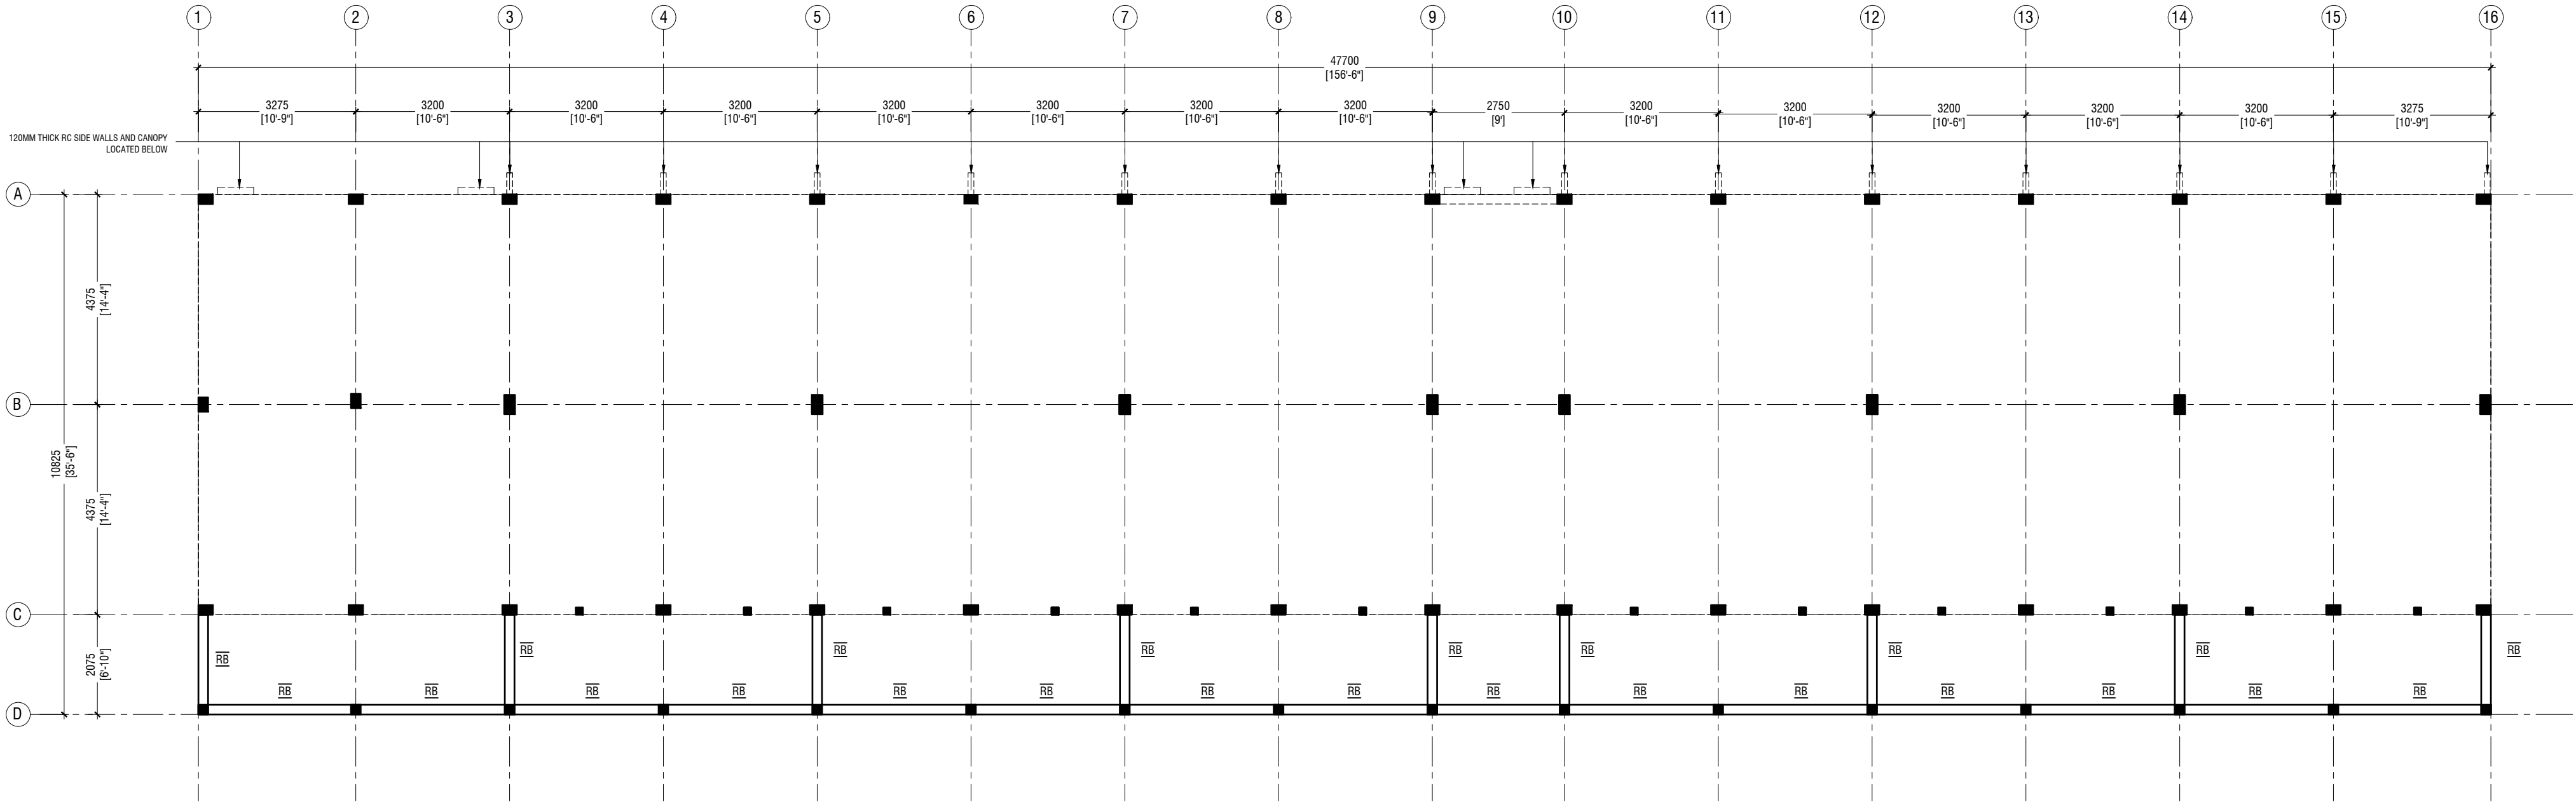

NOTE:

| COLUMN SIZES | |
|--------------|----------------|
| C1 | : 225 x 400 mm |
| C2 | : 225 x 400 mm |
| C3 | : 200 x 300 mm |
| C4 | : 200 x 200 mm |
| C5 | : 200 x 300 mm |
| SC | : 150 x 150 mm |
| COVER | : 40mm |

| BEAM SIZES | |
|------------|--------------|
| RB | : 200x300 mm |
| COVER | : 35mm |

ROOF BEAM PLAN - 1 @9.15 FROM F.F.L

SCALE 1:100



RIYAS PRIVATE LIMITED
t : +9603350495 f : +9603307076
e : info@riyas.com.mv
w : www.riyas.com.mv
3rd floor, H. Azumi, Ameenemadhu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel


Services: Aishath Ahmed

Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Roof Beam Plan - 1

Page: S-06/12

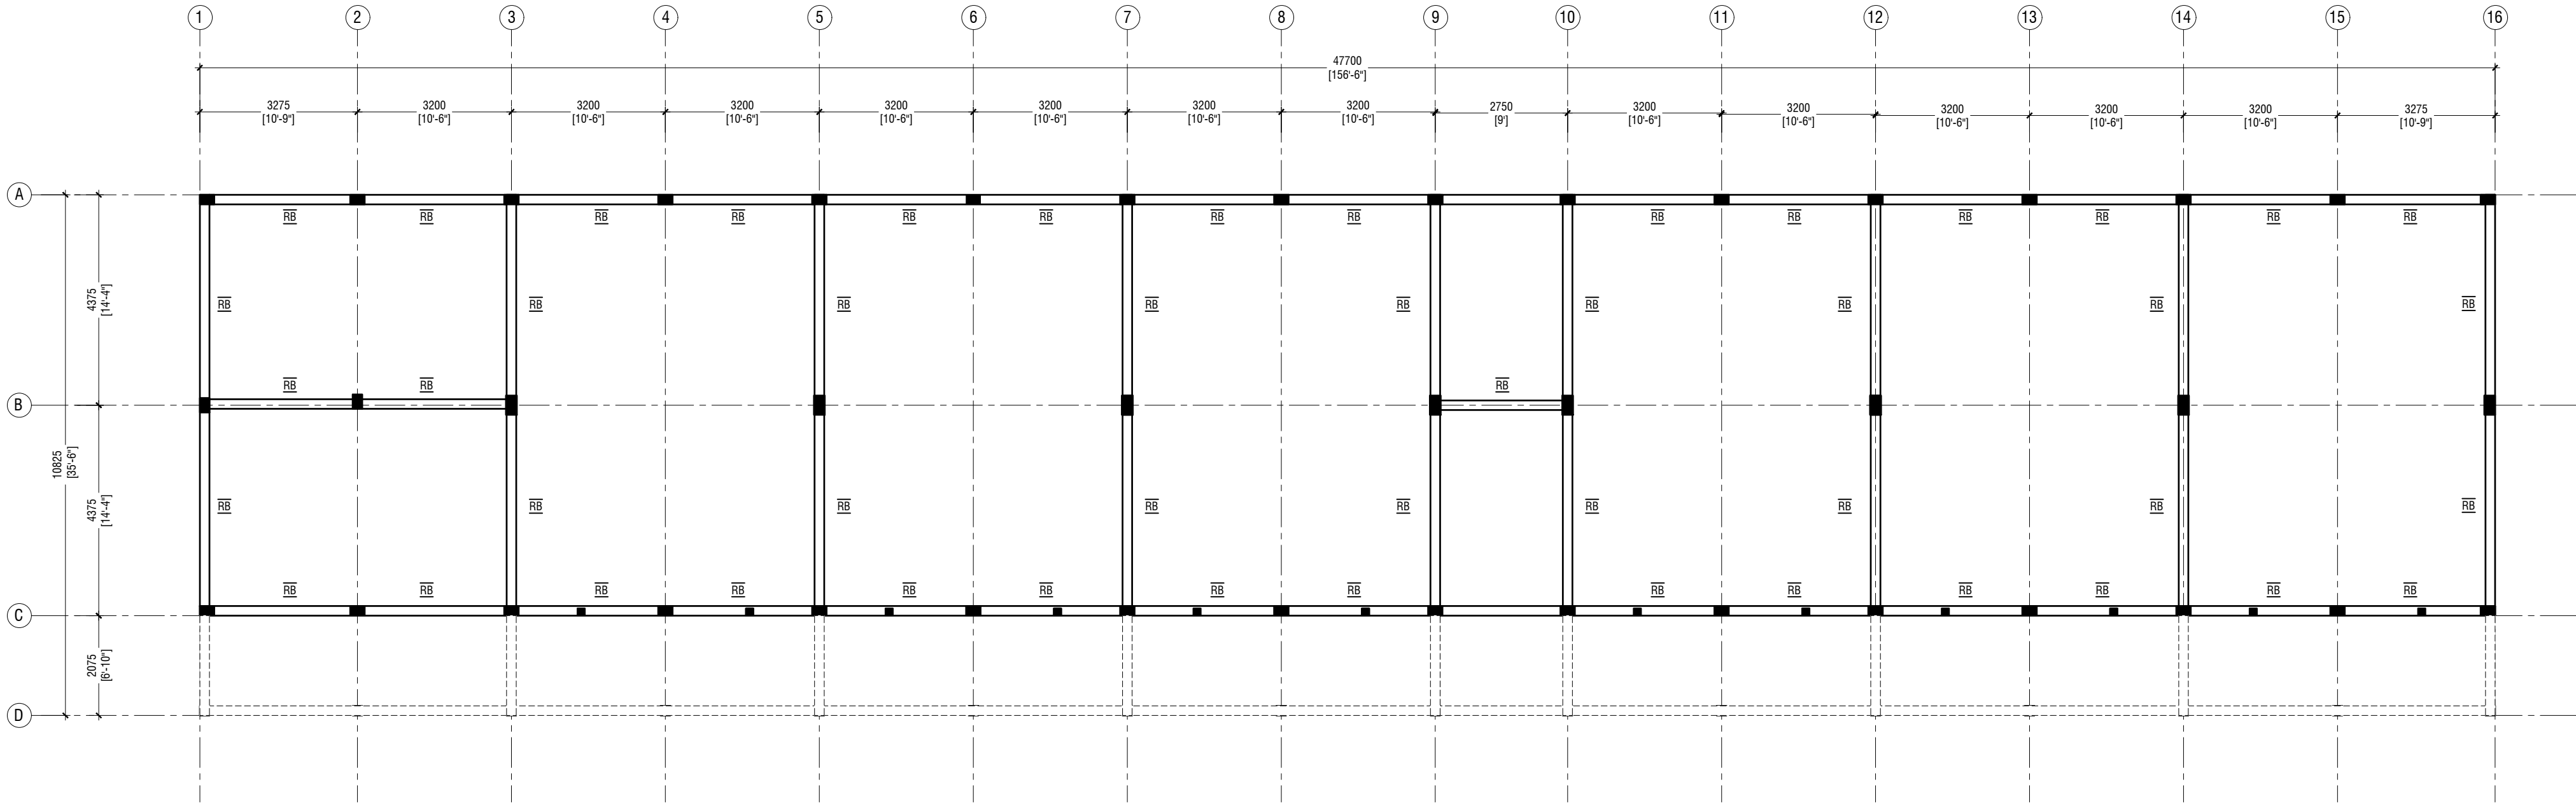



NOTE:

| COLUMN SIZES | |
|--------------|----------------|
| C1 | : 225 x 400 mm |
| C2 | : 225 x 400 mm |
| C3 | : 200 x 300 mm |
| C4 | : 200 x 200 mm |
| C5 | : 200 x 300 mm |
| SC | : 150 x 150 mm |
| COVER | : 40mm |

| BEAM SIZES | |
|------------|--------------|
| RB | : 200x300 mm |
| COVER | : 35mm |

ROOF BEAM PLAN - 2 @9.706 FROM F.F.L



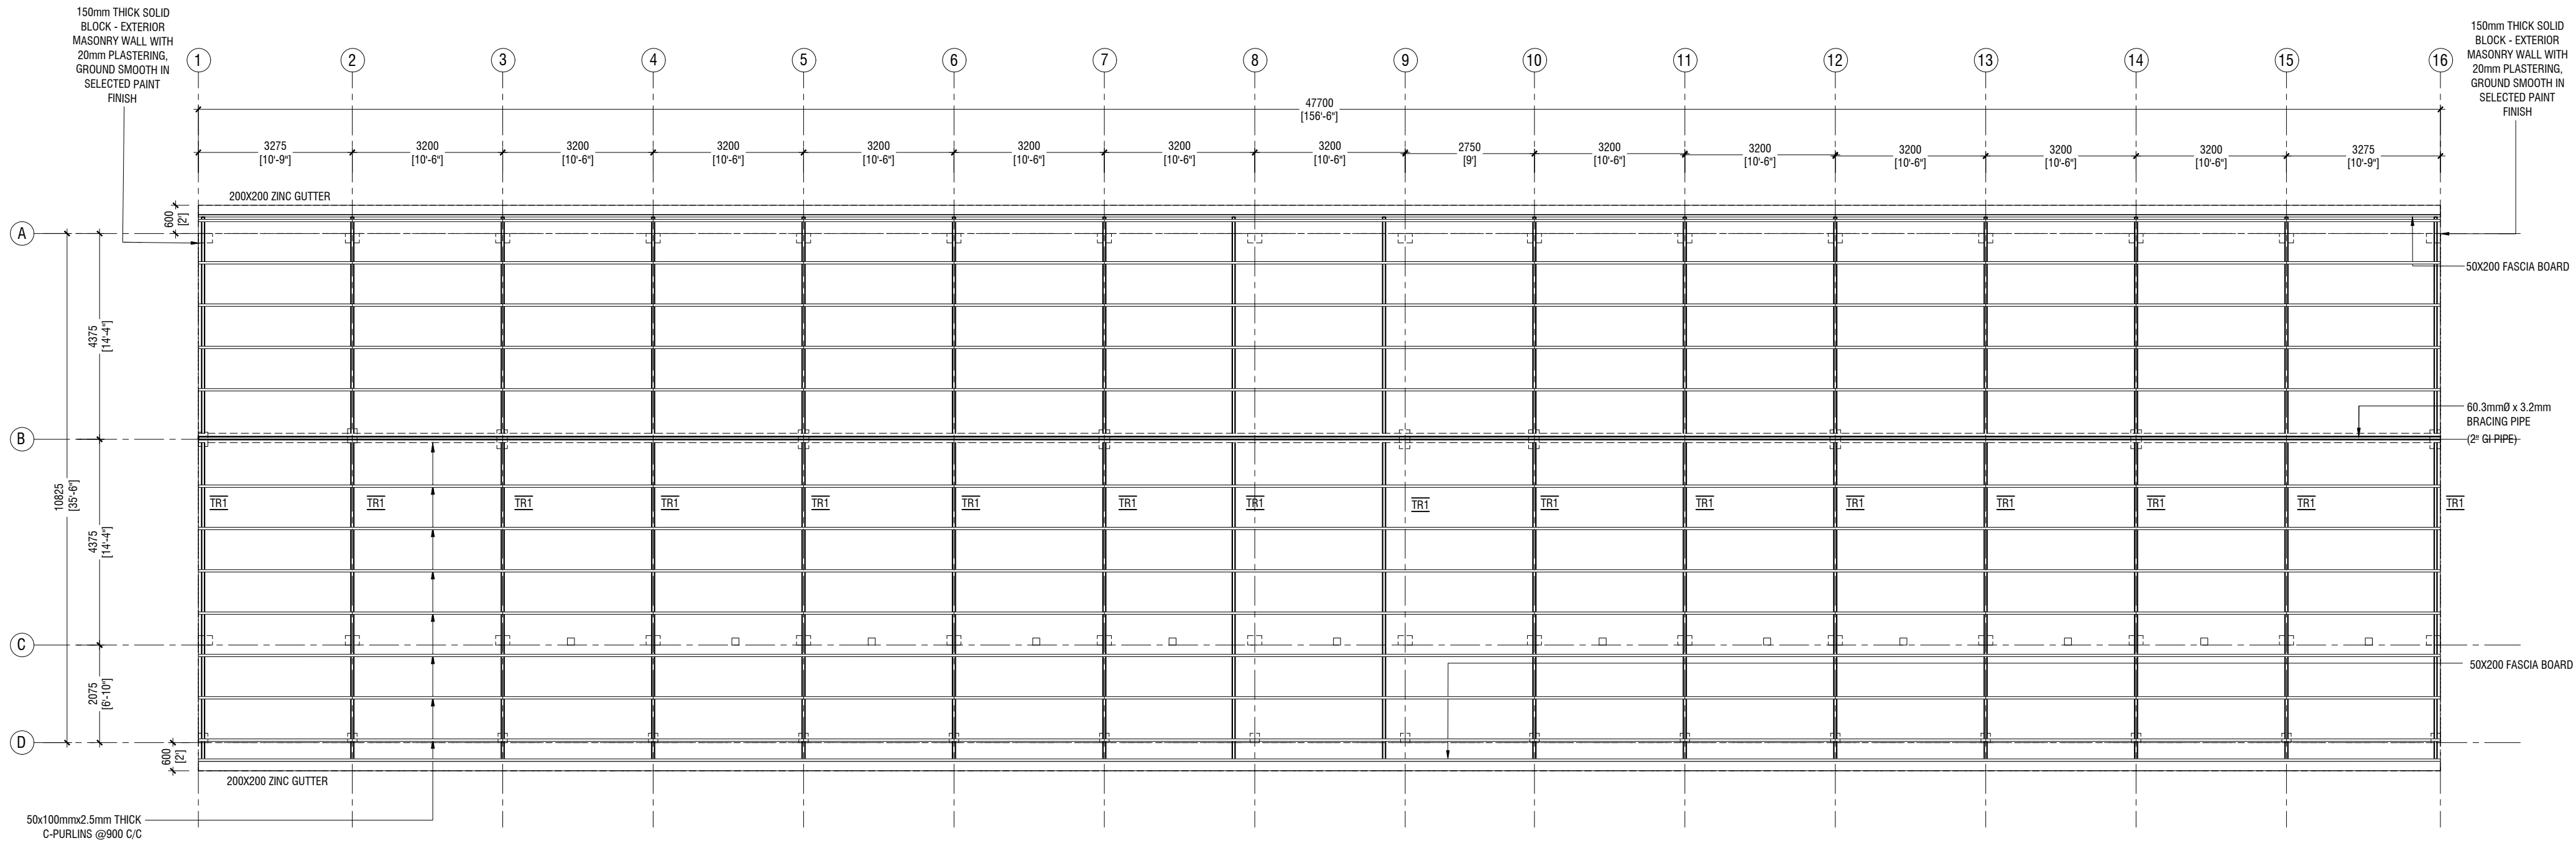

ROOF TRUSS & FRAMING PLAN

SCALE 1:100



RIYAS PRIVATE LIMITED

T: +9603350495 F: +9603310776
E: info@riyas.com.mv
W: www.riyas.com.mv
3rd Floor, H. Azim, Ameeremadhu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Mariyam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Mariyam Leevan Jaleel

Services: Aishath Ahmed

Interior: -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Roof Truss & Framing Plan

Page: S-08/12


| | DIMENSION | REINFORCEMENT |
|----|-------------------|---------------------|
| F1 | 2500 x 2500 x 400 | T16@125 C/C B/W (B) |
| F2 | 2200 x 2200 x 350 | T16@150 C/C B/W (B) |
| F3 | 1800 x 1800 x 300 | T12@125 C/C B/W (B) |
| F4 | 1600 x 1600 x 300 | T12@125 C/C B/W (B) |
| F5 | 1300 x 1300 x 300 | T12@150 C/C B/W (B) |
| F6 | 900 x 900 x 300 | T12@150 C/C B/W (B) |

FOUNDATION DEPTH = 1200mm


NOTE:-
COVER TO FOUNDATION = 50mm
COVER TO COLUMNS = 40mm
COVER TO BEAMS = 35mm
COVER TO SLAB = 30mm
LAPS = Ø OF BAR x 45
BEAMS @END SUPPORT = Ø OF BAR x 12

GRADE OF CONCRETE = M25


FOUNDATION PADS

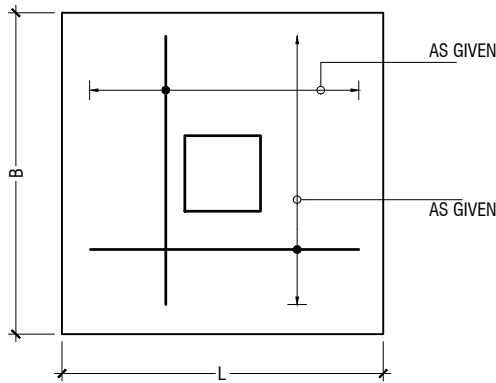

PLAN

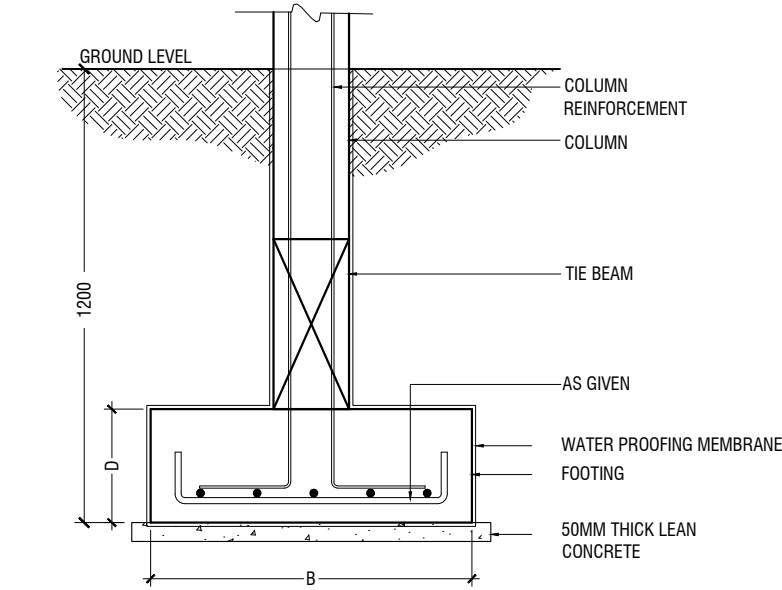

TYPICAL FOOTING SECTION

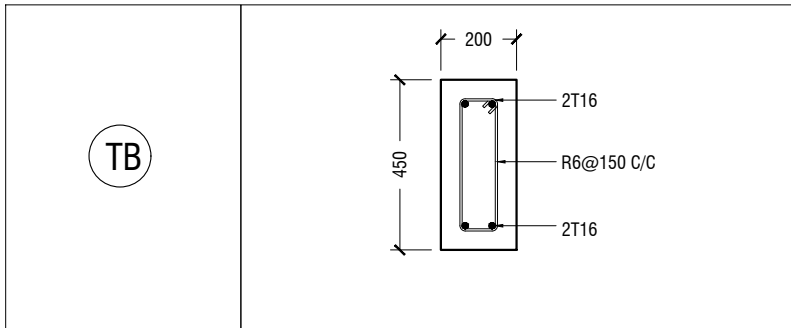

FOUNDATION DETAILS

| | GROUND & 1ST FLOOR |
|----|--------------------|
| C1 | |
| C2 | |
| C3 | |
| C4 | |
| C5 | |
| SC | |

COLUMN DETAIL

STRUCTURAL DETAILS - 1


SCALE 1:20



| | MIDSPAN | SUPPORT |
|----|---------|---------|
| B1 | | |
| B2 | | |
| B3 | | |
| B4 | | |
| RB | | |
| HB | | |


| | |
|-----|--|
| LT1 | |
| LT2 | |

LINTELS OVER ALL DOORS, WINDOWS
(THAT DOES NOT RISE TO ROOF BEAM LEVEL)
LT2 FOR WINDOW (W2) ONLY

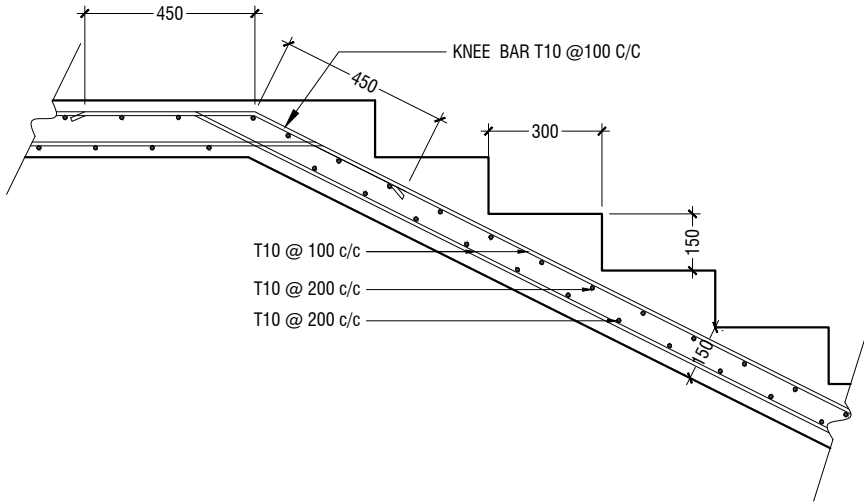

MAIN STAIRCASE REINFORCEMENT DETAIL

STRUCTURAL DETAILS - 2



BEAM DETAIL

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education


Project Number: RI/2020/006
Date: January 2021
Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |


Title: Structural Details - 2
Page: S-11/12

NOTE:
PROVIDE 25MM SPACER BAR @ 2000 C/C BETWEEN TWO LAYERS
OF BEAM REINFORCEMENT

RIYAN PRIVATE LIMITED
t: +9603315049 f: +9603310776
e: info@riyan.com.mv
w: www.riyan.com.mv
3rd floor, H. Azum, 'Ameeneemagu, Male'

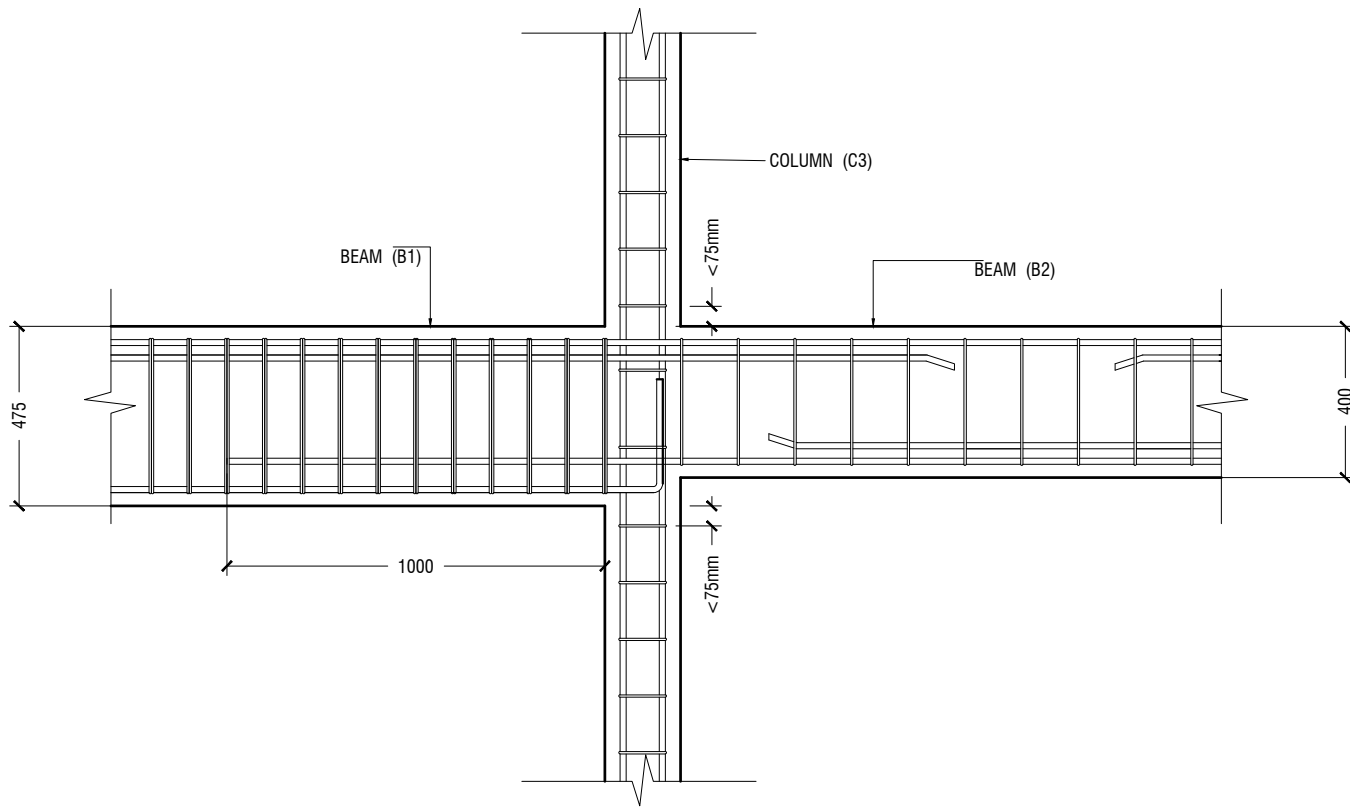

B1 TO B2 CONNECTION DETAIL

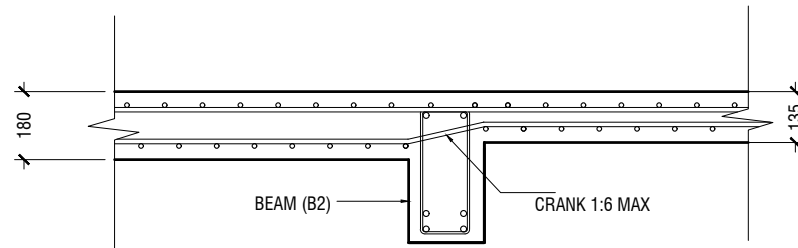

SLAB THICKNESS REDUCTION DETAIL

STRUCTURAL DETAILS - 3

SCALE 1:20



RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagu, Male'

Sn.Hithadhoo Sharafuddin School - 18 Classroom (03 Storey)
Client: Ministry of Education

Project Number: RI/2020/006
Date: January 2021

Architect : Mariyam Irasha Shareef
Engineer : Mohamed Muththalib Waleed
Drawn by : Mariyam Leevan Jaleel
Services : Aishath Ahmed
Interior : -

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |
| -- | ----- |

Title: Structural Details - 3

Page: S-12/12

Proposed 18 Classroom at
Sn.Hithadhoo Sharafuddin School
(03 Storey)

SERVICES DRAWINGS
Client: Ministry of Education




RIYAN PRIVATE LIMITED

t : +9603315049 f : +9603310776
e : info@riyan.com.mv
w : www.riyan.com.mv
3rd floor, H. Azum, Ameenemagu, Male'

TABLE OF CONTENTS

| DRAWING No. | TITLE | REVISION No. | DATE | REMARKS |
|------------------|--------------------------------------|--------------|------|---------|
| S E R V I C E S | | --- | --- | --- |
| DR - 01 /03 | GROUND FLOOR DRAINAGE LAYOUT | --- | --- | --- |
| DR - 02 /03 | FIRST - SECOND FLOOR DRAINAGE LAYOUT | --- | --- | --- |
| DR - 03 /03 | ROOF DRAINAGE LAYOUT | --- | --- | --- |
| PL - 01 / 02 | GROUND FLOOR PLUMBING LAYOUT | --- | --- | --- |
| PL - 02 / 02 | FIRST - SECOND FLOOR PLUMBING LAYOUT | --- | --- | --- |
| EL - 01 / 02 | GROUND FLOOR LIGHTING LAYOUT | --- | --- | --- |
| EL - 02 / 02 | FIRST - SECOND FLOOR LIGHTING LAYOUT | --- | --- | --- |
| EP - 01 / 02 | GROUND FLOOR POWER LAYOUT | --- | --- | --- |
| EP - 02 / 02 | FIRST - SECOND FLOOR POWER LAYOUT | --- | --- | --- |
| FDP - 01 / 02 | GROUND FLOOR FDP LAYOUT | --- | --- | --- |
| FDP - 02 / 02 | FIRST - SECOND FLOOR FDP LAYOUT | --- | --- | --- |
| DETAIL - 01 / 02 | SEPTIC TANK DETAIL | --- | --- | --- |
| DETAIL - 02 / 02 | GROUND WATER WELL DETAIL | --- | --- | --- |
| | | | | |

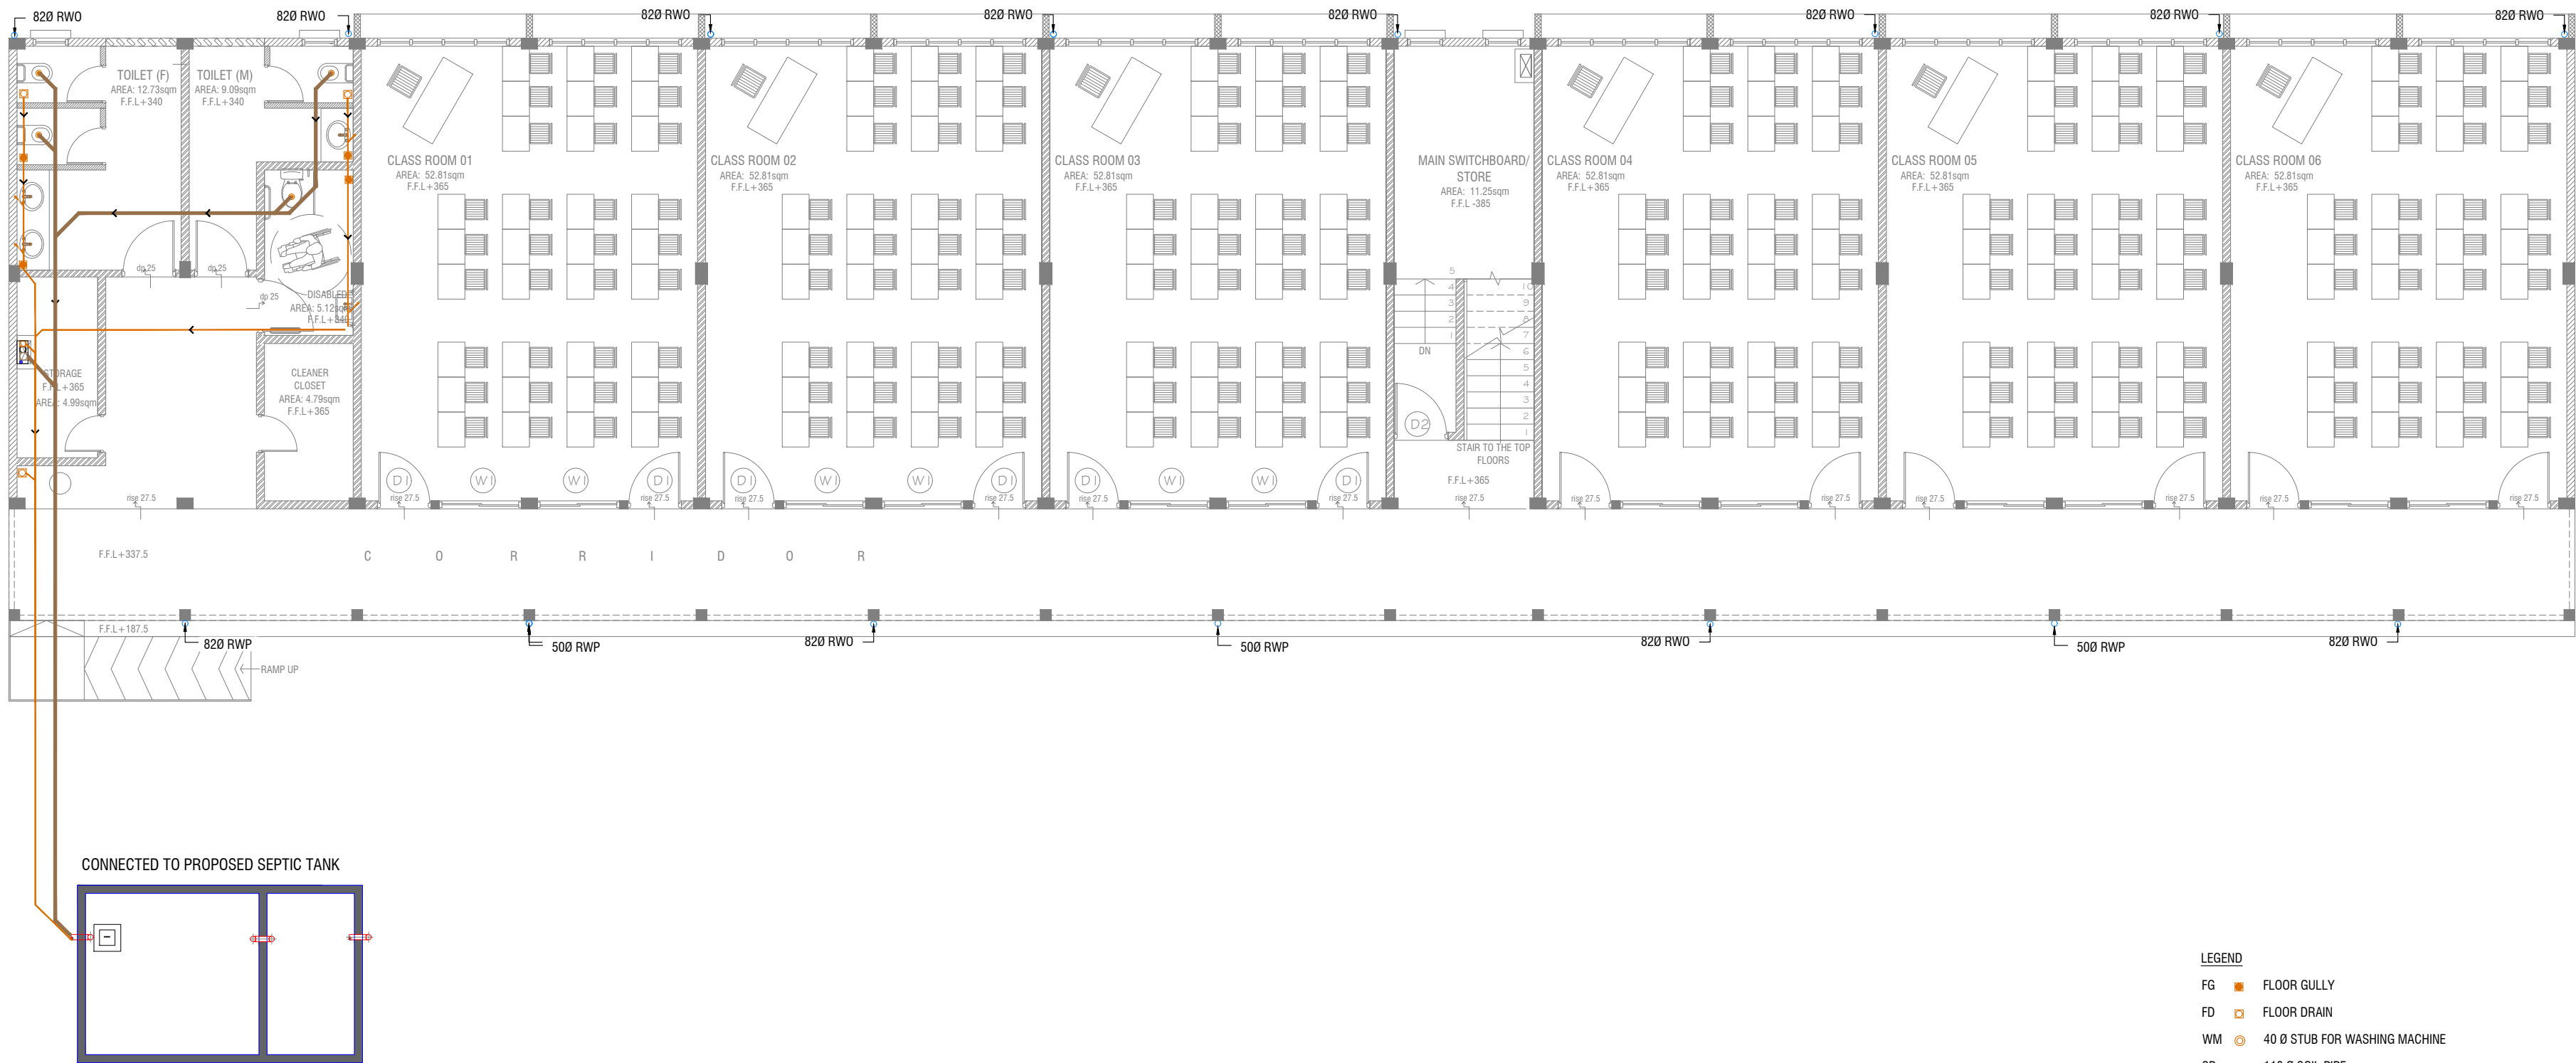

GROUND FLOOR DRAINAGE LAYOUT

SCALE 1:100

- LEGEND**
- FG ■ FLOOR GULLY
 - FD □ FLOOR DRAIN
 - WM ○ 40 Ø STUB FOR WASHING MACHINE
 - SP — 110 Ø SOIL PIPE
 - SVP ○ 110 Ø SOIL VENT PIPE
 - WP — 82 Ø WASTE PIPE
 - WVP ○ 82 Ø WASTE VENT PIPE
 - WP — 40 Ø WASTE PIPE
 - RWP — 82/50 Ø RAINWATER PIPE
 - RWO ○ 82/50 Ø DRAIN OUTLET
 - CD — 25 Ø DRAIN PIPE
 - MHVP — 50 Ø MANHOLE VENT PIPE

NOTE:
- ALL RAINWATER PIPES TO BE AT GROUND LEVEL
DISCHARGED THROUGH A PERFORATED COWL OR TO A SOAK PIT
- ALL SOIL AND WASTE PIPES TO BE AT GROUND
LEVEL, UNDER THE SLAB.

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

Project Number: RI/2020/006
Architect: Mariyam Idris Sharief
Engineer: Mohamed Muthalib Waleed
Drawn by: Mariyam Lalevan Jaleel
Services: Adhith Ahmed
Interior: -

| Rev no | Date |
|--------|------|
| - | - |
| - | - |
| - | - |



RIYAT PRIVATE LIMITED


T: +9603355049 F: +9603330776
E: info@riyat.com.mv
W: www.riyat.com.mv
3rd Floor, H. Azum, Anememmagu, Malé

Title: Ground Floor

Drainage Layout

Page: DR 01-03

The contents of these drawings remain as a property of Riyat Private Limited. Any use other than those expressly stated is a violation of this copyright.

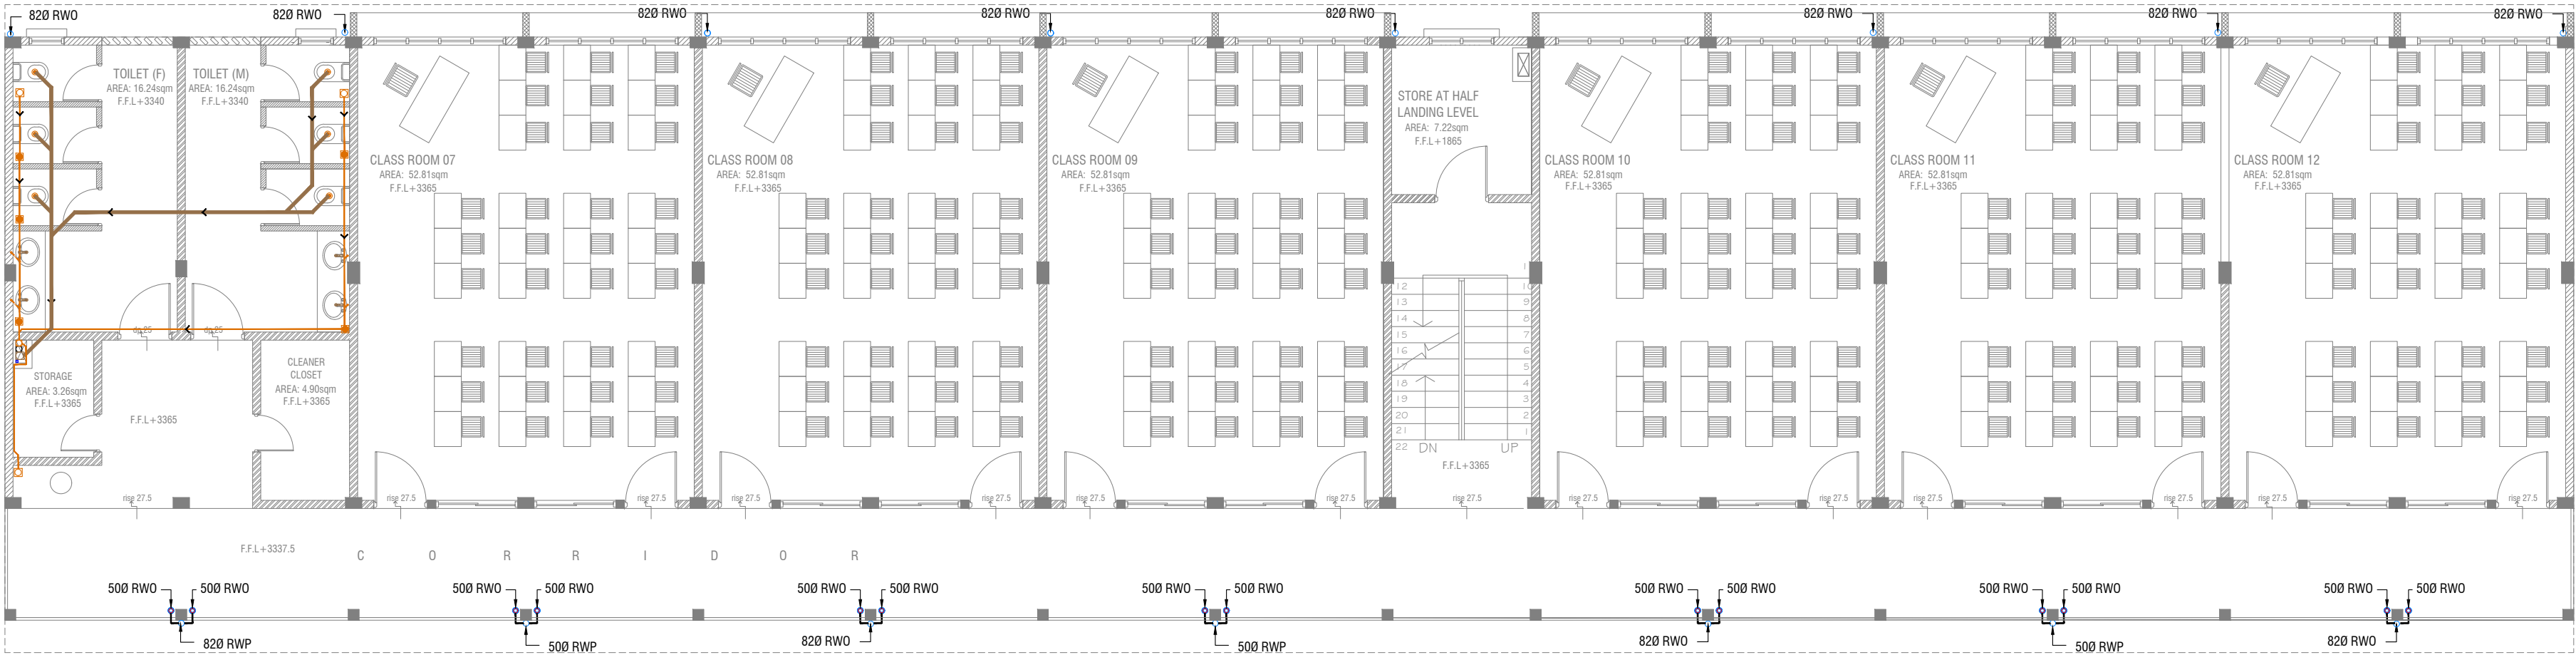

FIRST - SECOND FLOOR DRAINAGE LAYOUT

SCALE 1:100



- LEGEND
- FG FLOOR GULLY
 - FD FLOOR DRAIN
 - WM 40 Ø STUB FOR WASHING MACHINE
 - SP 110 Ø SOIL PIPE
 - SVP 110 Ø SOIL VENT PIPE
 - WP 82 Ø WASTE PIPE
 - WVP 82 Ø WASTE VENT PIPE
 - WP 40 Ø WASTE PIPE
 - RWP 82/50 Ø RAINWATER PIPE
 - RWO 82/50 Ø DRAIN OUTLET
 - CD 25 Ø DRAIN PIPE
 - MHVP 50 Ø MANHOLE VENT PIPE

NOTE:
- ALL SOIL AND WASTE PIPES TO BE UNDER THE SLAB LEVEL.

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

| Rev no | Date |
|--------|------------|
| 1 | 10/01/2021 |
| 2 | 10/01/2021 |
| 3 | 10/01/2021 |
| 4 | 10/01/2021 |
| 5 | 10/01/2021 |

Project Number: RJ/2020/006
Date: January 2021
Architect: Hithadhoo Sharafuddin
Engineer: Mohamed Maththas Waleed
Drawn by: Maryam Leevan Jaleel
Services: Ashath Ahmed
Interior: -




RYAN PRIVATE LIMITED

T: +9603375040 F: +9603370776
E: info@ryan.com.mv
W: www.ryan.com.mv
3rd floor, H. Adam, Amereemadga, Male

Title: First - Second Floor
Drainage Layout
Page: DR 02-03

The contents of these drawings remain as a property of Ryan Private Limited. Any use other than those expressly stated is a violation of this copyright.

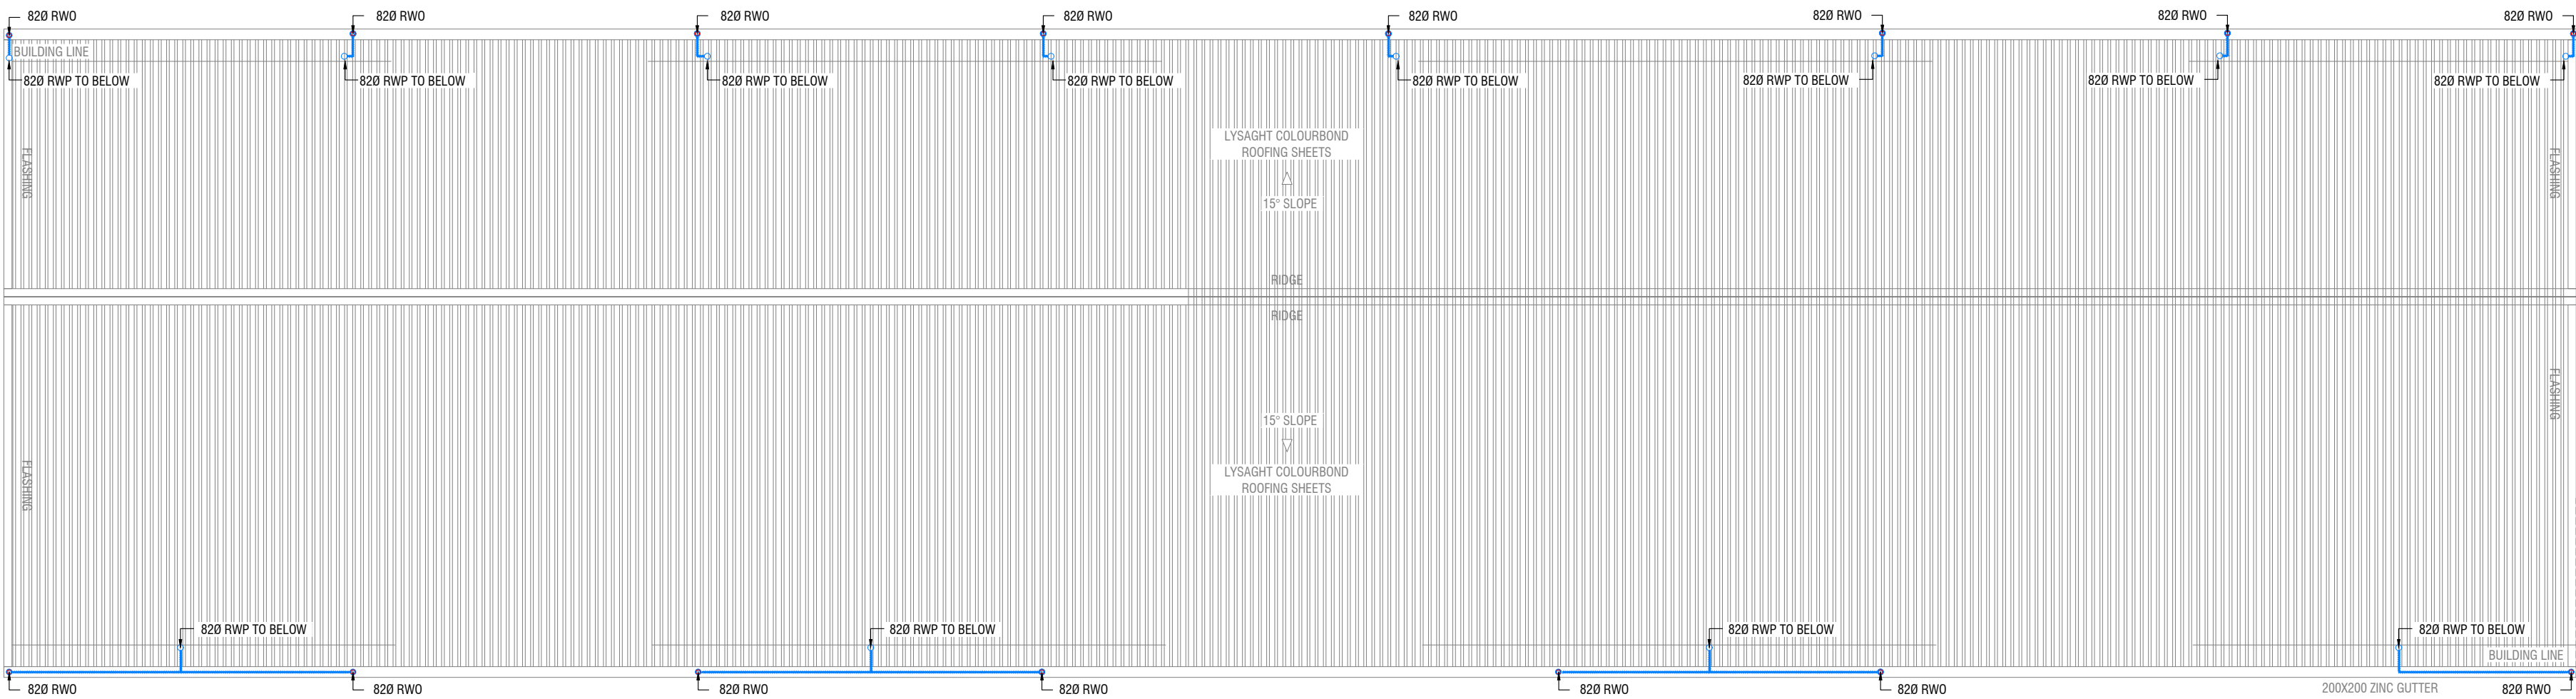

ROOF DRAINAGE LAYOUT

SCALE 1:100

0 0.5 1 2 3 4 5

| LEGEND | |
|--------|-------------------------------|
| FG | FLOOR GULLY |
| FD | FLOOR DRAIN |
| WM | 40 Ø STUB FOR WASHING MACHINE |
| SP | 110 Ø SOIL PIPE |
| SVP | 110 Ø SOIL VENT PIPE |
| WP | 82 Ø WASTE PIPE |
| WVP | 82 Ø WASTE VENT PIPE |
| WP | 40 Ø WASTE PIPE |
| RWP | 82/50 Ø RAINWATER PIPE |
| RWO | 82/50 Ø DRAIN OUTLET |
| CD | 25 Ø DRAIN PIPE |
| MHP | 50 Ø MANHOLE VENT PIPE |

Sri.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)
Client: Ministry of Education

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |


Project Number: R/2020/006
Drawing No: R/2020/006
Engineer: Mohamed Ibrahim Sharaf
Drawn by: Mariyam Leelan Jaleel
Checked by: Ashraf Ahmed



RYAN PRIVATE LIMITED
T: +9603375048 F: +9603370776
E: info@ryan.com.mv
W: www.ryan.com.mv
3rd floor, H. Azum, Ammeenmagu, Male'


Title: Roof
Drainage Layout
Page: DR 03-03

The contents of these drawings remain as a property of Ryan Private Limited. Any use other than those expressly stated is a violation of this copyright.

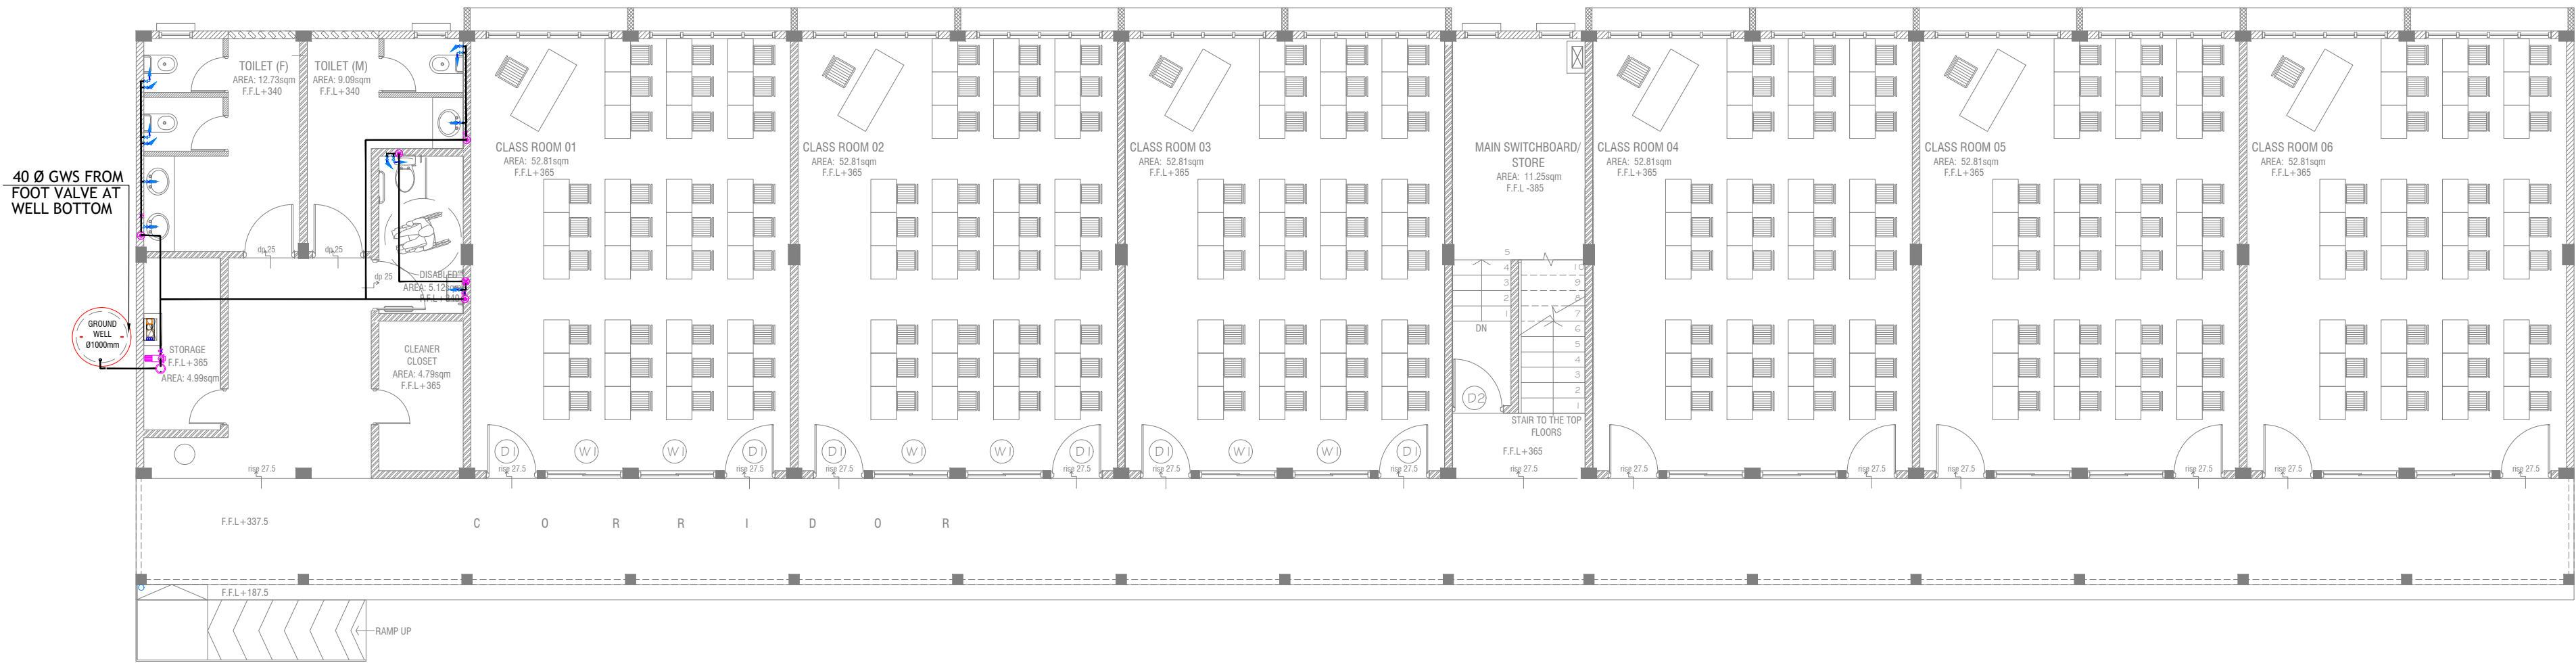

GROUND FLOOR PLUMBING LAYOUT

SCALE 1:100

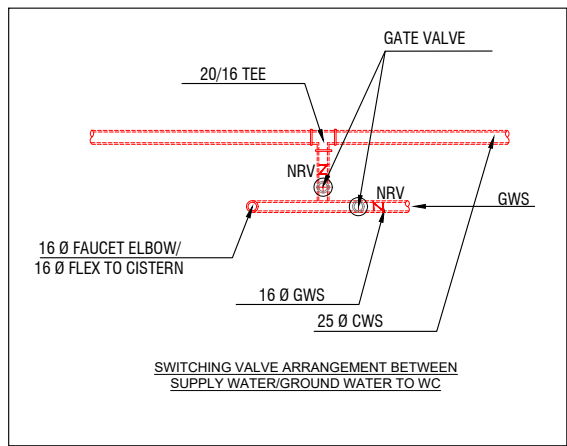

LEGEND

- 16 Ø COLD WATER SUPPLY TO CISTERN
- 16 Ø COLD WATER SUPPLY TO BIDET SHOWER
- 16 Ø COLD WATER SUPPLY TO BASIN FAUCET / SINK
- GV GATE VALVE
- 25 Ø COLD WATER SUPPLY PIPES RUN UNDERGROUND
- 25 Ø COLD WATER SUPPLY PIPES RUN IN WALL / UNDER FALSE CEILING
- RISE IN WALL
- DROP IN WALL
- CWS COLD WATER SUPPLY
- HWS HOT WATER SUPPLY
- GROUND WATER SUPPLY

NOTE:
- THE WELL SHALL BE RELOCATED ACCORDING TO THE SALINITY OF THE GROUND WATER.
- BASED ON WELL LOCATION PUMP CAPACITY TO BE DECIDED

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

| Rev no | Date |
|--------|------------|
| 1 | 2023/01/06 |
| 2 | 2023/01/06 |
| 3 | 2023/01/06 |
| 4 | 2023/01/06 |
| 5 | 2023/01/06 |
| 6 | 2023/01/06 |
| 7 | 2023/01/06 |
| 8 | 2023/01/06 |
| 9 | 2023/01/06 |
| 10 | 2023/01/06 |
| 11 | 2023/01/06 |
| 12 | 2023/01/06 |
| 13 | 2023/01/06 |
| 14 | 2023/01/06 |
| 15 | 2023/01/06 |
| 16 | 2023/01/06 |
| 17 | 2023/01/06 |
| 18 | 2023/01/06 |
| 19 | 2023/01/06 |
| 20 | 2023/01/06 |
| 21 | 2023/01/06 |
| 22 | 2023/01/06 |
| 23 | 2023/01/06 |
| 24 | 2023/01/06 |
| 25 | 2023/01/06 |
| 26 | 2023/01/06 |
| 27 | 2023/01/06 |
| 28 | 2023/01/06 |
| 29 | 2023/01/06 |
| 30 | 2023/01/06 |
| 31 | 2023/01/06 |
| 32 | 2023/01/06 |
| 33 | 2023/01/06 |
| 34 | 2023/01/06 |
| 35 | 2023/01/06 |
| 36 | 2023/01/06 |
| 37 | 2023/01/06 |
| 38 | 2023/01/06 |
| 39 | 2023/01/06 |
| 40 | 2023/01/06 |
| 41 | 2023/01/06 |
| 42 | 2023/01/06 |
| 43 | 2023/01/06 |
| 44 | 2023/01/06 |
| 45 | 2023/01/06 |
| 46 | 2023/01/06 |
| 47 | 2023/01/06 |
| 48 | 2023/01/06 |
| 49 | 2023/01/06 |
| 50 | 2023/01/06 |
| 51 | 2023/01/06 |
| 52 | 2023/01/06 |
| 53 | 2023/01/06 |
| 54 | 2023/01/06 |
| 55 | 2023/01/06 |
| 56 | 2023/01/06 |
| 57 | 2023/01/06 |
| 58 | 2023/01/06 |
| 59 | 2023/01/06 |
| 60 | 2023/01/06 |
| 61 | 2023/01/06 |
| 62 | 2023/01/06 |
| 63 | 2023/01/06 |
| 64 | 2023/01/06 |
| 65 | 2023/01/06 |
| 66 | 2023/01/06 |
| 67 | 2023/01/06 |
| 68 | 2023/01/06 |
| 69 | 2023/01/06 |
| 70 | 2023/01/06 |
| 71 | 2023/01/06 |
| 72 | 2023/01/06 |
| 73 | 2023/01/06 |
| 74 | 2023/01/06 |
| 75 | 2023/01/06 |
| 76 | 2023/01/06 |
| 77 | 2023/01/06 |
| 78 | 2023/01/06 |
| 79 | 2023/01/06 |
| 80 | 2023/01/06 |
| 81 | 2023/01/06 |
| 82 | 2023/01/06 |
| 83 | 2023/01/06 |
| 84 | 2023/01/06 |
| 85 | 2023/01/06 |
| 86 | 2023/01/06 |
| 87 | 2023/01/06 |
| 88 | 2023/01/06 |
| 89 | 2023/01/06 |
| 90 | 2023/01/06 |
| 91 | 2023/01/06 |
| 92 | 2023/01/06 |
| 93 | 2023/01/06 |
| 94 | 2023/01/06 |
| 95 | 2023/01/06 |
| 96 | 2023/01/06 |
| 97 | 2023/01/06 |
| 98 | 2023/01/06 |
| 99 | 2023/01/06 |
| 100 | 2023/01/06 |

Project Number: RI/2023/006
Date: January 2023
Architect: Mariyam Iratha Shareef
Engineer: Mohamed Muthalib Waleed
Services: Aishah Ahmed
Interior: -



RYAN PRIVATE LIMITED


t: +960335049 f: +9603330776
e: info@ryan.com.mv
w: www.ryan.com.mv
3rd floor, H. Azam, Ammeenmogu, Malé

Title: Ground Floor

Plumbing Layout

Page: PL 01-02

The contents of these drawings remain as a property of RYAN Private Limited. Any use other than those expressly stated is a violation of this copyright

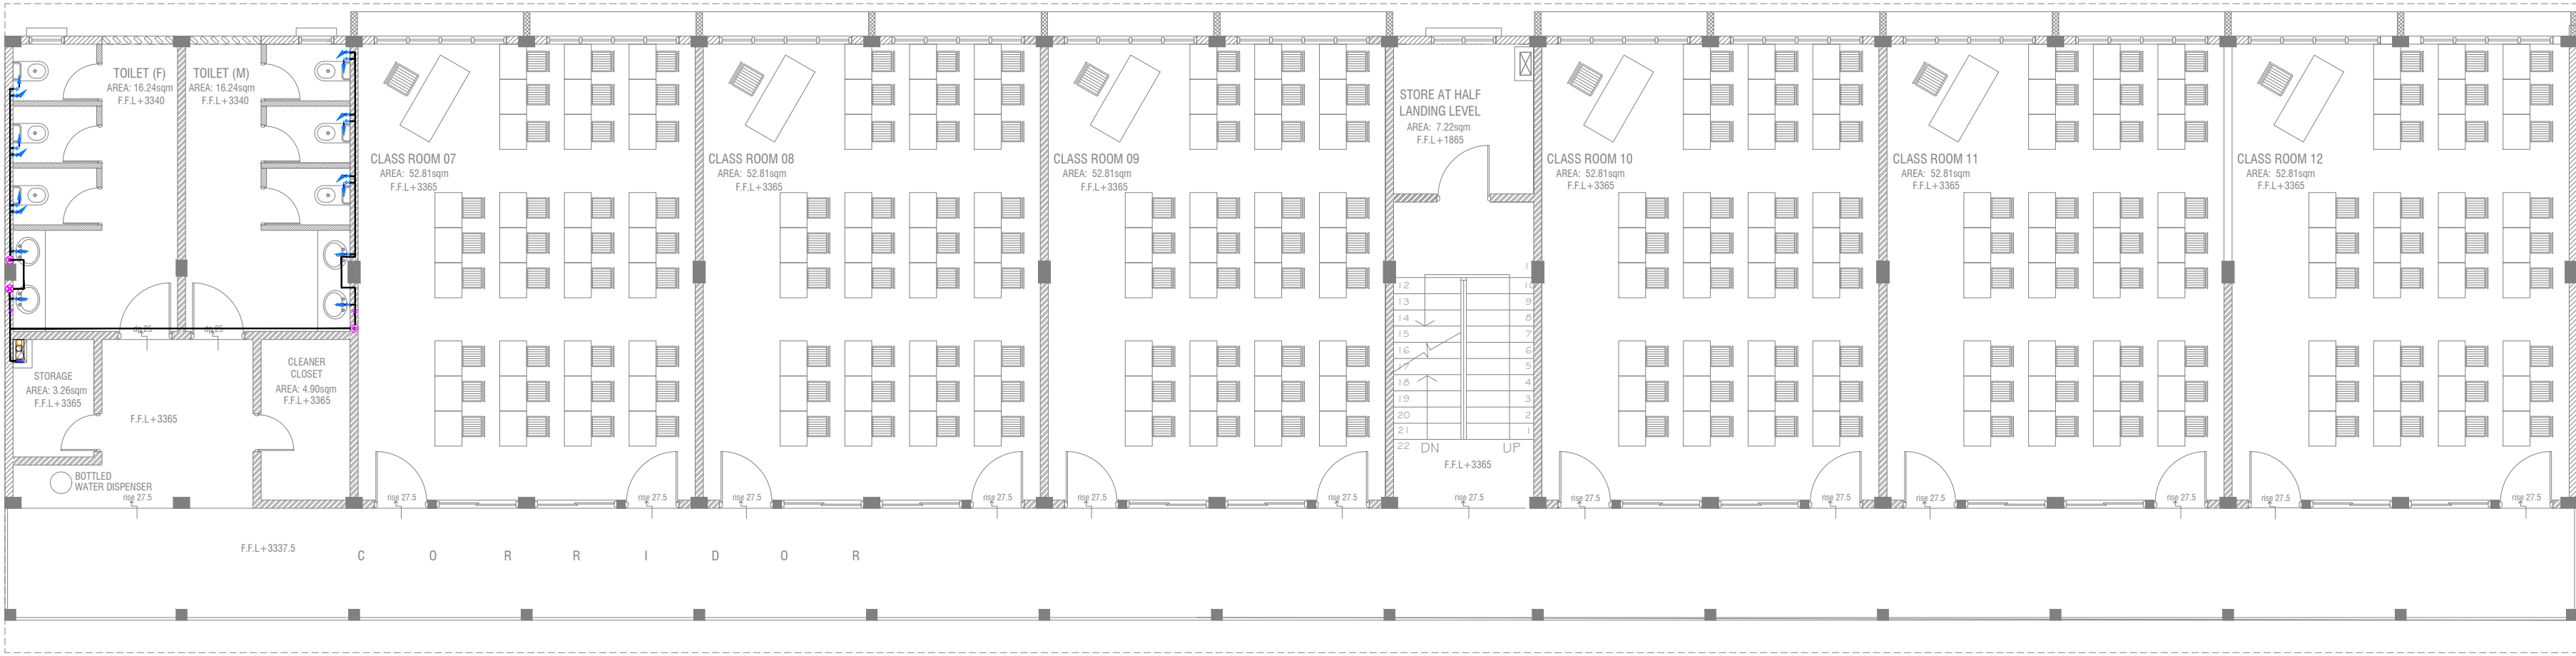

FIRST - SECOND FLOOR PLUMBING LAYOUT




- LEGEND**
- 16 Ø COLD WATER SUPPLY TO CISTERN
 - 16 Ø COLD WATER SUPPLY TO BIDET / SHOWER
 - 16 Ø COLD WATER SUPPLY TO BASIN FAUCET / SINK
 - GV GATE VALVE
 - 25 Ø COLD WATER SUPPLY PIPES RUN UNDERGROUND
 - 25 Ø COLD WATER SUPPLY PIPES RUN IN WALL / UNDER FALSE CEILING
 - RISE IN WALL
 - DROP IN WALL
 - CWS COLD WATER SUPPLY
 - HWS HOT WATER SUPPLY
 - GROUND WATER SUPPLY

Sn.Hithadhoo Sharafuddin School '18 Classroom Block (3 story)

Client: Ministry of Education

| Rev no | Date |
|--------|------------|
| 1 | 2020/01/27 |
| 2 | 2020/01/27 |
| 3 | 2020/01/27 |
| 4 | 2020/01/27 |
| 5 | 2020/01/27 |
| 6 | 2020/01/27 |
| 7 | 2020/01/27 |
| 8 | 2020/01/27 |
| 9 | 2020/01/27 |
| 10 | 2020/01/27 |
| 11 | 2020/01/27 |
| 12 | 2020/01/27 |
| 13 | 2020/01/27 |
| 14 | 2020/01/27 |
| 15 | 2020/01/27 |
| 16 | 2020/01/27 |
| 17 | 2020/01/27 |
| 18 | 2020/01/27 |
| 19 | 2020/01/27 |
| 20 | 2020/01/27 |
| 21 | 2020/01/27 |
| 22 | 2020/01/27 |
| 23 | 2020/01/27 |
| 24 | 2020/01/27 |
| 25 | 2020/01/27 |
| 26 | 2020/01/27 |
| 27 | 2020/01/27 |
| 28 | 2020/01/27 |
| 29 | 2020/01/27 |
| 30 | 2020/01/27 |
| 31 | 2020/01/27 |
| 32 | 2020/01/27 |
| 33 | 2020/01/27 |
| 34 | 2020/01/27 |
| 35 | 2020/01/27 |
| 36 | 2020/01/27 |
| 37 | 2020/01/27 |
| 38 | 2020/01/27 |
| 39 | 2020/01/27 |
| 40 | 2020/01/27 |
| 41 | 2020/01/27 |
| 42 | 2020/01/27 |
| 43 | 2020/01/27 |
| 44 | 2020/01/27 |
| 45 | 2020/01/27 |
| 46 | 2020/01/27 |
| 47 | 2020/01/27 |
| 48 | 2020/01/27 |
| 49 | 2020/01/27 |
| 50 | 2020/01/27 |
| 51 | 2020/01/27 |
| 52 | 2020/01/27 |
| 53 | 2020/01/27 |
| 54 | 2020/01/27 |
| 55 | 2020/01/27 |
| 56 | 2020/01/27 |
| 57 | 2020/01/27 |
| 58 | 2020/01/27 |
| 59 | 2020/01/27 |
| 60 | 2020/01/27 |
| 61 | 2020/01/27 |
| 62 | 2020/01/27 |
| 63 | 2020/01/27 |
| 64 | 2020/01/27 |
| 65 | 2020/01/27 |
| 66 | 2020/01/27 |
| 67 | 2020/01/27 |
| 68 | 2020/01/27 |
| 69 | 2020/01/27 |
| 70 | 2020/01/27 |
| 71 | 2020/01/27 |
| 72 | 2020/01/27 |
| 73 | 2020/01/27 |
| 74 | 2020/01/27 |
| 75 | 2020/01/27 |
| 76 | 2020/01/27 |
| 77 | 2020/01/27 |
| 78 | 2020/01/27 |
| 79 | 2020/01/27 |
| 80 | 2020/01/27 |
| 81 | 2020/01/27 |
| 82 | 2020/01/27 |
| 83 | 2020/01/27 |
| 84 | 2020/01/27 |
| 85 | 2020/01/27 |
| 86 | 2020/01/27 |
| 87 | 2020/01/27 |
| 88 | 2020/01/27 |
| 89 | 2020/01/27 |
| 90 | 2020/01/27 |
| 91 | 2020/01/27 |
| 92 | 2020/01/27 |
| 93 | 2020/01/27 |
| 94 | 2020/01/27 |
| 95 | 2020/01/27 |
| 96 | 2020/01/27 |
| 97 | 2020/01/27 |
| 98 | 2020/01/27 |
| 99 | 2020/01/27 |
| 100 | 2020/01/27 |

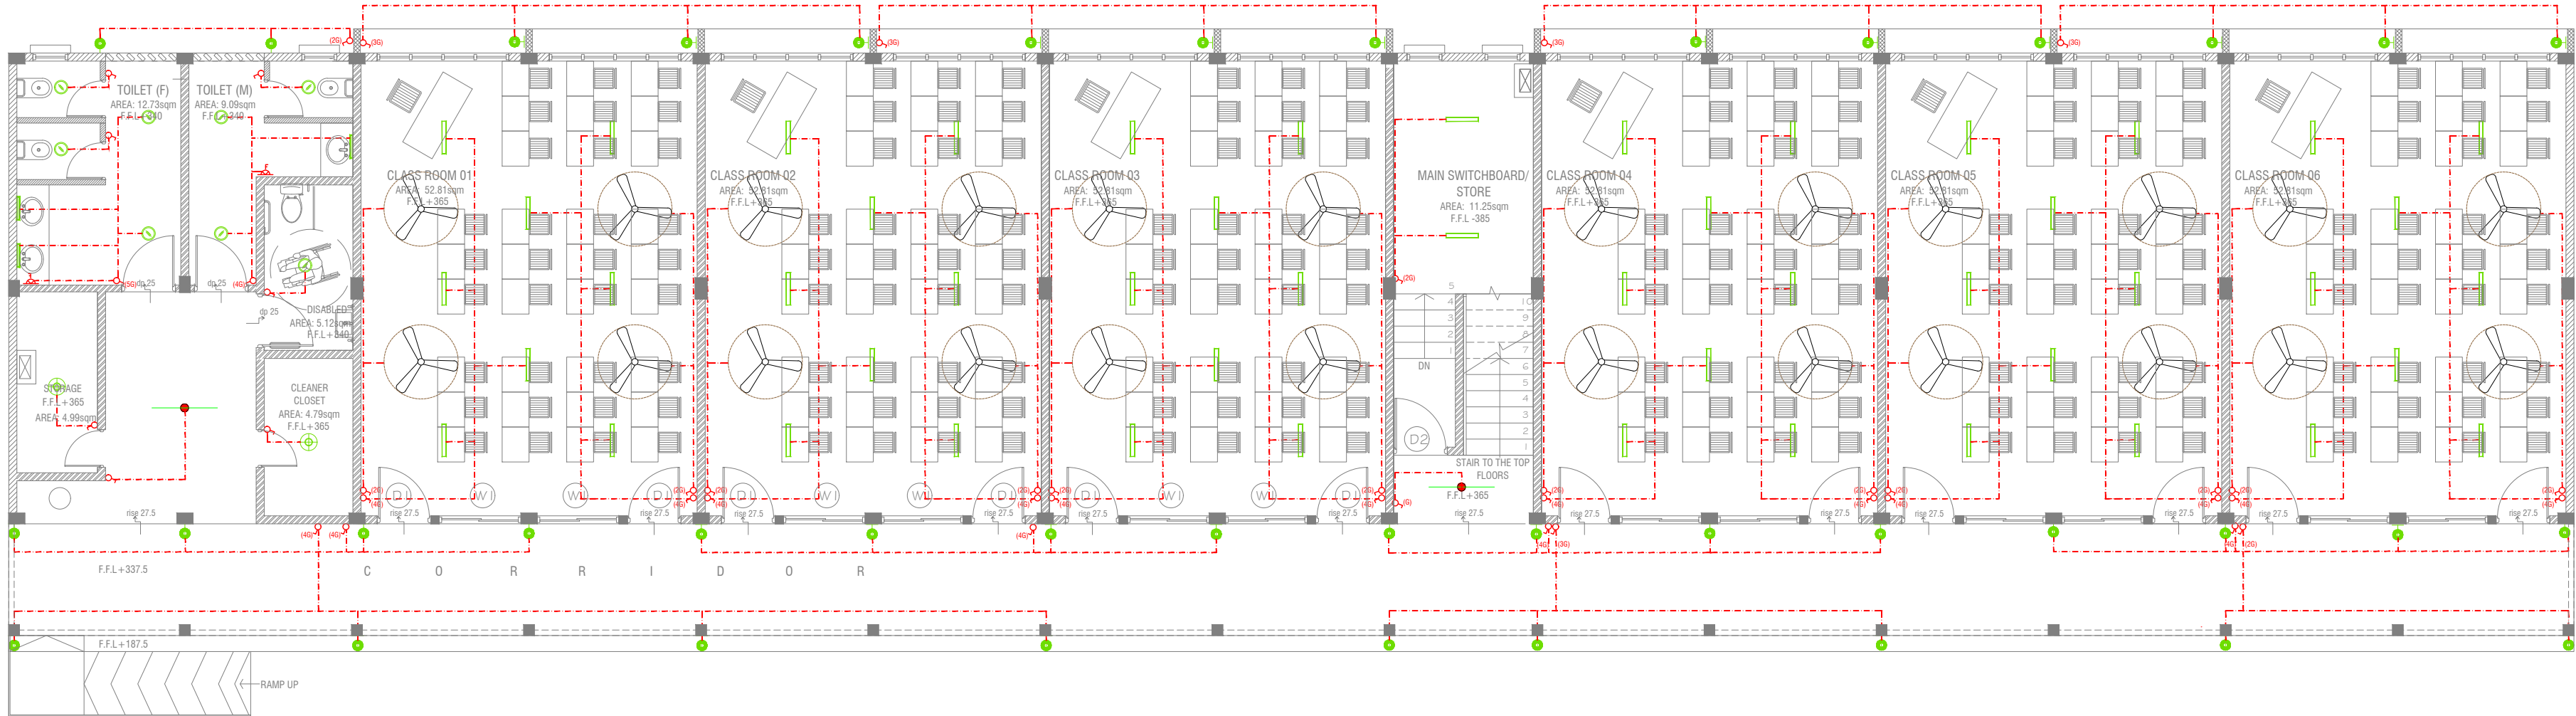

GROUND FLOOR LIGHTING LAYOUT


SCALE 1:100



LEGEND

- WPD 40W (IP 65) OUT DOOR WALL LIGHT
- ML MIRROR LIGHT (7W LED LIGHT)
- H2 LED RECESSED DOWN LIGHT 12W
- CL LED CEILING LIGHT 18W
- WP LED TUBE LIGHT WITH WEATHER PROOF OPAL CASING
- C2 LED CEILING DOWN LIGHT (18W)
- LIGHT SWITCH
- SWITCHING LINE
- EXHAUST

CL2 LED TUBE LIGHT WITH OPAL CASING



CEILING FAN (52" - 54")

NOTE:

- ALL WIRING TO BE OF STELCO APPROVED STANDARDS
- SWITCH CONTROL = 1200MM FROM FLOOR FIN. LEVEL
- ALL LIGHTING POINTS CONNECTED TO THEIR RESPECTIVE DB
- POLYCARBONATE ENCLOSURE TO ALL SWITCH AND SOCKET WHICH ARE LOCATED AT THE OUTDOORS

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

Project Number: RI/2020/006

Architect: Maryam Insha Shareef

Engineer: Mohamed Muthalib Waleed

Services: Ashraf Ahmed

Interior: -

Rev no

Date

RIYAN PRIVATE LIMITED

t: +963335049 f: +963330776

e: info@riyan.com.mv

w: www.riyan.com.mv


3rd floor, H. Adam, Ammanmorgu, Malé

Title: Ground Floor

Lighting Layout

Page: EL 01-02

The contents of these drawings remain as a property of Riyan Private Limited. Any use other than those expressly stated is a violation of this copyright.

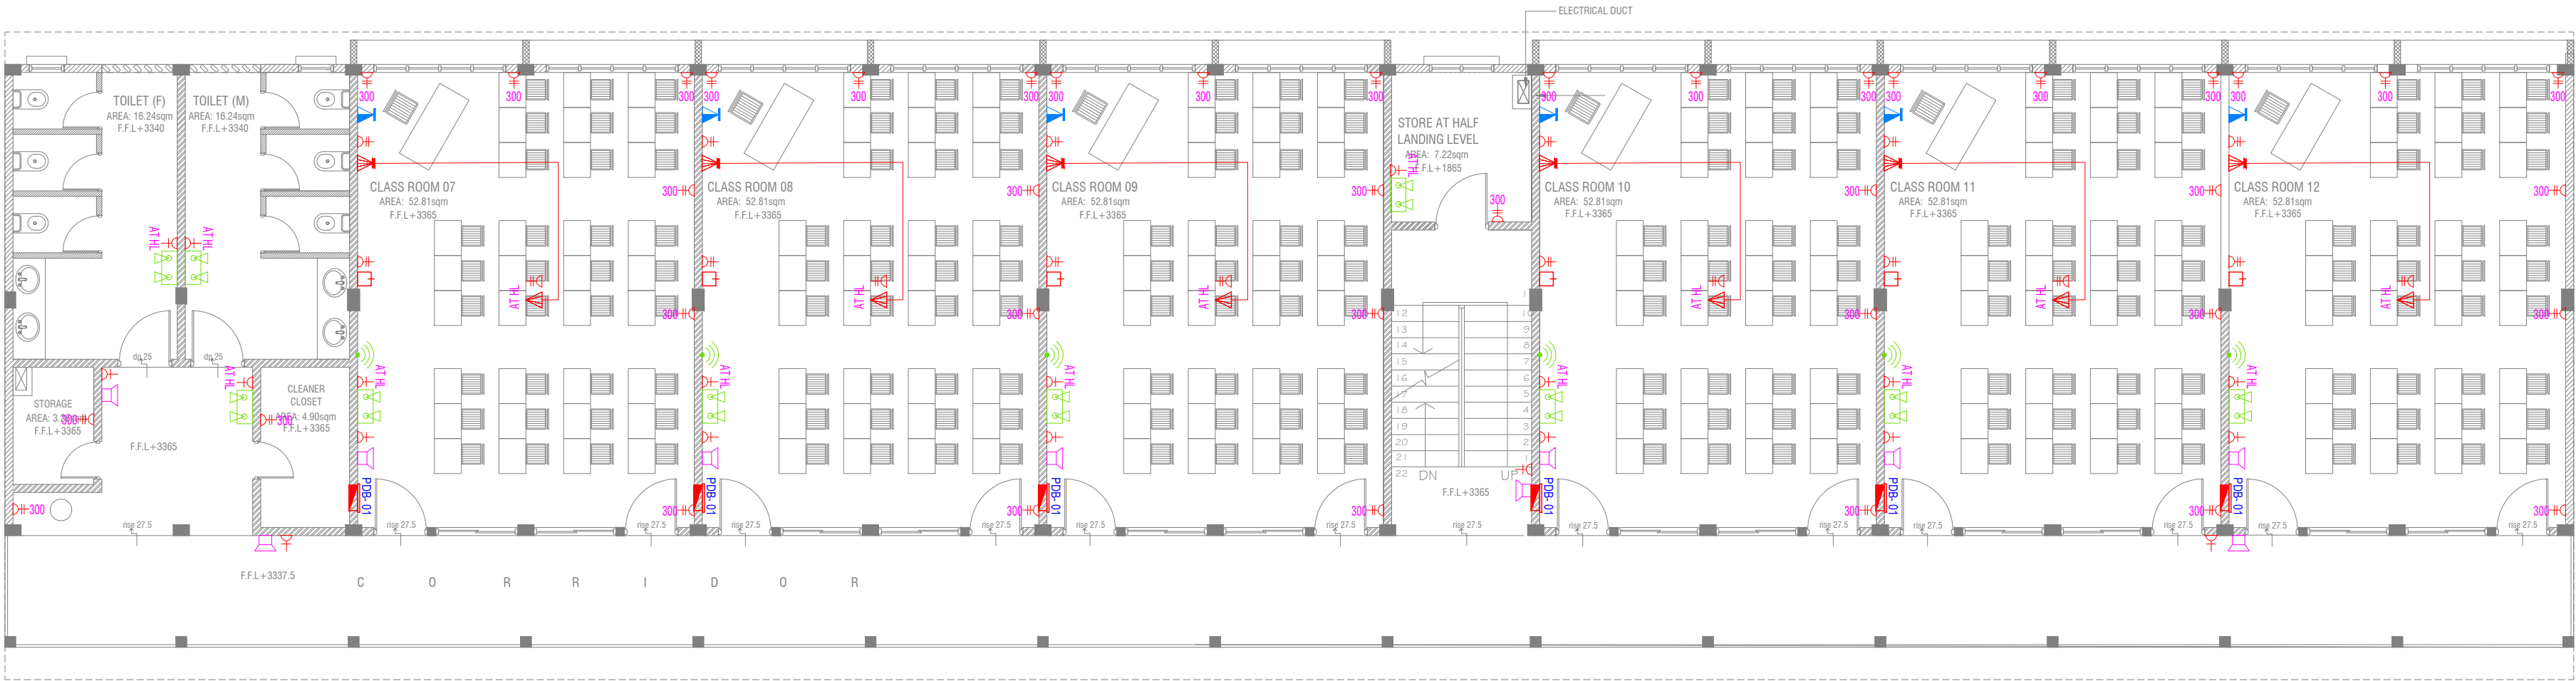

FIRST - SECOND FLOOR POWER LAYOUT

SCALE 1:100



- NOTE:
- ALL WIRING TO BE OF APPROVED STANDARDS
 - POWER/IT/COMPUTER SOCKETS = 300MM - 450MM FROM FLOOR FIN. LEVEL
 - SWITCH CONTROL / SOCKET = 1100MM - 1200MM FROM FLOOR FIN. LEVEL
 - KITCHEN SOCKETS / PANTRY SOCKETS = 1150MM - 1250MM FROM FLOOR FIN. LEVEL
 - AC = 2500MM - 2700MM FROM FLOOR FIN. LEVEL

- LEGEND
- TELEPHONE OUTLET (RJ11, CONNECTOR)
 - 13A POWER OUTLET
 - 13A TWIN SOCKET OUTLET
 - HDMI, VGA & RAC AV SOCKET
 - DISTRIBUTION BOX
 - SPEAKERS
 - HDMI, VGA & RAC AV TWIN SOCKET
 - TWIN COMPUTER NETWORK OUTLET
 - DATA POINT

- PAGING MIC
- VOLUME CONTROLLER
- EMERGENCY LIGHT

ALL ELECTRICAL COMPONENT TO BE CONNECTED TO THEIR RESPECTIVE DB

SPEAKERS TO BE CONNECTED TO THE MAIN PA SYSTEM OF THE SCHOOL

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

| Rev no | Date |
|--------|-------|
| -- | ----- |
| -- | ----- |
| -- | ----- |


Project Number: R/2020/006
Date: January 2021
Checked by: Hithadhoo Sharafuddin
Engineer: Mohamed Muthalib Waleed
Drawn by: Mariyam Leevan Jaleel
Services: Ashraf Ahmed
Interior: --



RIYANI PRIVATE LIMITED
t: +9602275040 f: +9602270776
e: info@riyani.com.mu
w: www.riyani.com.mu
3rd floor, H. Azum, Ammanveemagui, Male'

Title: First - Second Floor Power Layout
Page: EP 02-02

The contents of these drawings remain as a property of Riyani Private Limited. Any use other than those expressly stated is a violation of this copyright

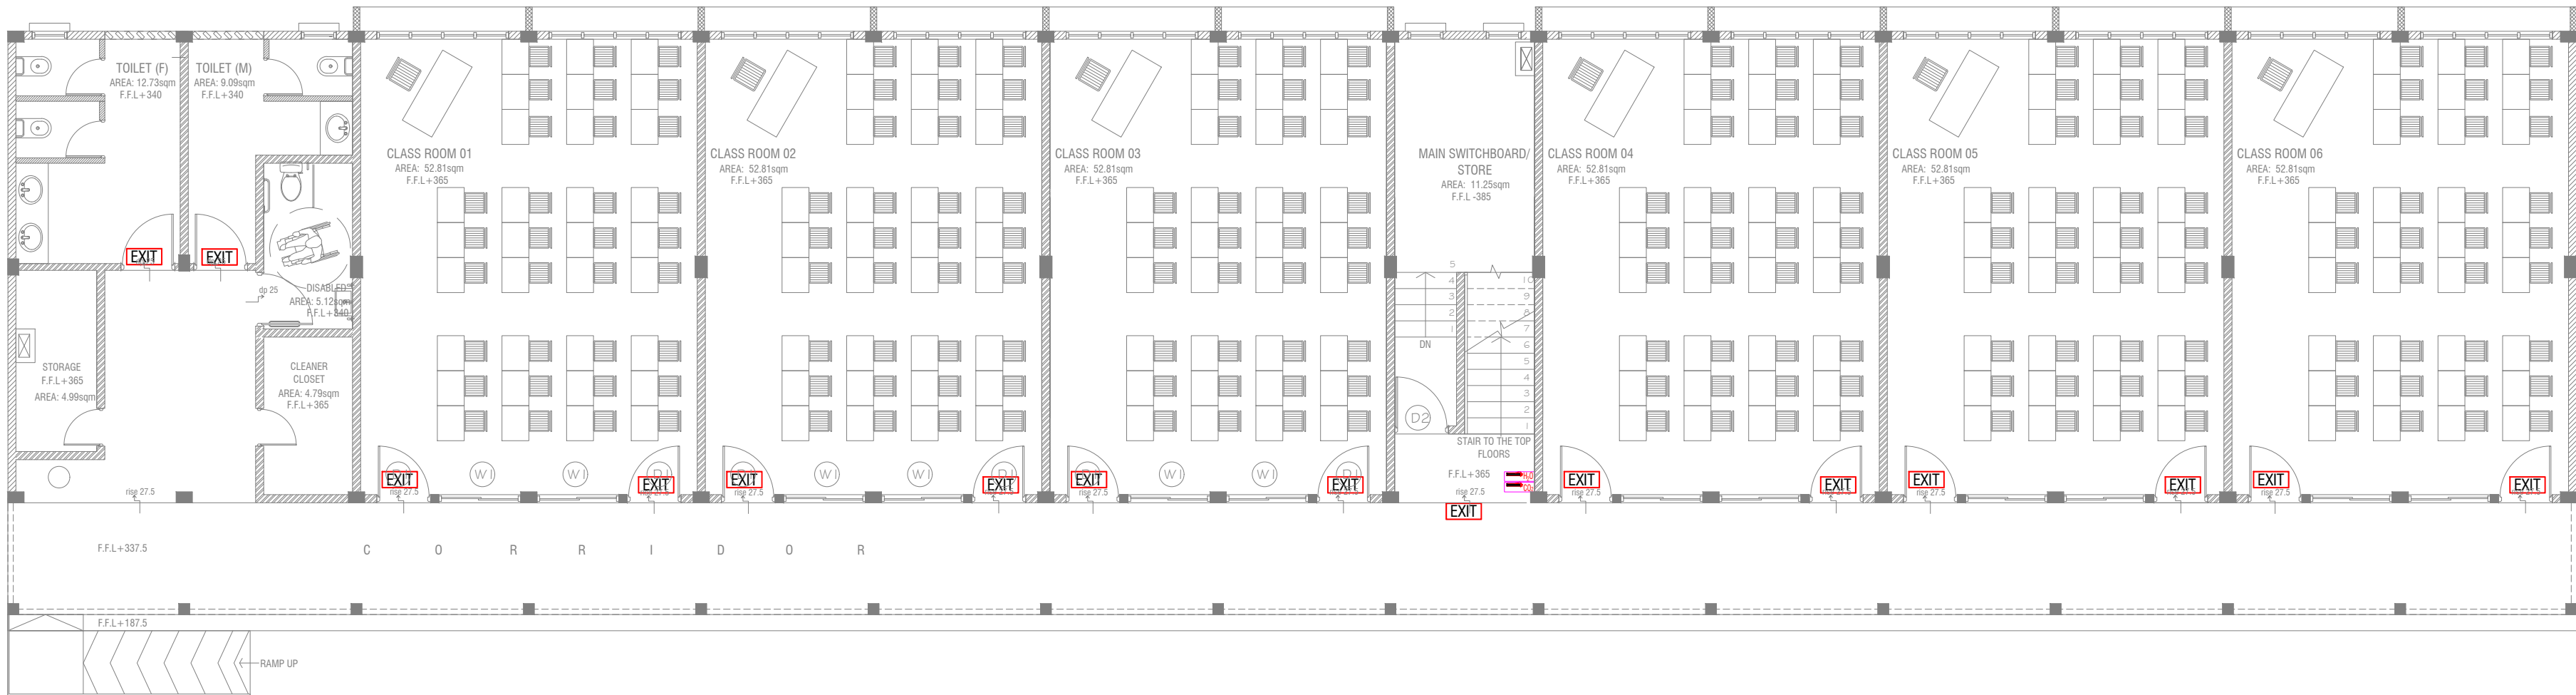

GROUND FLOOR FDP LAYOUT
SCALE 1:100

LEGEND

- EXIT SIGN
- CO₂ EXTINGUISHER (LOAD: 2KG) IN POLYCARBONATE ENCLOSURE(TYP.)
- H₂O EXTINGUISHER (LOAD: 9L) IN POLYCARBONATE ENCLOSURE(TYP.)

ALL FIRE CABLES AND CONDUITS SHOULD BE FIRE RETARDANT LOW SMOKE (FRLS) TYPE.

ALL FIRE RATED DOOR SHOULD COME WITH PACKING (EXPANSION SEAL TRAP)

- 1.ALL PIPES SHOULD BE GALVANIZED,SCHEDULE 40.
2. ALL PIPE SHALL BE PAINTED IN RED AS PER REGULATION.
3. ALL SUPPORT/BACKET SHALL BE HOT DIPPED GALVANIZED TO 100XMM 4.ALL FIRE EXTINGUISHER INSIDE CABINETS. (CABINET SHOULD BE PROVIDED)

-IF THE INSTALLATION OF CEILING IS CARRIED OUT LOWER THAN BEAM BOTTOM ,SMOKE DETECTORS SHOULD BE PLACED AS INDICATED ON THE DRAWING.
-ALTERNATIVELY IF THE INSTALLATION OF CEILING IS CARRIED OUT EQUAL TO BEAM BOTTOM OR IF THE CEILING IS NOT INSTALLED , SMOKE DETECTORS ARE TO BE PLACED IN BETWEEN EACH BEAM

Sr.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

| Project Number | Rev no | Date |
|------------------------------------|--------|------|
| RI/2020/006 | - | - |
| Date: January 2020 | - | - |
| Drawn by: Maryam Leeson Jaleel | - | - |
| Engineer: Mohamed Muthalib Valseed | - | - |
| Services: Ashraf Ahmed | - | - |
| Interior: - | - | - |



RIYAN PRIVATE LIMITED
t: +960335240 f: +960335276
e: info@riyan.com.mv
w: www.riyan.com.mv
3rd floor - H. Aqam, Aradheemagdu, Male

Title: Ground Floor
FDP Layout
Page: FDP 01-02

The contents of these drawings remain as a property of Riyan Private Limited. Any use other than those expressly stated is a violation of this copyright.






FIRST - SECOND FLOOR FDP LAYOUT

SCALE 1:100

0 0.5 1 2 3 4 5

LEGEND

-  EXIT SIGN
-  CO₂ EXTINGUISHER (LOAD: 2KG) IN POLYCARBONATE ENCLOSURE(TYP.)
-  H₂O EXTINGUISHER (LOAD: 9L) IN POLYCARBONATE ENCLOSURE(TYP.)

ALL FIRE CABLES AND CONDUITS SHOULD BE FIRE RETARDANT LOW SMOKE (FRLS) TYPE.

ALL FIRE RATED DOOR SHOULD COME WITH PACKING (EXPANSION SEAL TRAP)

- 1.ALL PIPES SHOULD BE GALVANIZED,SCHEDULE 40.
2. ALL PIPE SHALL BE PAINTED IN RED AS PER REGULATION.
3. ALL SUPPORT/BACKET SHALL BE HOT DIPPED GALVANIZED TO 100MM 4.ALL FIRE EXTINGUISHER INSIDE CABINETS. (CABINET SHOULD BE PROVIDED)

-IF THE INSTALLATION OF CEILING IS CARRIED OUT LOWER THAN BEAM BOTTOM ,SMOKE DETECTORS SHOULD BE PLACED AS INDICATED ON THE DRAWING.
-ALTERNATIVELY IF THE INSTALLATION OF CEILING IS CARRIED OUT EQUAL TO BEAM BOTTOM OR IF THE CEILING IS NOT INSTALLED , SMOKE DETECTORS ARE TO BE PLACED IN BETWEEN EACH BEAM

Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)
Client: Ministry of Education

| Rev no | Date |
|--------|------------|
| 1 | 2020/06/06 |
| 2 | 2020/06/06 |
| 3 | 2020/06/06 |
| 4 | 2020/06/06 |
| 5 | 2020/06/06 |
| 6 | 2020/06/06 |
| 7 | 2020/06/06 |
| 8 | 2020/06/06 |
| 9 | 2020/06/06 |
| 10 | 2020/06/06 |
| 11 | 2020/06/06 |
| 12 | 2020/06/06 |
| 13 | 2020/06/06 |
| 14 | 2020/06/06 |
| 15 | 2020/06/06 |
| 16 | 2020/06/06 |
| 17 | 2020/06/06 |
| 18 | 2020/06/06 |
| 19 | 2020/06/06 |
| 20 | 2020/06/06 |
| 21 | 2020/06/06 |
| 22 | 2020/06/06 |
| 23 | 2020/06/06 |
| 24 | 2020/06/06 |
| 25 | 2020/06/06 |
| 26 | 2020/06/06 |
| 27 | 2020/06/06 |
| 28 | 2020/06/06 |
| 29 | 2020/06/06 |
| 30 | 2020/06/06 |
| 31 | 2020/06/06 |
| 32 | 2020/06/06 |
| 33 | 2020/06/06 |
| 34 | 2020/06/06 |
| 35 | 2020/06/06 |
| 36 | 2020/06/06 |
| 37 | 2020/06/06 |
| 38 | 2020/06/06 |
| 39 | 2020/06/06 |
| 40 | 2020/06/06 |
| 41 | 2020/06/06 |
| 42 | 2020/06/06 |
| 43 | 2020/06/06 |
| 44 | 2020/06/06 |
| 45 | 2020/06/06 |
| 46 | 2020/06/06 |
| 47 | 2020/06/06 |
| 48 | 2020/06/06 |
| 49 | 2020/06/06 |
| 50 | 2020/06/06 |
| 51 | 2020/06/06 |
| 52 | 2020/06/06 |
| 53 | 2020/06/06 |
| 54 | 2020/06/06 |
| 55 | 2020/06/06 |
| 56 | 2020/06/06 |
| 57 | 2020/06/06 |
| 58 | 2020/06/06 |
| 59 | 2020/06/06 |
| 60 | 2020/06/06 |
| 61 | 2020/06/06 |
| 62 | 2020/06/06 |
| 63 | 2020/06/06 |
| 64 | 2020/06/06 |
| 65 | 2020/06/06 |
| 66 | 2020/06/06 |
| 67 | 2020/06/06 |
| 68 | 2020/06/06 |
| 69 | 2020/06/06 |
| 70 | 2020/06/06 |
| 71 | 2020/06/06 |
| 72 | 2020/06/06 |
| 73 | 2020/06/06 |
| 74 | 2020/06/06 |
| 75 | 2020/06/06 |
| 76 | 2020/06/06 |
| 77 | 2020/06/06 |
| 78 | 2020/06/06 |
| 79 | 2020/06/06 |
| 80 | 2020/06/06 |
| 81 | 2020/06/06 |
| 82 | 2020/06/06 |
| 83 | 2020/06/06 |
| 84 | 2020/06/06 |
| 85 | 2020/06/06 |
| 86 | 2020/06/06 |
| 87 | 2020/06/06 |
| 88 | 2020/06/06 |
| 89 | 2020/06/06 |
| 90 | 2020/06/06 |
| 91 | 2020/06/06 |
| 92 | 2020/06/06 |
| 93 | 2020/06/06 |
| 94 | 2020/06/06 |
| 95 | 2020/06/06 |
| 96 | 2020/06/06 |
| 97 | 2020/06/06 |
| 98 | 2020/06/06 |
| 99 | 2020/06/06 |
| 100 | 2020/06/06 |



RYAN PRIVATE LIMITED

T: +9603310548 F: +9603310776

E: info@ryan.com.mv



W: www.ryan.com.mv

3rd floor, V.I. Aquas, Koonimalegala, Malé

Title: First - Second Floor FDP Layout

Page: FDP 02-02

The contents of these drawings remain as a property of RYAN Private Limited. Any use other than those expressly stated is a violation of this copyright.

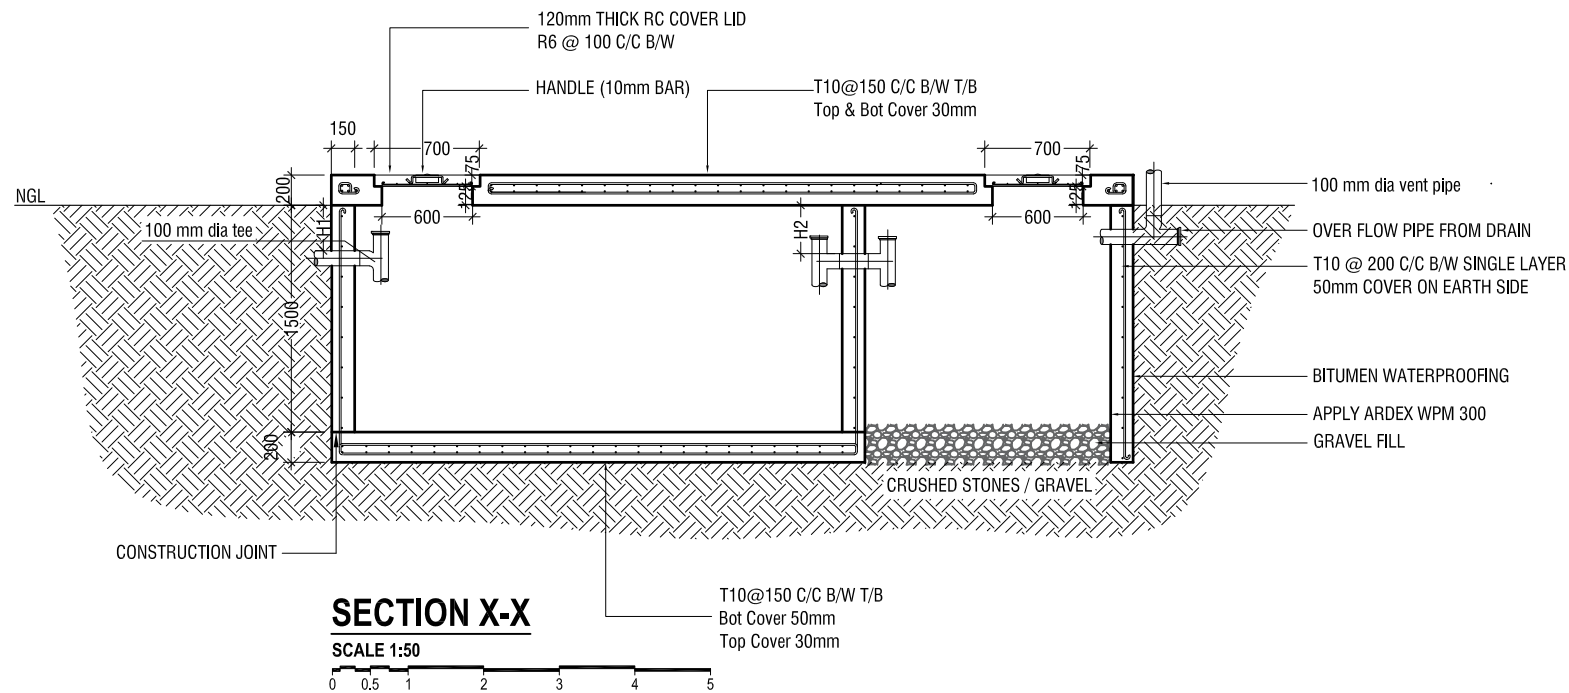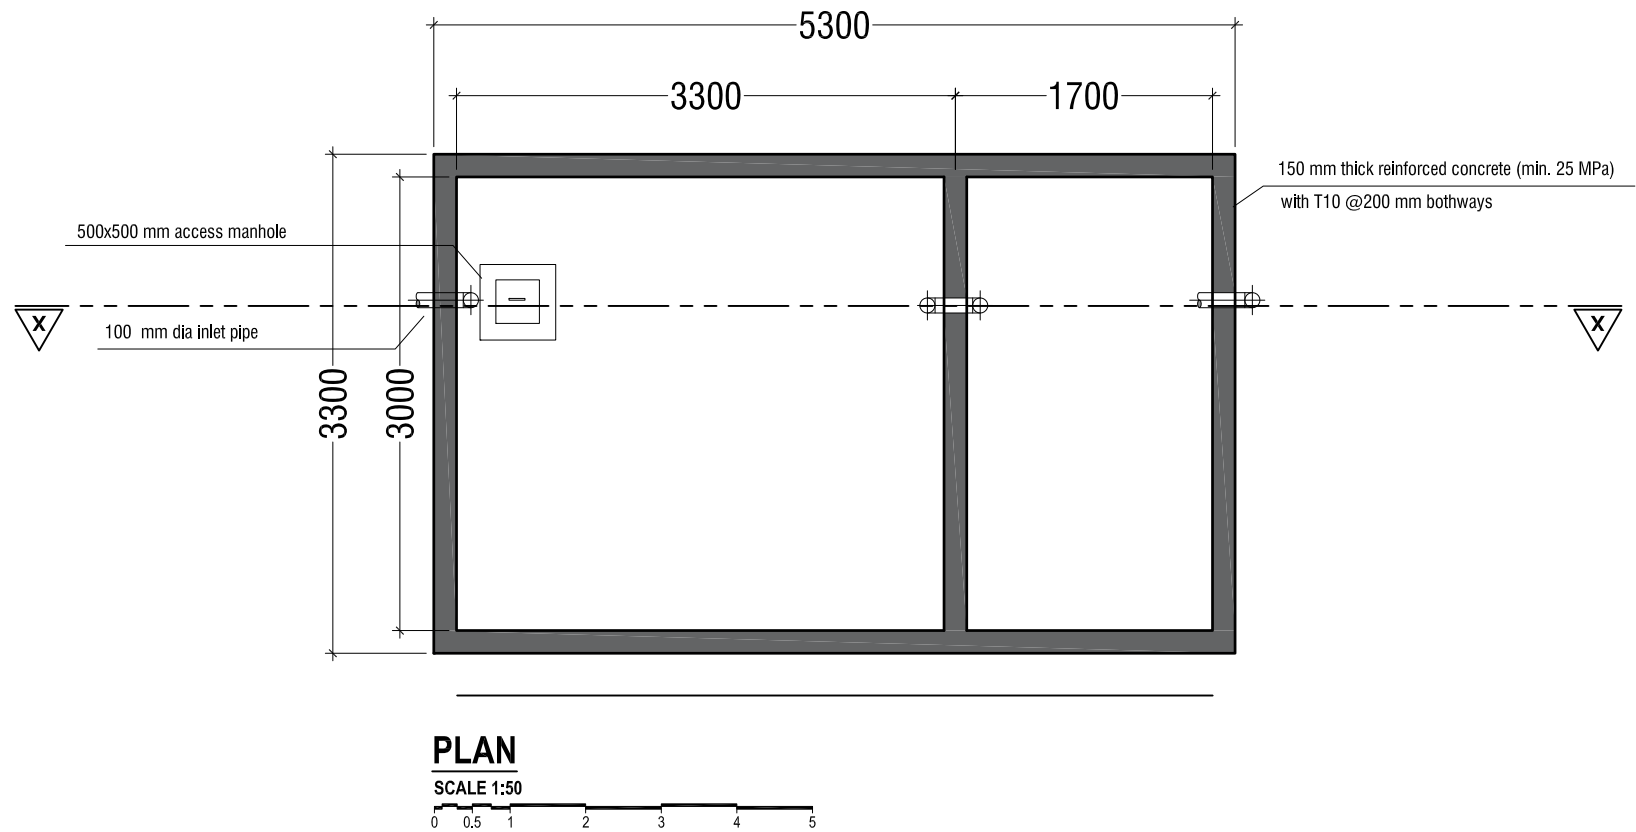

NOTE:

H1 < H2

- TOP AND BOTTOM OF SEPTIC TANK SHOULD BE OF 200mm THICK
- BITUMINOUS WATERPROOFING TO BE APPLIED BELOW GROUND SURFACE
- REINFORCEMENT TO HAVE A COVER OF 50mm FROM EARTH

SEPTIC TANK DETAIL

SCALE 1:50



Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)
Client: Ministry of Education

Project Number: RI/2020/006

Date: January 2021

Architect: Maryam Irasha Shareef

Engineer: Mohamed Muththalib Waleed

Drawn by: Maryam Leevan Jaleel

Services: Ashraf Ahmed

Interior:-

| Rev no | Date |
|--------|------|
| 1 | |
| 2 | |
| 3 | |
| 4 | |



RYAN PRIVATE LIMITED


t: +9603315049 f: +9603310776
e: info@ryan.com.mv
w: www.ryan.com.mv
3rd floor, H. Azum, Armeenemmagu, Male'

Title: Septic Tank Detail


Page: Detail 01-02

The contents of these drawings remain as a property of RYAN Private Limited. Any use other than those expressly stated is a violation of this copyright

WATER TANK WALL TOP & BOTTOM SLAB

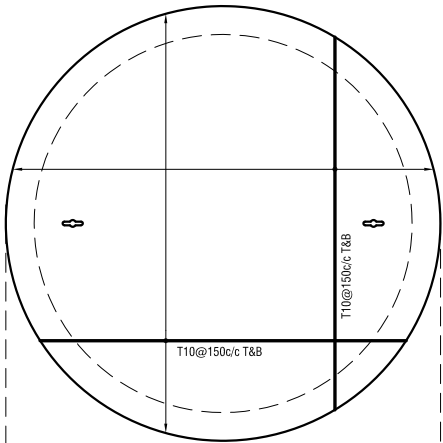

WATER TANK WALL REINF.

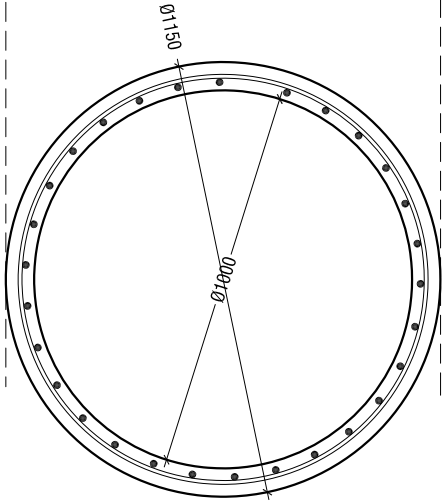


WATER TANK DETAILS


SCALE 1:20




WATER TANK SECTION

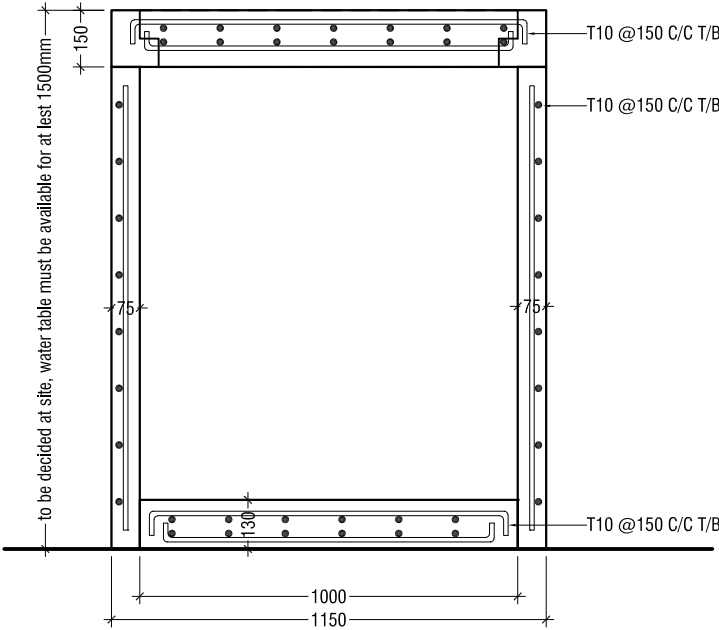


ELEVATION

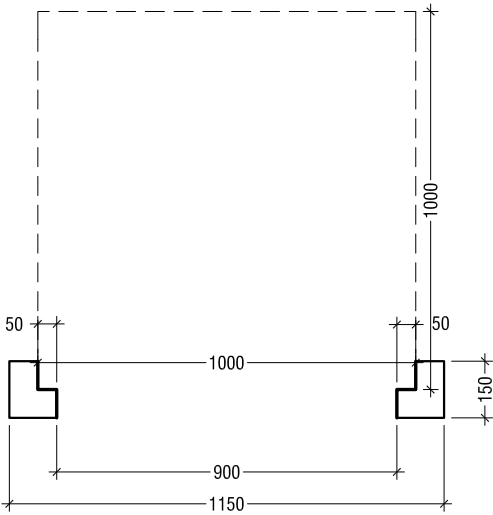

SECTION

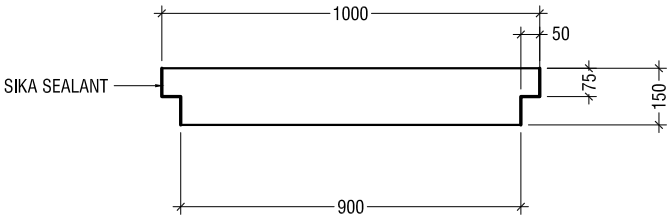

PLAN

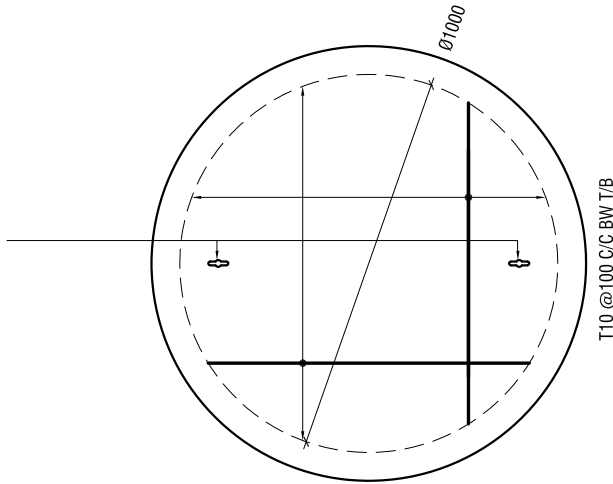

NOTE:

- ALL CONCRETE WORKS BELOW GROUND AND AT TERRACE LEVEL TO BE TREATED WITH 'SIKA' WATERPROOFING CHEMICAL OR EQUIVALENT
- PROVIDE PROVISION FOR WATER ENTRANCE THROUGH THE BASE

WATER TANK LID DETAILS

SCALE 1:20



Sn.Hithadhoo Sharafuddin School 18 Classroom Block (3 story)

Client: Ministry of Education

| Rev no | Date |
|--------|------------|
| 1 | 2021/01/01 |
| 2 | 2021/01/01 |
| 3 | 2021/01/01 |
| 4 | 2021/01/01 |

Project Number: RI/2020/006

Date: January 2021

Architect: Maryam Irasha Shareef

Engineer: Mohamed Muththallo Waleed

Drawn by: Maryam Leevan Jaleel

Services: Aishath Ahmed

The contents of these drawings remain as a property of Rlyan Private Limited. Any use other than those expressly stated is a violation of this copyright.



RIYAN PRIVATE LIMITED

t: +9603315049 f: +9603310776
e: info@rlyan.com.mv
w: www.rlyan.com.mv
3rd floor, H. Azum, Ameenemoggu, Male*

Title: Ground Water Well
Detail

Page: Detail 02-02