


L03-BILEHDHOO

POWER HOUSE MAIN LV DISTRIBUTION BOARD

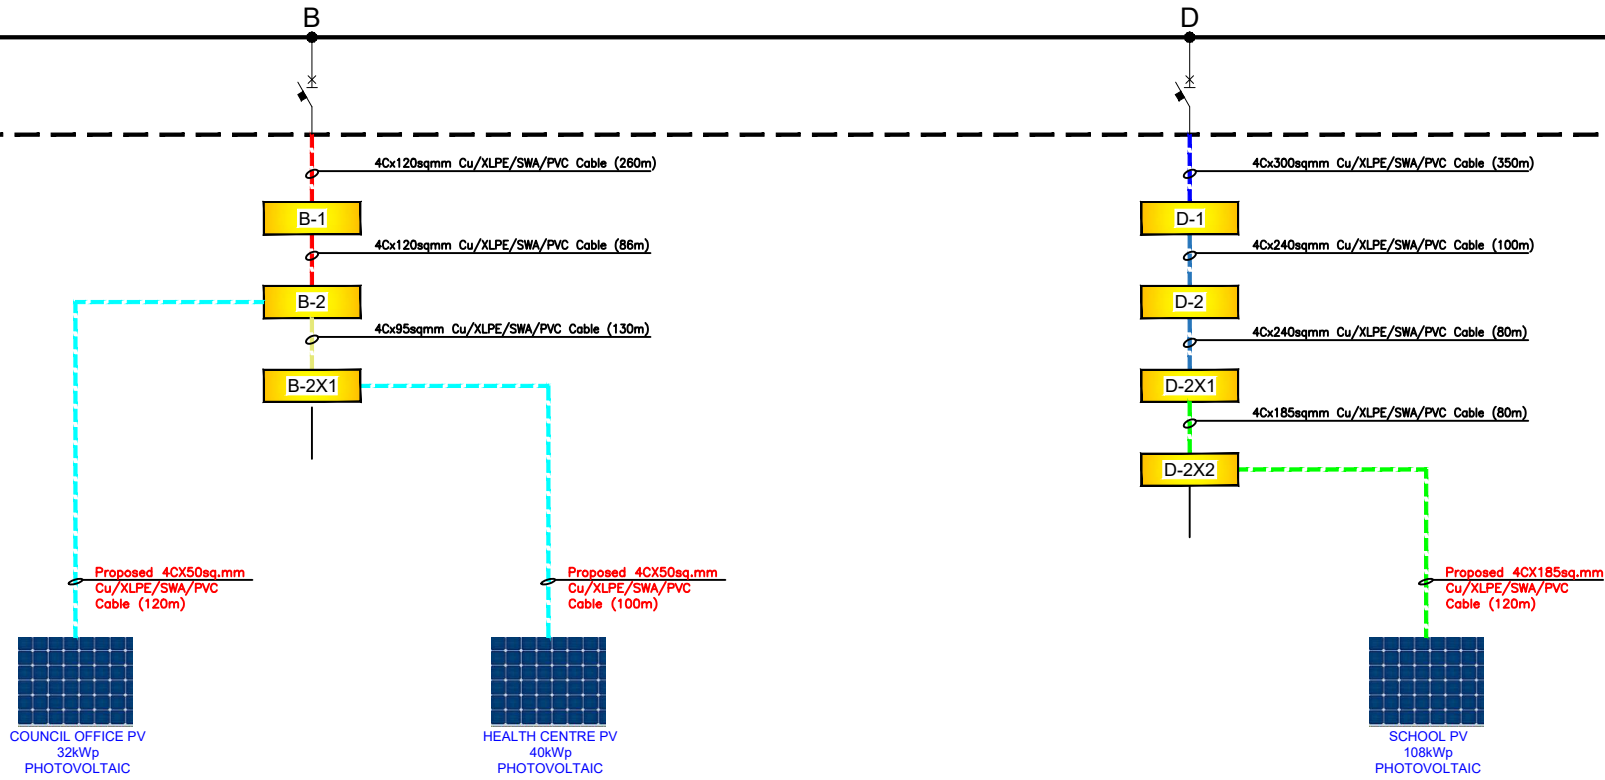

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
————	EXISTING Cable	-
-----	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 50sq.mm Cu/XLPE/SWA/PVC Cable	220m
-----	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	130m
-----	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	346m
-----	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	-
-----	PROPOSED 185sq.mm Cu/XLPE/SWA/PVC Cable	200m
-----	PROPOSED 240sq.mm Cu/XLPE/SWA/PVC Cable	180m
-----	PROPOSED 300sq.mm Cu/XLPE/SWA/PVC Cable	350m
D/B	EXISTING DISTRIBUTION BOX	-
D/B	PROPOSED DISTRIBUTION BOX	-
D/B	EXISTING DISTRIBUTION BOX TO BE REPLACED	7 Nos
D/B	EXISTING DISTRIBUTION BOX TO BE MODIFIED	-

NOTES:-

- THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
- CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE GRID MODIFICATION DIAGRAM FOR L03-BILEHDHOO FOR PV INTEGRATION		DESIGN : PMU	SCALE : N.T.S
							DRAWN : PMU	DRW NO. : KL03-J431-BILEHDH00-GR
					PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : BILEHDHOO
							DATE: : 25DEC21	PAGE : 1