
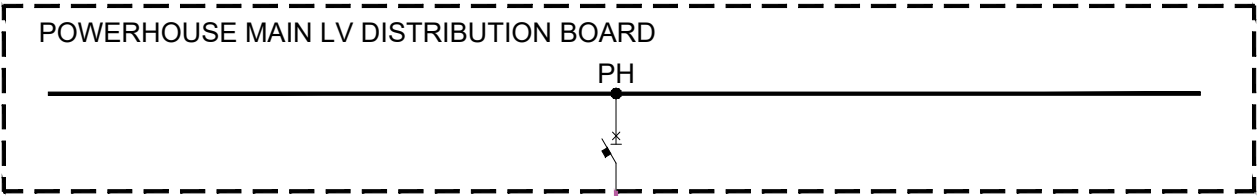


K07-KOLHUFUSHI

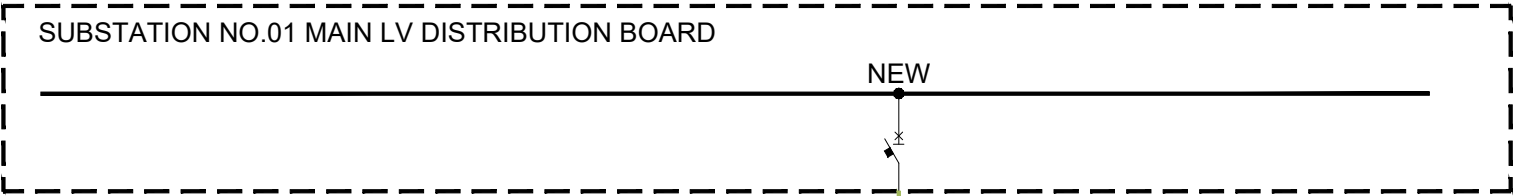

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
	EXISTING Cable	-
	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	50m
	PROPOSED 50sq.mm Cu/XLPE/SWA/PVC Cable	100m
	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	70m
	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	150m
	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	200m
	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	200m
	PROPOSED 185sq.mm Cu/XLPE/SWA/PVC Cable	-
	PROPOSED 300sq.mm Cu/XLPE/SWA/PVC Cable	-
	EXISTING DISTRIBUTION BOX	-
	PROPOSED DISTRIBUTION BOX	3 Nos
	EXISTING DISTRIBUTION BOX TO BE REPLACED	-
	EXISTING DISTRIBUTION BOX TO BE MODIFIED	-

NOTES:-

- THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
- CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE GRID MODIFICATION DIAGRAM FOR K07-KOLHUFUSHI FOR PV INTEGRATION	DESIGN : PMU	SCALE : N.T.S
						DRAWN : PMU	DRW NO. : K07-J431-KOLHUFUSHI-GR
					PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	LICENCE NO:	ISLAND NAME : KOLHUFUSHI
					CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	DATE: : 25DEC21	PAGE : 1