


K06-NAALAAFUSHI

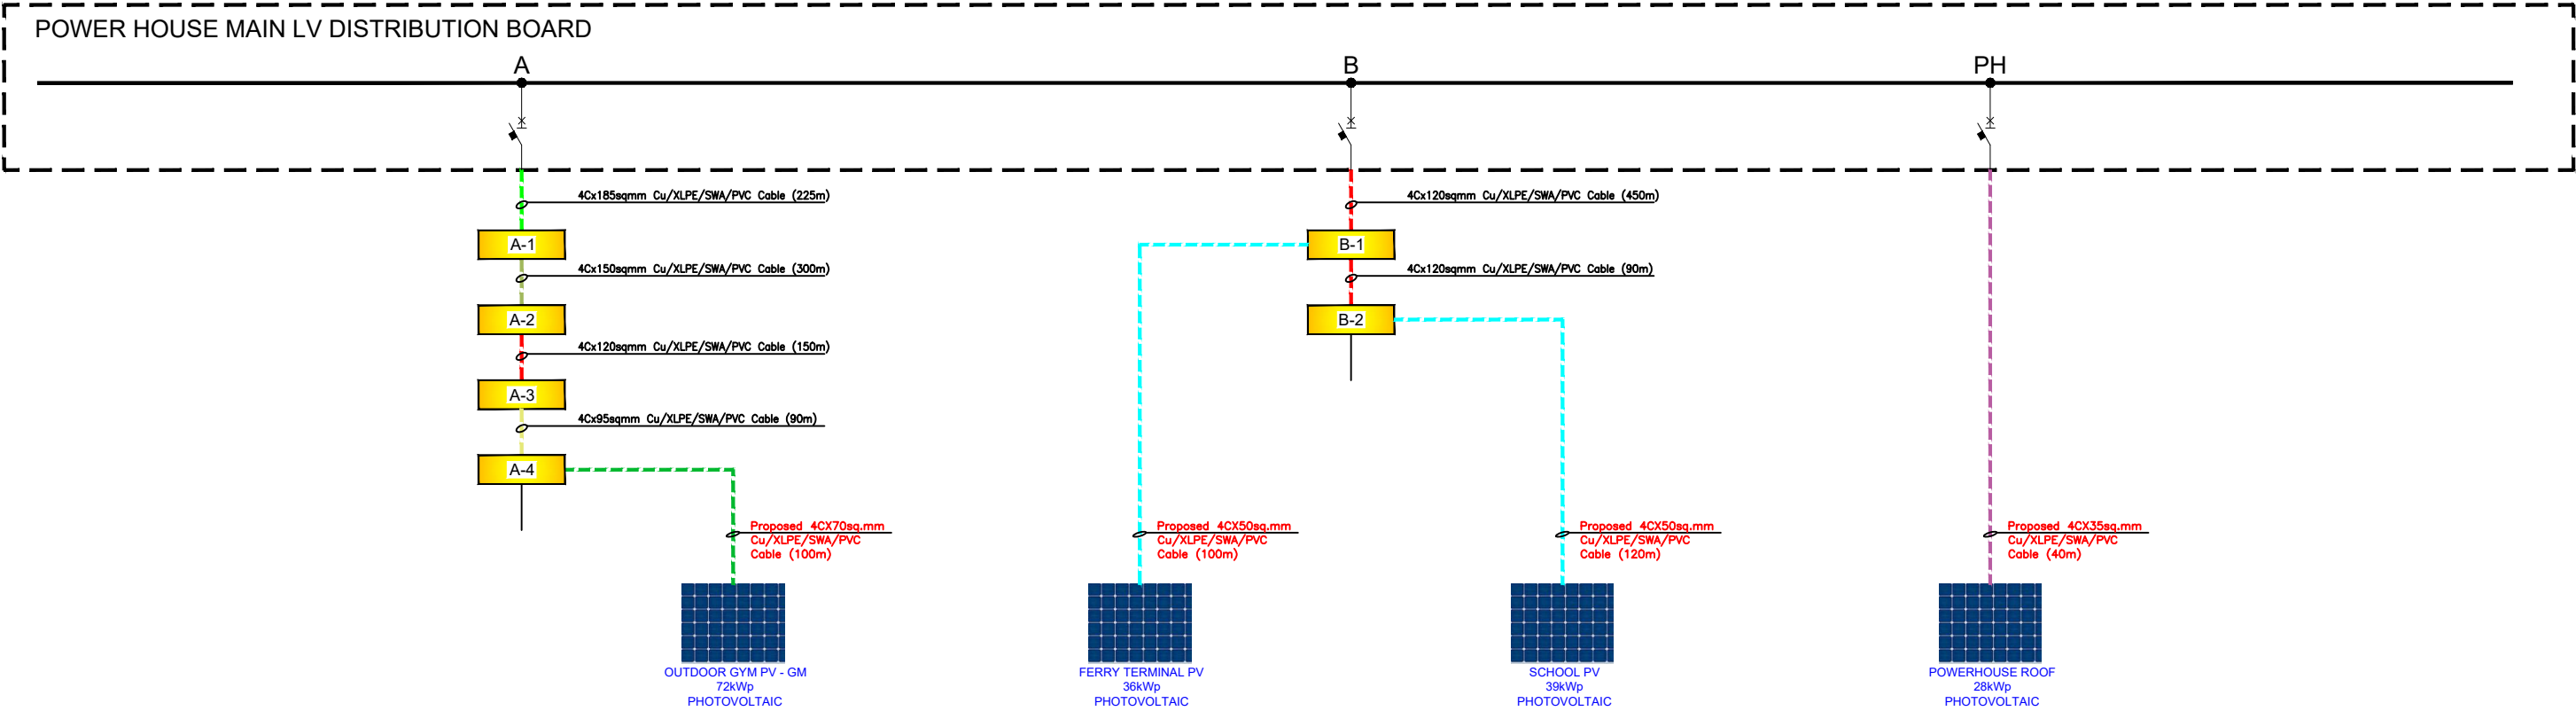

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
—	EXISTING Cable	-
---	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	40m
---	PROPOSED 50sq.mm Cu/XLPE/SWA/PVC Cable	220m
---	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	100m
---	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	90m
---	PROPOSED 120sq.mm Cu/XLPE/SWA/PVC Cable	690m
---	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	300m
---	PROPOSED 185sq.mm Cu/XLPE/SWA/PVC Cable	225m
---	PROPOSED 300sq.mm Cu/XLPE/SWA/PVC Cable	-
D/B	EXISTING DISTRIBUTION BOX	-
D/B	PROPOSED DISTRIBUTION BOX	-
D/B	EXISTING DISTRIBUTION BOX TO BE REPLACED	6 Nos.
D/B	EXISTING DISTRIBUTION BOX TO BE MODIFIED	-

NOTES:-

- THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
- CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE GRID MODIFICATION DIAGRAM FOR K06-NAALAAFUSHI FOR PV INTEGRATION	DESIGN : PMU	SCALE : N.T.S
						DRAWN : PMU	DRW NO. : K06-J431-NAALAAFUSHI-GR
					PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	LICENCE NO:	ISLAND NAME : NAALAAFUSHI
					CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	DATE: : 25DEC21	PAGE : 1