


N05-GURAI DHOO

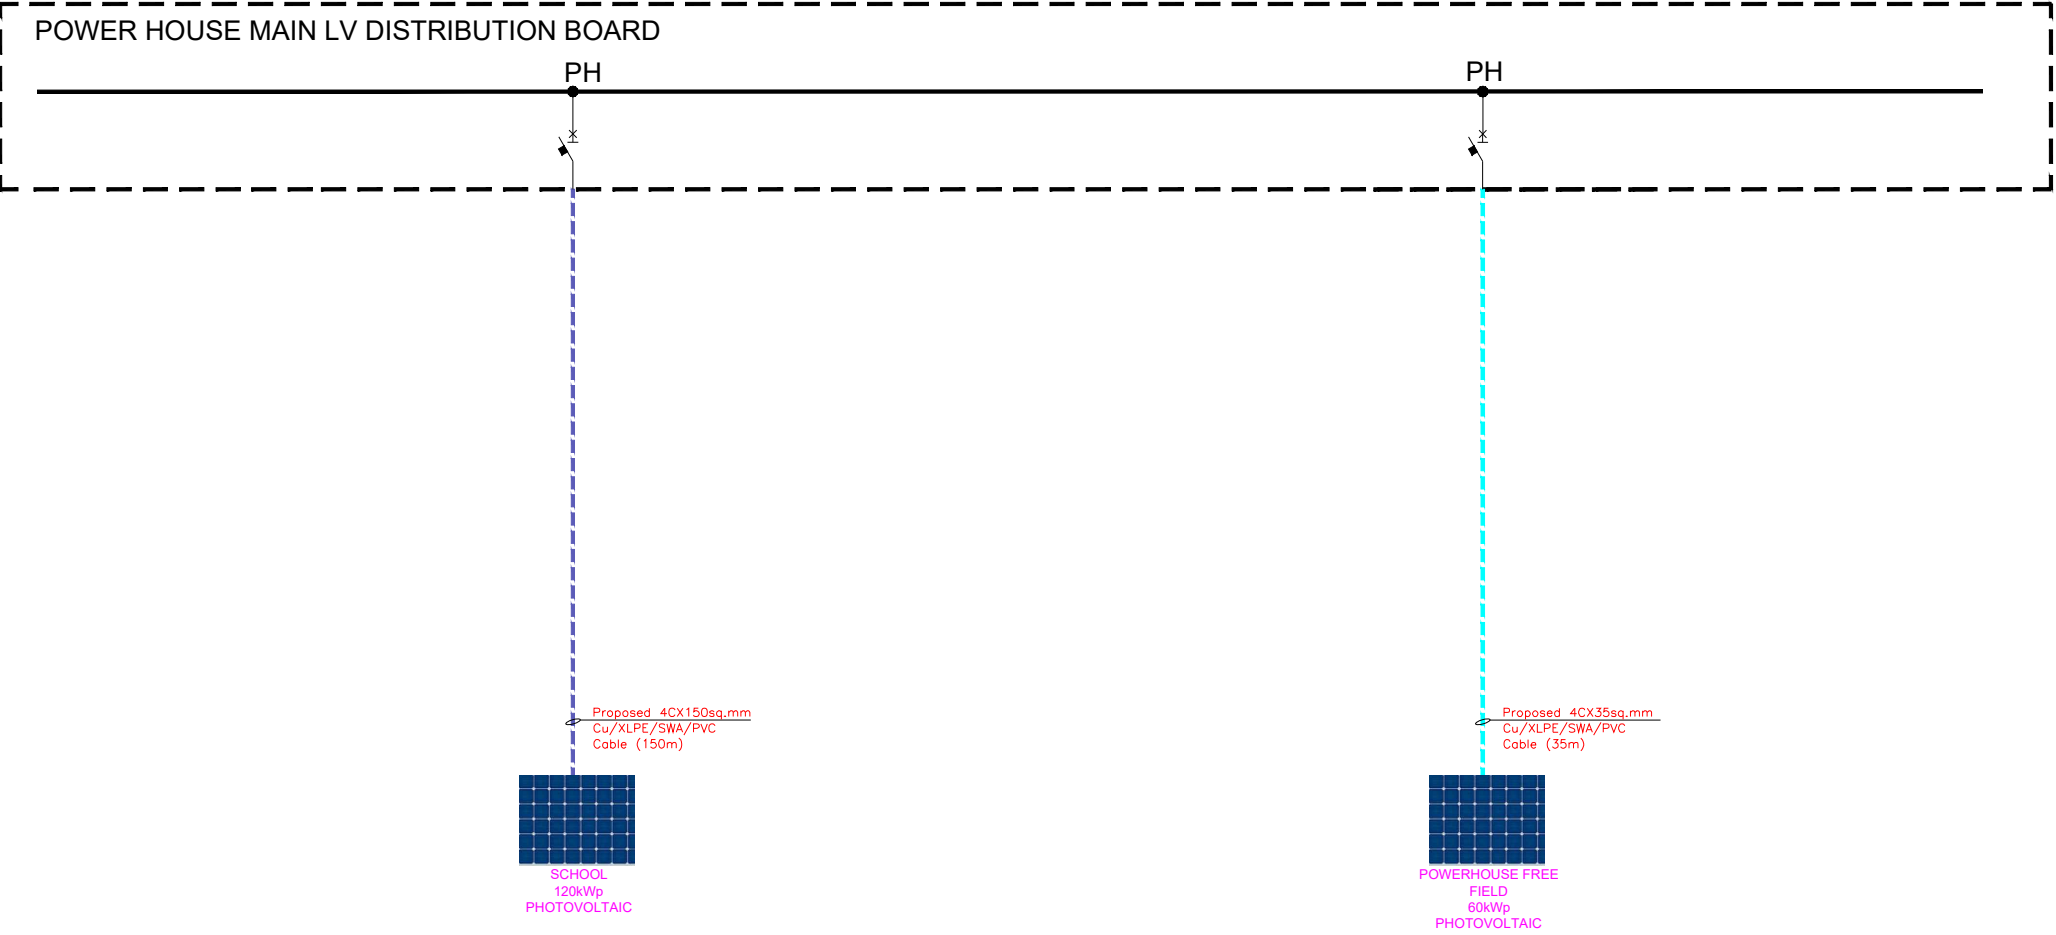

LEGEND:-

SYMBOL	DESCRIPTION	QUANTITY
<div></div>	EXISTING Cable	-
<div></div>	PROPOSED 35sq.mm Cu/XLPE/SWA/PVC Cable	35m
<div></div>	PROPOSED 70sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 95sq.mm Cu/XLPE/SWA/PVC Cable	-
<div></div>	PROPOSED 150sq.mm Cu/XLPE/SWA/PVC Cable	150m
<div>D/B</div>	EXISTING DISTRIBUTION BOX	-
<div>D/B</div>	PROPOSED DISTRIBUTION BOX	-

NOTES:-

1. THESE DRAWINGS ARE PRELIMINARY AND ARE FOR TENDERING PURPOSES ONLY.
2. CONTRACTOR SHALL CARRY OUT DETAILED SITE SURVEY AND ENGINEERING / STUDY TO EVALUATE AND PROPOSE THE EXTENT OF REPLACEMENT / MODIFICATION REQUIRED IN THE EXISTING DISTRIBUTION NETWORK. THIS IS SUBJECT TO REVIEW AND APPROVAL BY THE EMPLOYER DURING THE ENGINEERING PHASE OF THE PROJECT.

	PURPOSE OF SUBMISSION	REV	AUTHORISED BY	DATE	DRAWING TITLE NETWORK MODIFICATION DIAGRAM FOR N05–GURAI DHOO		DESIGN : PMU	SCALE : N.T.S
	FIRST REVISION	A		08JAN20			DRAWN : MARSOOM	DRW NO. : G409–THAA–N05–SLD–1
		B		09 MAY 20	PROJECT PREPARING OUTER ISLANDS SUSTAINABLE DEVELOPMENT	CLIENT: GOVERNMENT OF THE REPUBLIC OF MALDIVES	LICENCE NO:	ISLAND NAME : GURAI DHOO
							DATE: : 30SEP19	PAGE : 1